



TABLE OF CONTENTS

<u>MISCELLANEOUS</u>	
Masonry Trash Container Enclosure	MI 1
Wooden Trash Container Enclosure	MI 2
Survey Monument	MI 3
 <u>STORM DRAINAGE</u>	
Drop Inlet	SD 1
Inlet Structure	SD 2
Inlet Structure Steel Throat	SD 3
Standard Manhole	SD 4
Manhole Frame & Cover	SD 5
 <u>SANITARY SEWER</u>	
48" Manhole	SS 1
60" Manhole	SS 2
Drop Manhole	SS 3
Eccentric Manhole	SS 4
Manhole Frame & Cover	SS 5
Terminal Cleanout	SS 6
Manhole Frame & Cover Adjustment Detail	SS 7
Lateral	SS 8
 <u>STREETS</u>	
Local & Collector Streets	ST 1A
Secondary Street	ST 1B
Major Arterial Street	ST 1C
Alley	ST 1D
Cul-de-Sac	ST 2
Street Bulb Connection	ST 3
Alley Approach	ST 4
Alley "V" Gutter	ST 5
Barrier Type Curb & Gutter	ST 6
Rolled Type Curb & Gutter	ST 7
Monolithic Curb, Gutter & Sidewalk	ST 8
Sidewalk	ST 9
Curb Return	ST 10
Residential Drive Approach	ST 11
Commercial Drive Approach	ST 12
Curb Removal at New Drive Approach	ST 13
Barrier Type Curb Only	ST 14
Concrete Gutter at Existing Curb	ST 15
Cross Gutter	ST 16
Timber Barricade	ST 17
Street Sign Location	ST 18
Traffic Bars	ST 19
Pavement Patches	ST 20
Tree Well Commercial Sidewalk Pattern Only	ST 21
 <u>WATER</u>	
Concrete Thrust Block Detail	WA 1
Fire Hydrant Assembly	WA 2
Gate Valve	WA 3
Valve Access Box	WA 4
1" Water Service	WA 5
Blow Off	WA 6
Fire Serfice	WA 7
Fire Hydrant Protection Assembly	WA 8

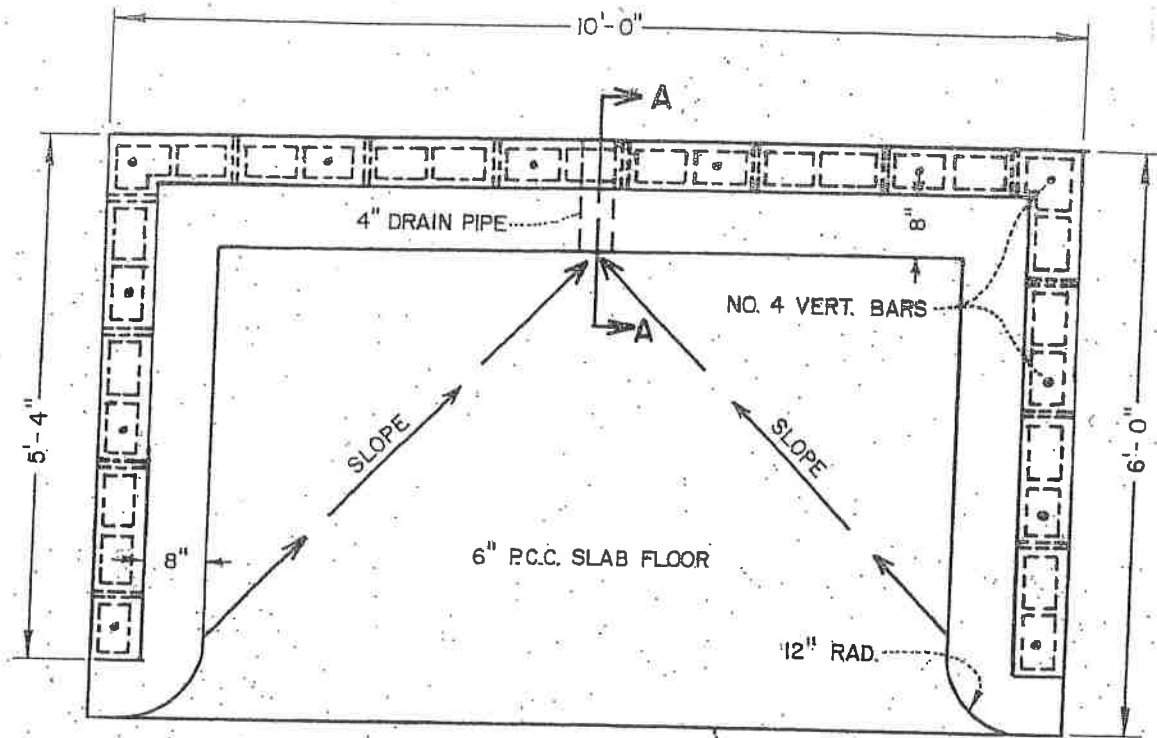

PLAN

SLAB TO BE FLUSH WITH ASPHALT CONCRETE PAVEMENT.

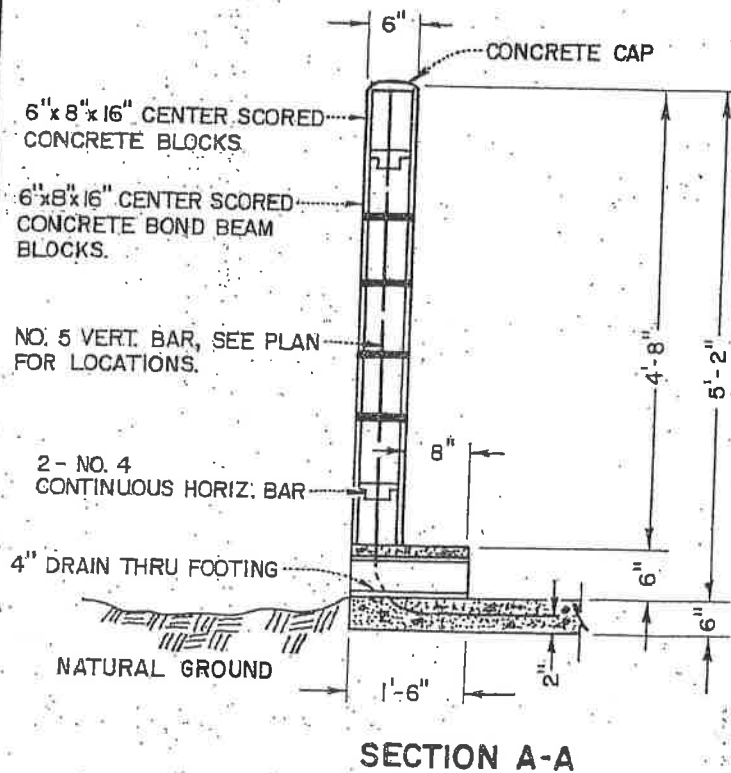

SECTION A-A

NOTES:

1. ALL CELLS IN CONCRETE BLOCKS SHALL BE FILLED SOLID WITH COURSE AGGREGATE GROUT
 2. CORNER BLOCK ENDS AND CENTER WEB SHALL BE BOND BEAM BLOCK
 3. ALL HORIZONTAL & VERTICAL JOINTS SHALL BE RAKED TO MATCH CENTER SCORED BLOCK.
 4. CONCRETE BLOCK, MORTAR AND COARSE GROUT SHALL CONFORM WITH LATEST EDITION OF THE UNIFORM BUILDING CODE.
 5. SLAB FLOOR AND FOOTING SHALL BE 2500psi PORTLAND CEMENT CONCRETE.
 6. GROUND TO BE SLOPED AWAY FROM WALLS.
- THIS STANDARD IS FOR SINGLE 3 cy. OR SMALLER BINS.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

MASONRY TRASH CONTAINER ENCLOSURE


MARK	DATE	REVISION

Engineering Standard

Approved *Anna J. White*


Date 9/14/79

MI-1

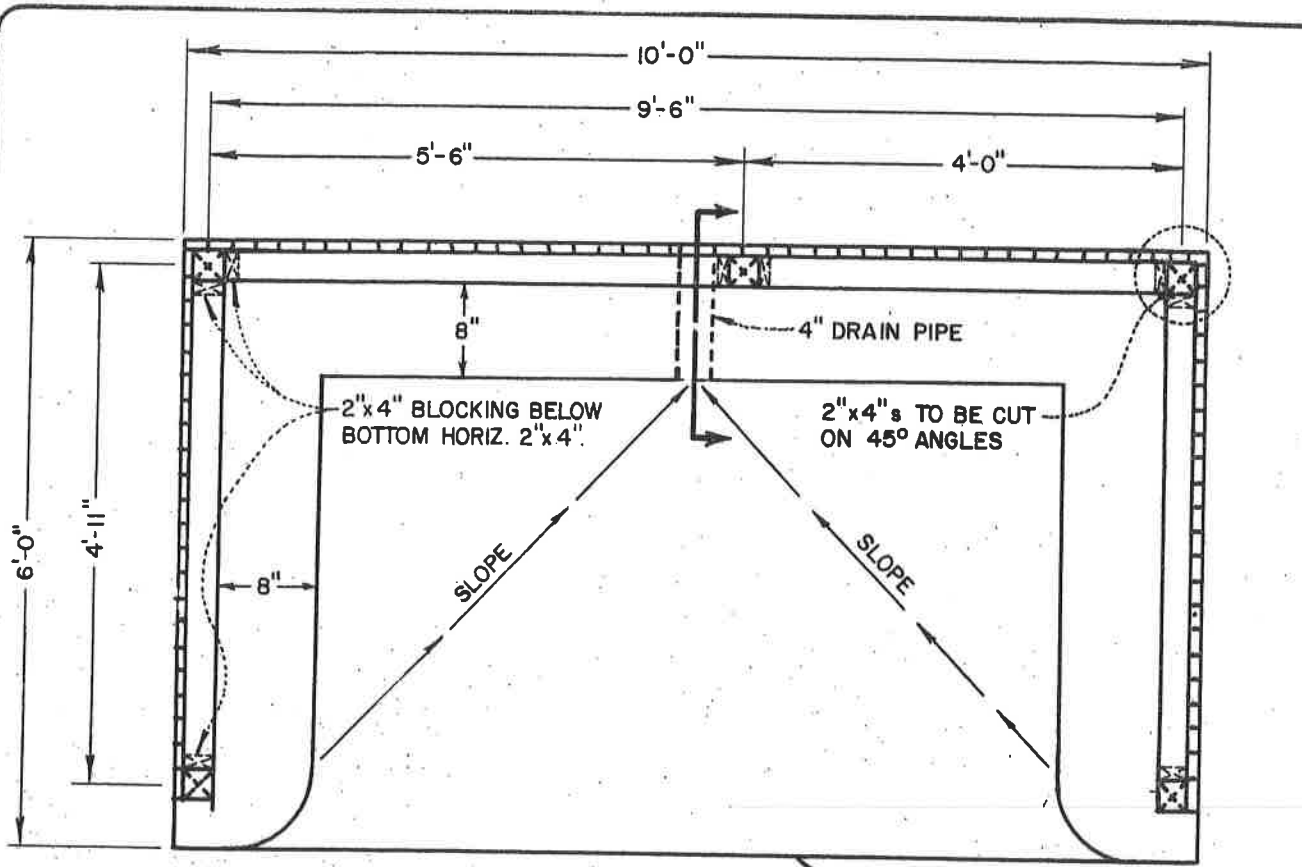

PLAN

SLAB TO BE FLUSH WITH ASPHALT OR CONCRETE PAVEMENT.

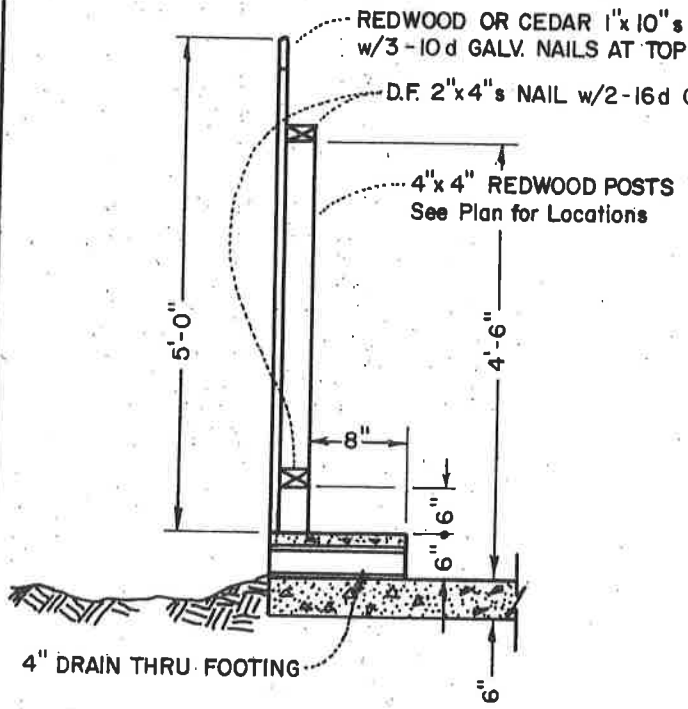

SECTION A-A

NOTES :


1. SLAB FLOOR AND FOOTINGS SHALL BE 2500psi. DESIGN PORTLAND CEMENT CONCRETE.
 2. 4" x 4" REDWOOD POSTS TO BE ANCHORED TO CONCRETE WITH POST SUPPORTS.
 3. GROUND TO BE SLOPED AWAY FROM THE SLAB FOOTING.
- THIS STANDARD IS FOR 3 cy. OR SMALLER BINS.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS


WOODEN TRASH CONTAINER ENCLOSURE

MARK	DATE	REVISION	Engineering Standard
			Approved <i>[Signature]</i>
			Date 9/14/79

MI-2

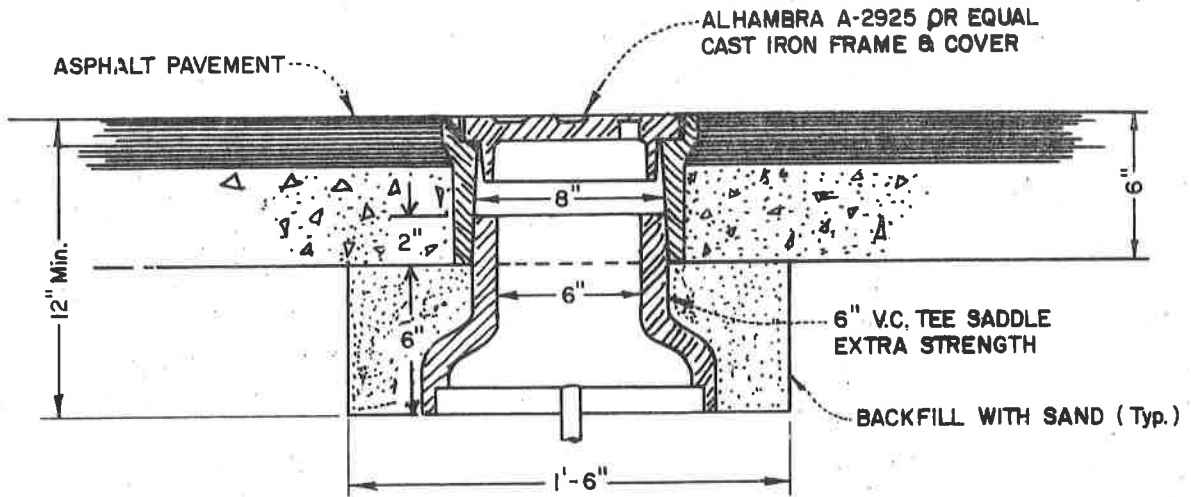

MONUMENT COVER
To be used with Type A or B monument

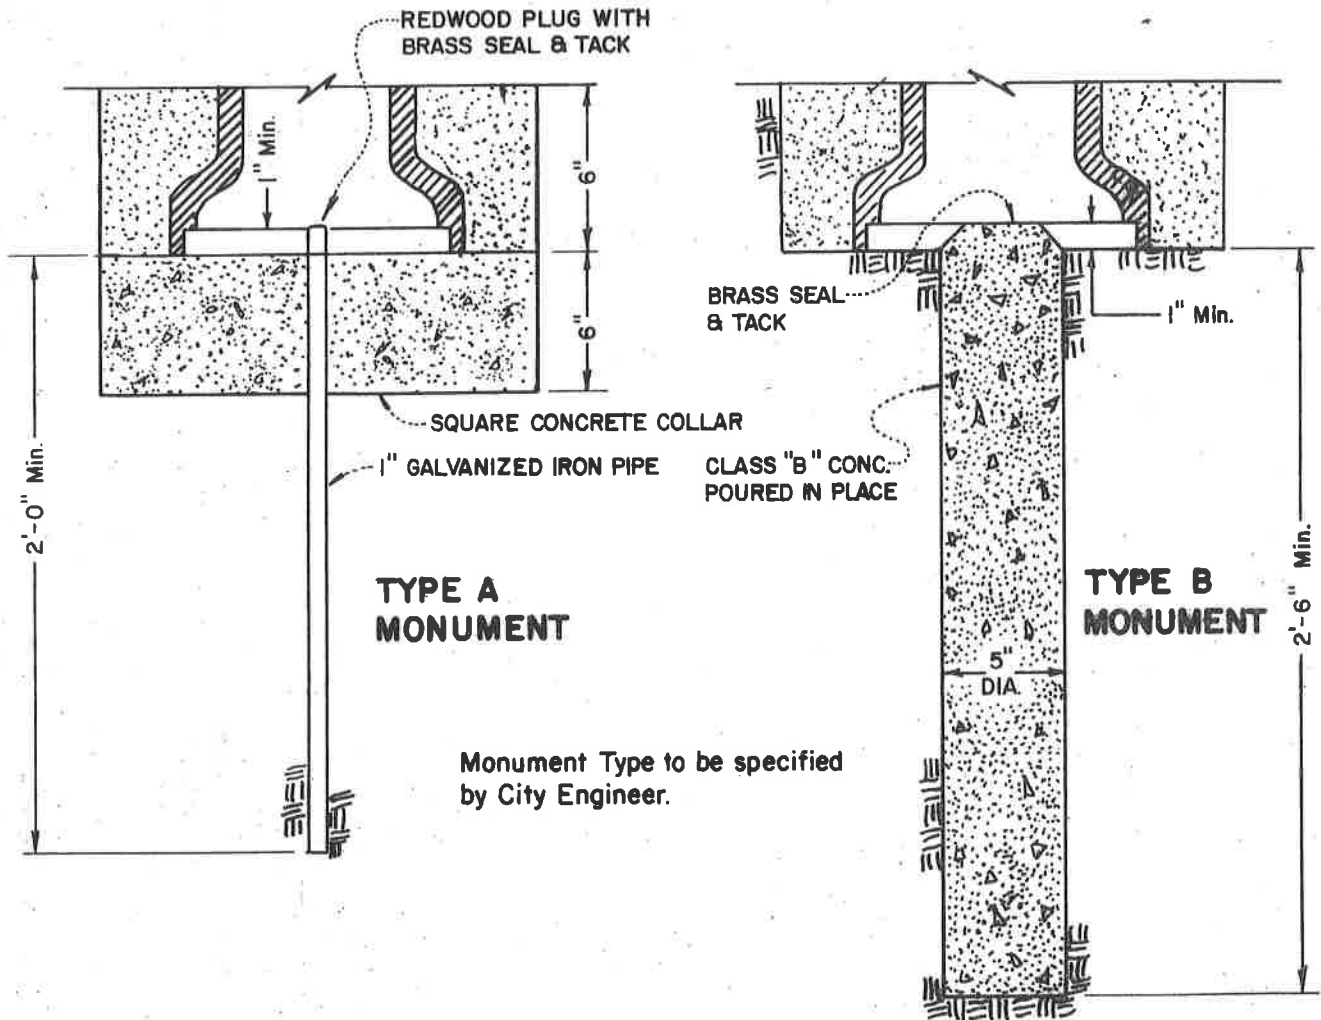

Monument Type to be specified
by City Engineer.


CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

SURVEY MONUMENT

MARK	DATE	REVISION

Engineering Standard
Approved *[Signature]*
Date 9/14/79


MI-3

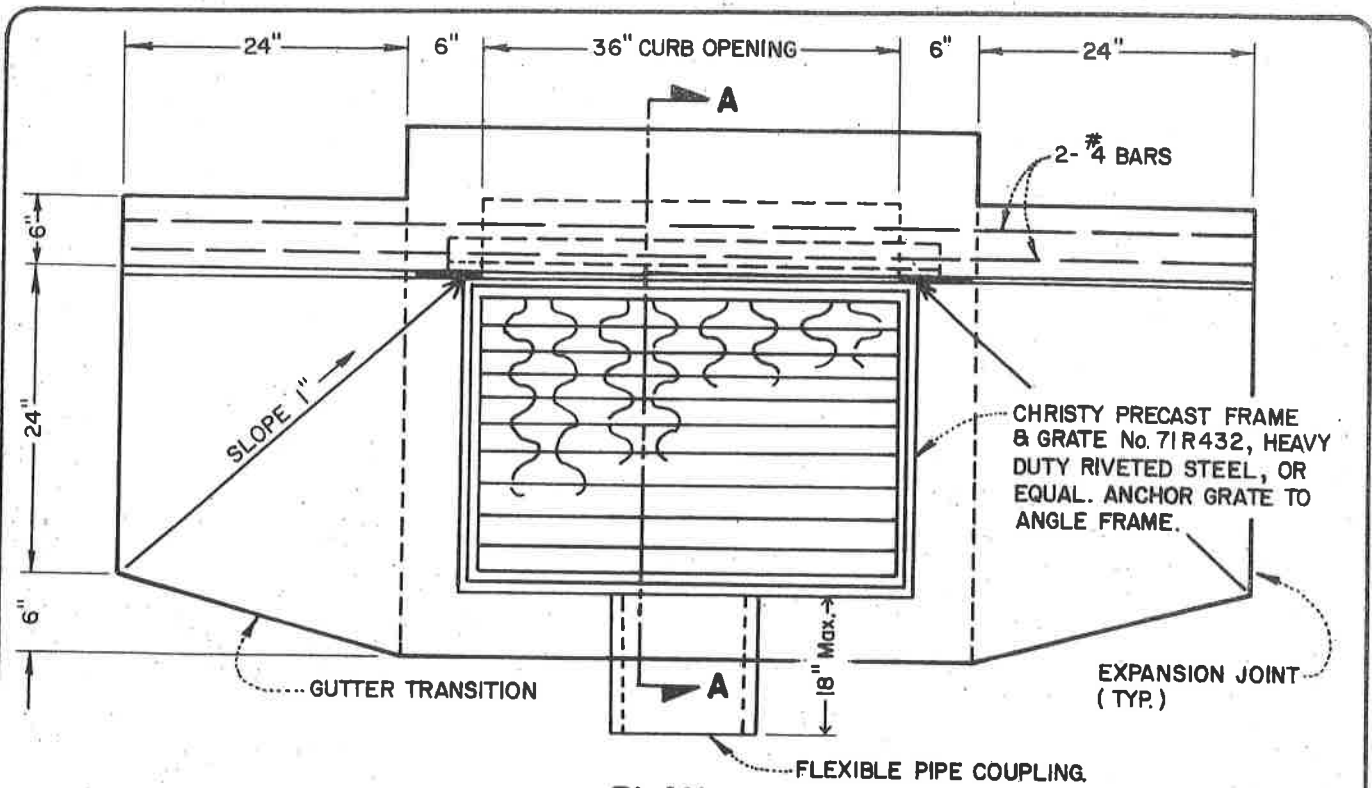

PLAN



2 - #4 BARS, CONT. 3" x 3" x 1/2" x 3'-6" LONG
 GRATE ELEVATION

- NOTES:**
1. CONCRETE SHALL REACH A MINIMUM COMPRESSIVE STRENGTH OF 2500 P.S.I. AT 28 DAYS.
 2. ALL REBAR SHALL CONFORM TO A.S.T.M. DESIG. A-615, GRADE 40

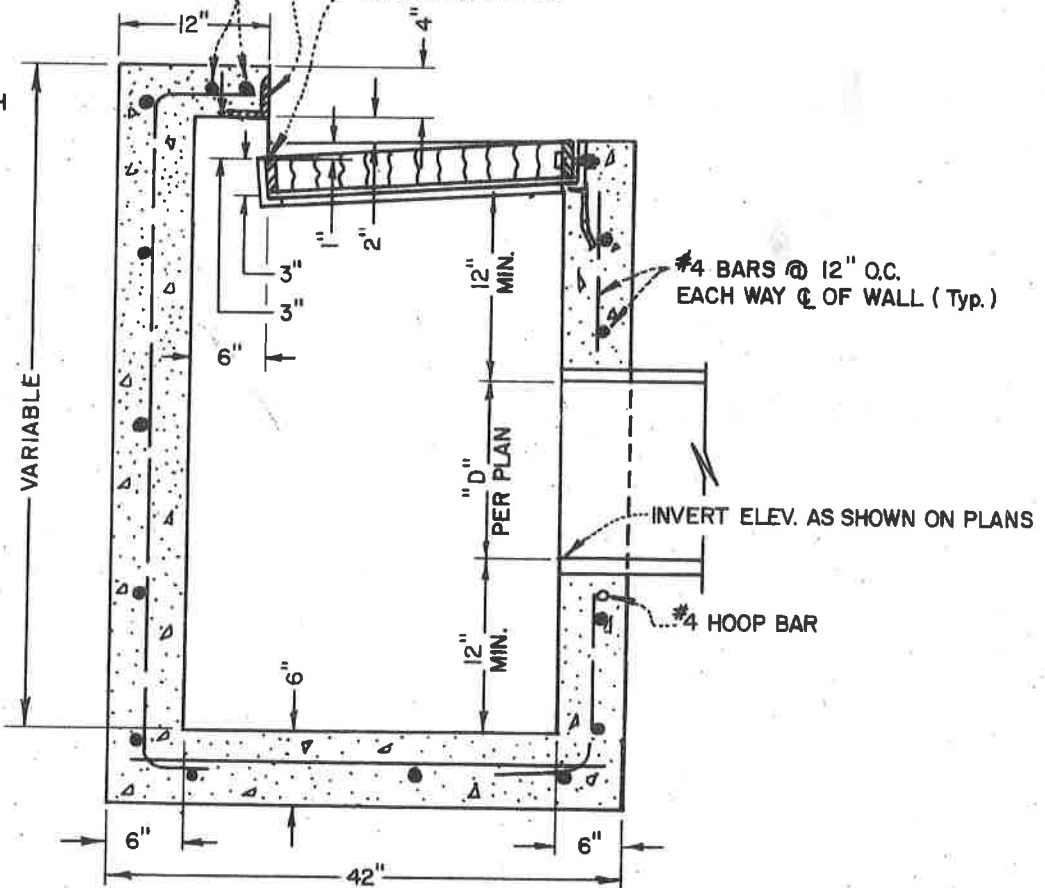


SECTION A-A

CITY OF <i>Lindsay</i> DEPARTMENT OF PUBLIC WORKS	DROP INLET																		
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="width: 10%;">MARK</th> <th style="width: 10%;">DATE</th> <th style="width: 10%;">REVISION</th> </tr> </thead> <tbody> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td></tr> </tbody> </table>	MARK	DATE	REVISION										<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 60%;">Engineering Standard</td> <td style="width: 40%;"></td> </tr> <tr> <td>Approved <i>[Signature]</i></td> <td style="text-align: center; vertical-align: middle;">SD-1</td> </tr> <tr> <td>Date 9/14/79</td> <td></td> </tr> </table>	Engineering Standard		Approved <i>[Signature]</i>	SD-1	Date 9/14/79	
MARK	DATE	REVISION																	
Engineering Standard																			
Approved <i>[Signature]</i>	SD-1																		
Date 9/14/79																			

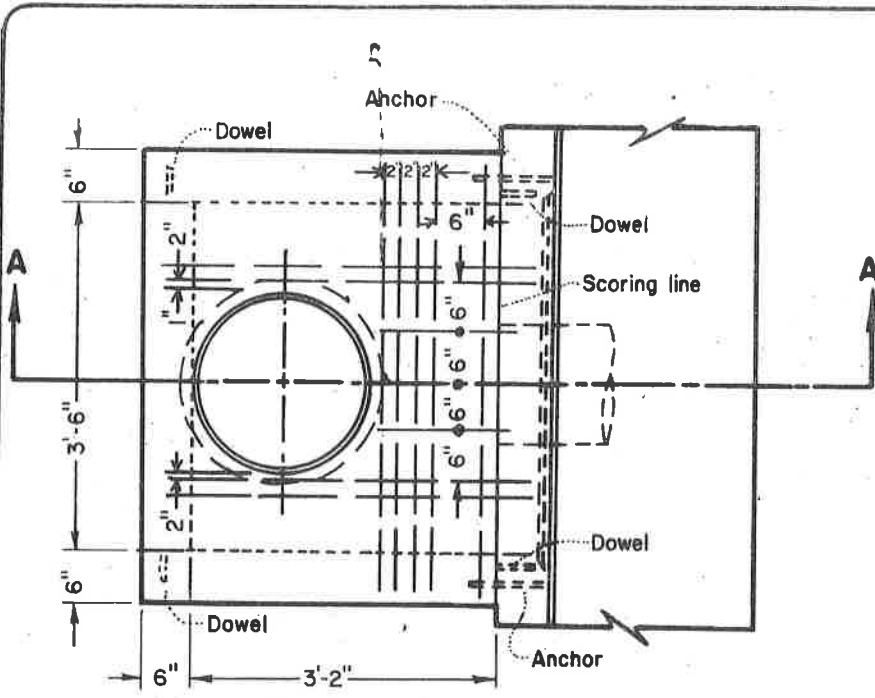

PLAN


SLOPE 1/4" PER FT. AS DIRECTED BY ENGINEER

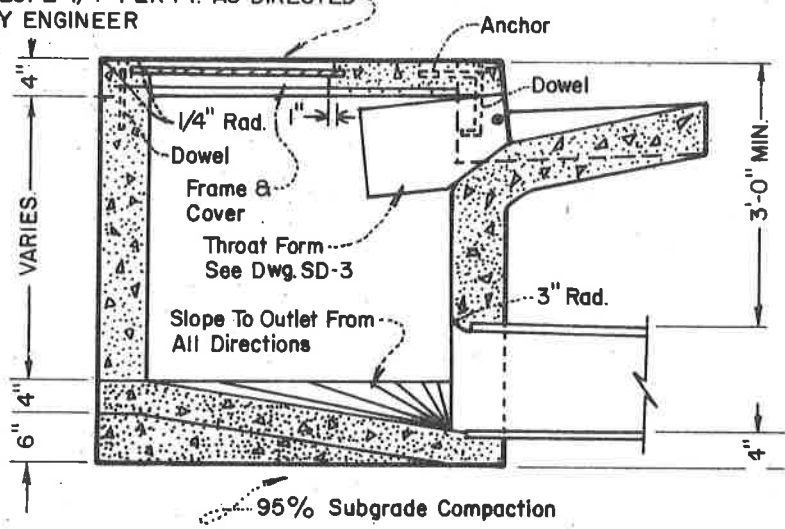

SECTION A-A

STEEL LIST	
DESCRIPTION	REQ'D.
3 BARS 4'-4" LONG	5
3 BARS 3'-11" LONG	4
3 BARS 1'-7" LONG	3
DOWEL See Detail	4
ANCHOR 4 12", 1/4" WELD	2
FRAME & COVER, Pinkerton A-335 or Equal.	1
FACE ANGLE & THROAT FORM - See Dwg. SD-3	1

CONCRETE SHALL BE 3000 p.s.i.

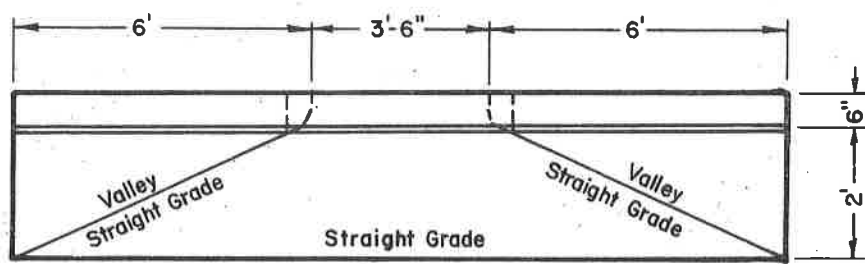


NOTE: WHEN STRUCTURE SERVES AS AN OUTLET, GUTTER GRADE SHALL NOT BE DEPRESSED.


CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

INLET STRUCTURE

MARK	DATE	REVISION	Engineering Standard	SD-2
			Approved <i>[Signature]</i>	
			Date 9/14/79	

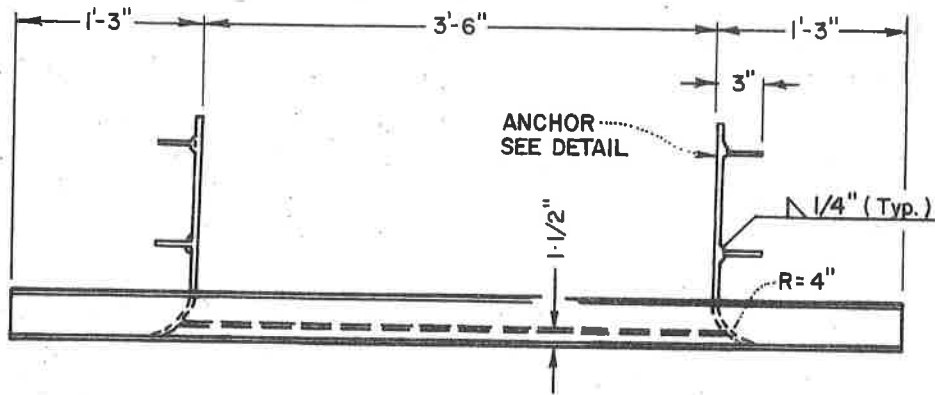


PLAN

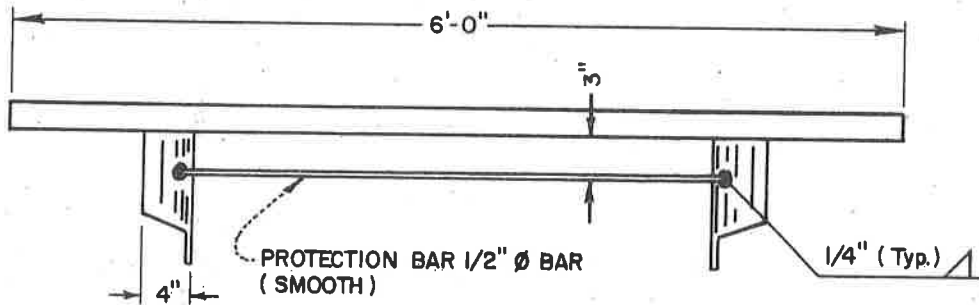

ELEVATION

NOTES:

1. ALL DIMENSIONS ARE FINISHED DIMENSIONS.
2. ALL PARTS SHALL BE STRUCTURAL GRADE STEEL UNLESS NOTED OTHERWISE.
3. ALL EXPOSED METAL PARTS PERTAINING TO THROAT FORM SHALL BE PAINTED OR DIPPED WITH AN ALUMINUM COLOR ASPHALTUM PAINT.

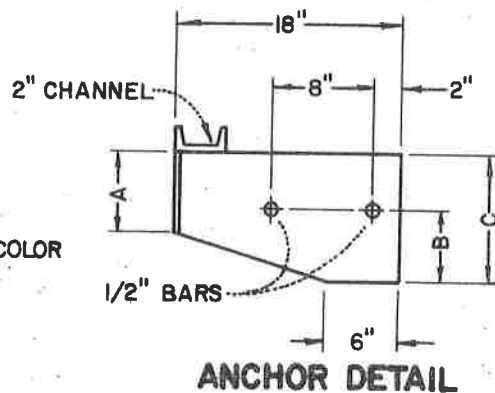

ANCHOR DETAIL

DIMENSIONS	A	B	C
INLET BOX	6-5/16"	5"	10"
OUTLET BOX	3-3/16"	2-1/2"	5"


CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

INLET STRUCTURE STEEL THROAT

MARK	DATE	REVISION

Engineering Standard
Approved *[Signature]*
Date 9/14/79

SD-3

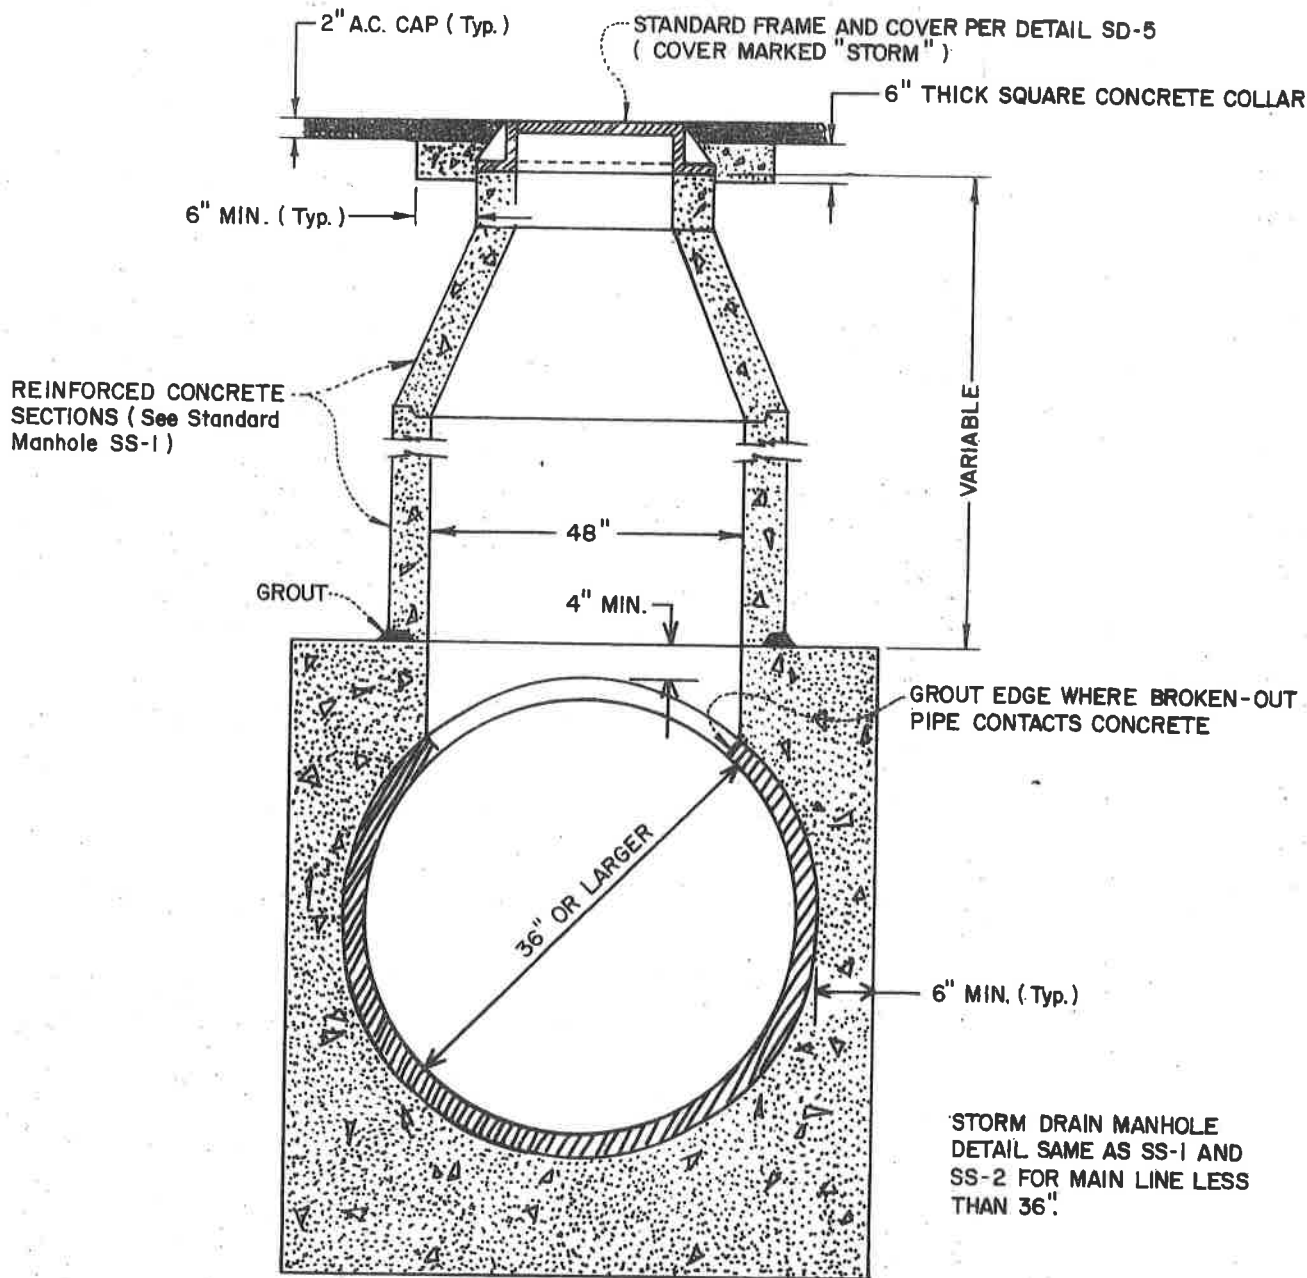

NOTES :


1. REINFORCED CONCRETE PIPE SECTIONS SHALL MEET REQUIREMENTS OF A.S.T.M. SPECIFICATION C-478-64 T.
2. MANHOLE BASE SHALL BE OF CONCRETE CONTAINING 6 SACKS OF PORTLAND CEMENT PER CUBIC YARD.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS


STANDARD MANHOLE

MARK	DATE	REVISION	Engineering Standard
			Approved: <i>[Signature]</i>
			Date: 9/14/79

SD-4

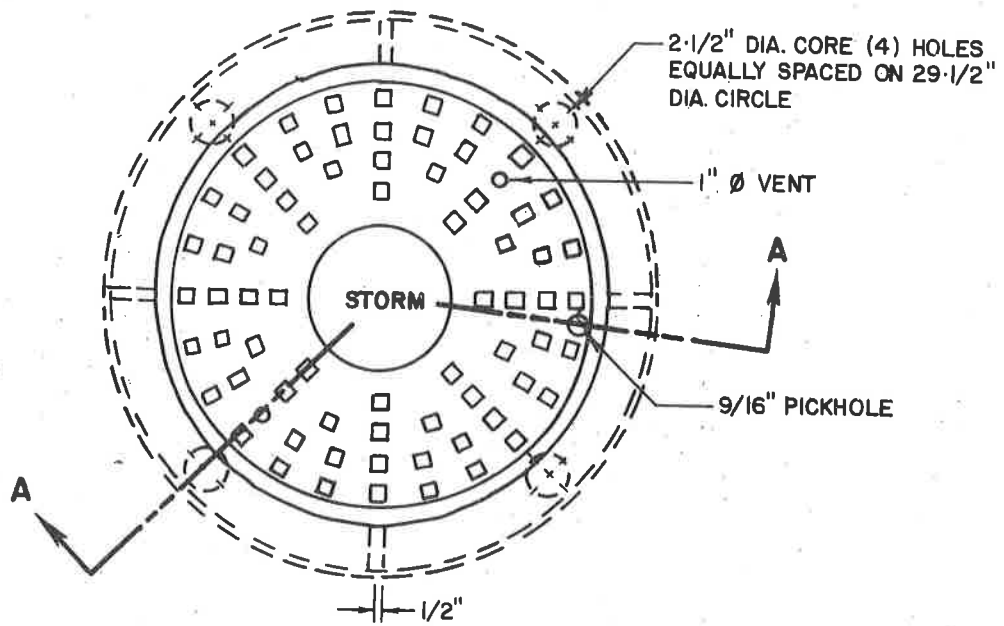

PLAN VIEW

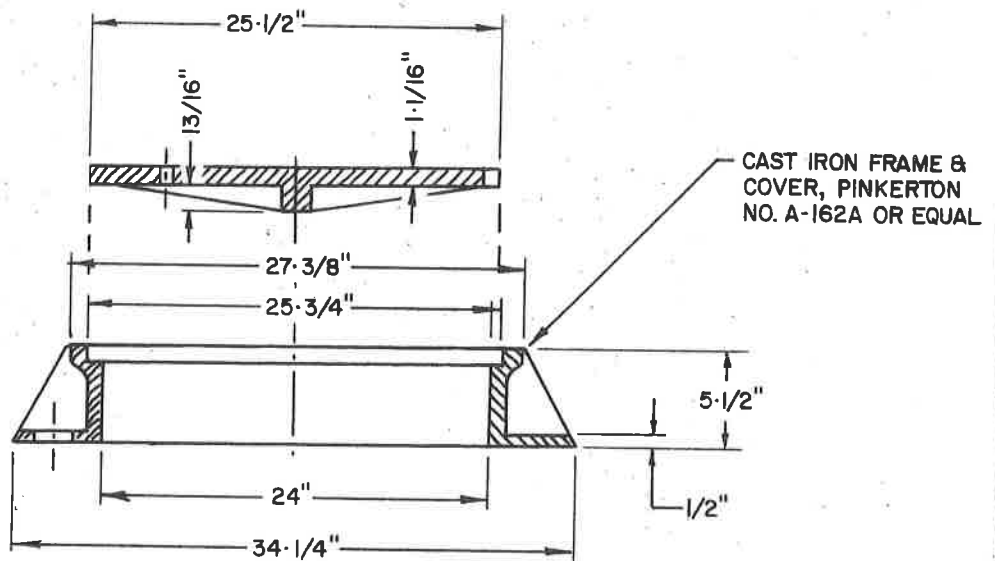


SECTION A-A

REFERENCE DRAWING
STANDARD MANHOLE..... S-1

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

MANHOLE FRAME AND COVER


MARK	DATE	REVISION	Engineering Standard
			Approved <i>[Signature]</i> SD-5
			Date 9/13/79

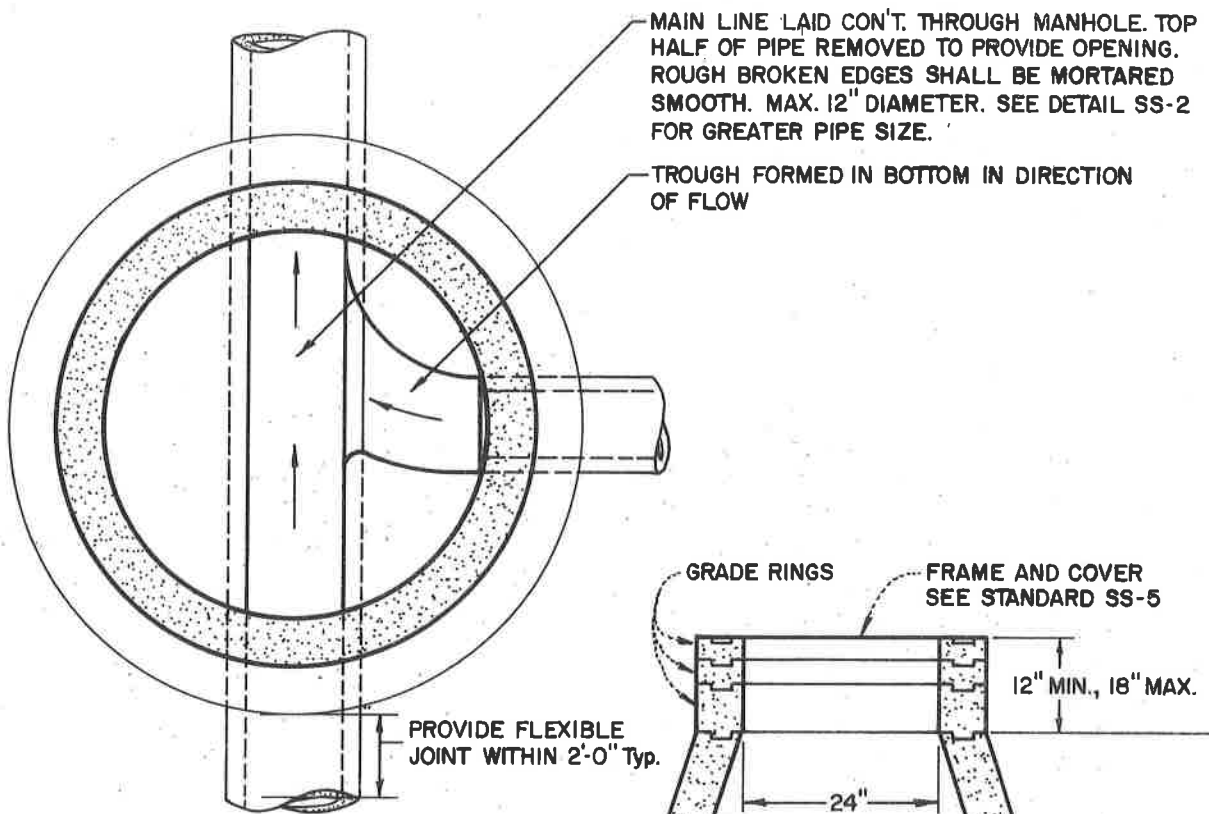

SECTION A-A

NOTES:

1. ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE REQUIREMENTS OF THE STANDARD SPECIFICATIONS.
2. PRECAST REINFORCED CONCRETE MANHOLE SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF A.S.T.M. DESIGNATION C-76.
3. ALL CONCRETE SHALL BE 2500psi. (5 SACK MIX)

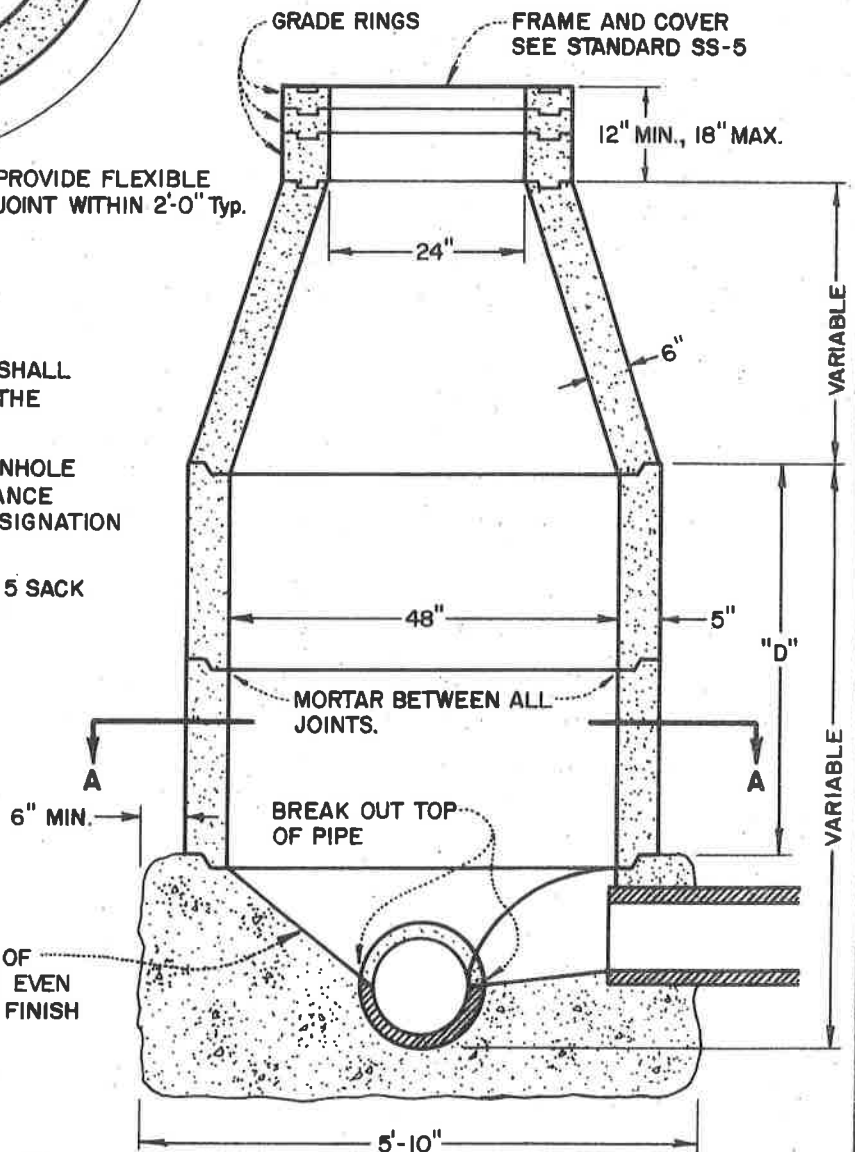

VERTICAL SECTION

SLOPE FROM CENTERLINE OF PIPE TO SIDE OF MANHOLE EVEN WITH TOP OF PIPE. TROWEL FINISH

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

48" MANHOLE

MARK	DATE	REVISION


Engineering Standard

Approved *[Signature]*

Date 9/13/79

SS-1

MAIN LINE LAID CONTINUOUS THROUGH MANHOLE. TOP HALF OF PIPE TO BE REMOVED TO PROVIDE OPENING. ROUGH BROKEN EDGES SHALL BE MORTARED. SMOOTH. MAX. 30" SHALL REQUIRE MANHOLE DESIGN BY ENGINEER.

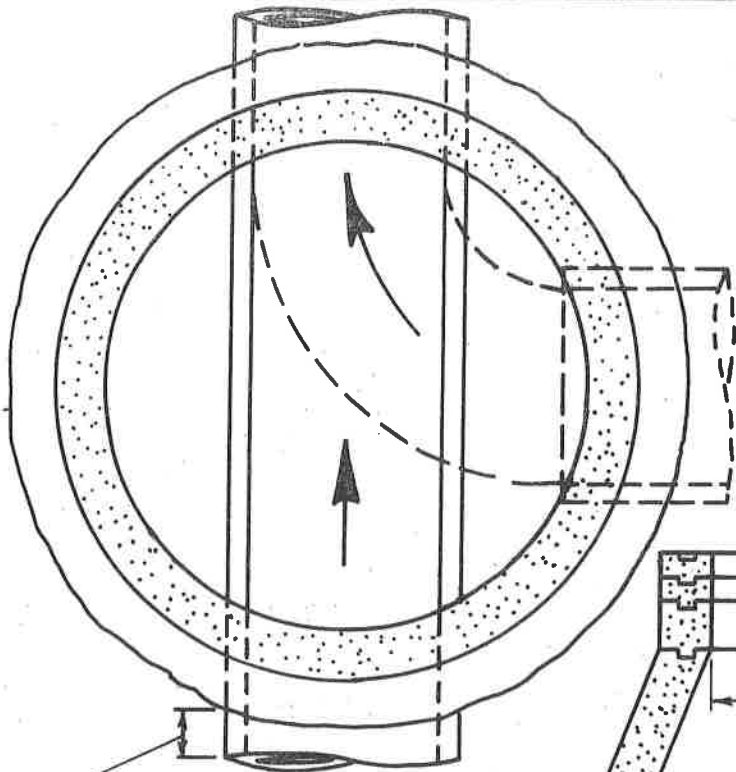


PROVIDE FLEXIBLE JOINT WITHIN 2'-0" (Typ.)

SECTION A-A

NOTES:

1. ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE REQUIREMENTS OF THE STANDARD SPECIFICATIONS.
2. PRECAST REINFORCED CONCRETE MANHOLE SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF A.S.T.M. DESIGNATION C-478.
3. QUARTER TURNS TO BE CONSTRUCTED TO FORM A SMOOTH FLOW LINE OF SAME SHAPE AND PATTERN AS BOTTOM WALL OF PIPE.
4. ALL CONCRETE SHALL BE 2500psi. (5 SACK MIX)

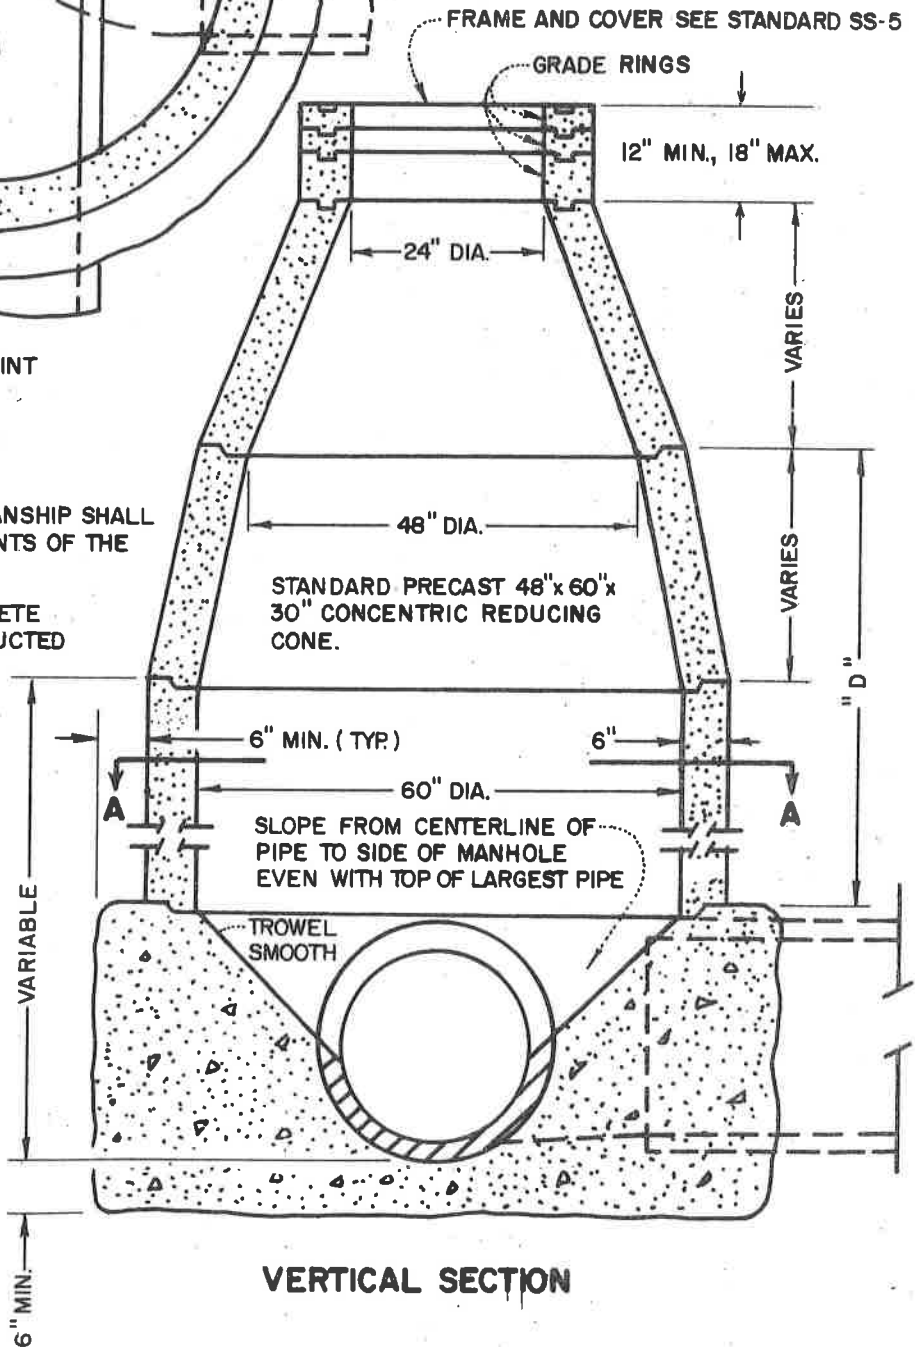

VERTICAL SECTION

60" MANHOLE

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS


MARK	DATE	REVISION

Engineering Standard

Approved: *[Signature]*

Date: 9/13/79

SS-2

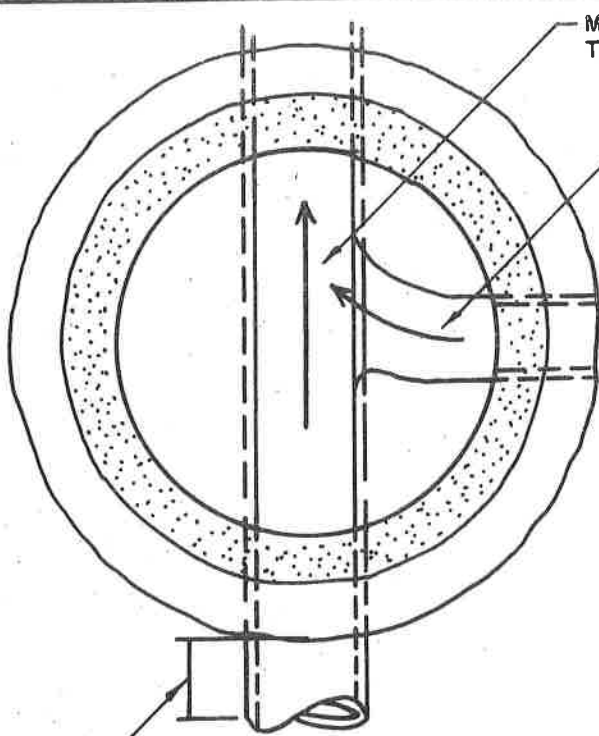

MAIN LINE LAID CONT. THROUGH MANHOLE

TROUGH FORMED IN BOTTOM IN DIRECTION OF FLOW.

FRAME & COVER SEE STANDARD SS-5.

GRADE RINGS

12" MIN., 18" MAX.

24"

6"


VARIABLE

PROVIDE FLEXIBLE JOINT WITHIN 2 FEET (TYP.)

SECTION A-A

NOTES :

1. ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE REQUIREMENTS OF THE STANDARD SPECIFICATIONS.
2. PRECAST REINFORCED CONCRETE MANHOLE SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF A.S.T.M. DESIGNATION C-478.
3. ALL CONCRETE SHALL BE 2500p.s.i. (5 SACK MIX.)

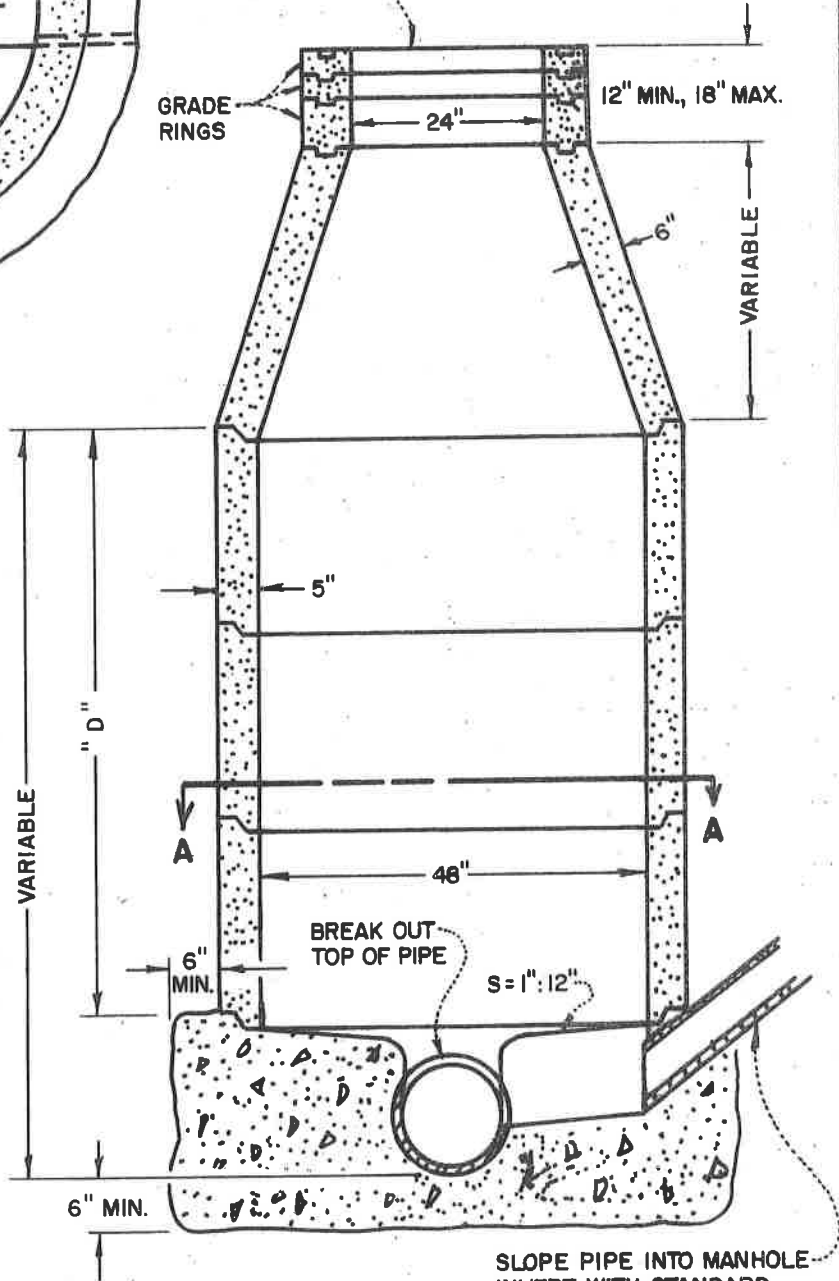

VARIABLE

" D "

5"

6" MIN.

BREAK OUT TOP OF PIPE

S = 1" : 12"

6" MIN.

SLOPE PIPE INTO MANHOLE INVERT WITH STANDARD SHORT JOINTS, MAXIMUM 3° DEFLECTION PER JOINT

VERTICAL SECTION

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

DROP MANHOLE


MARK	DATE	REVISION

Engineering Standard

Approved *[Signature]*

Date 9/11/79

SS-3

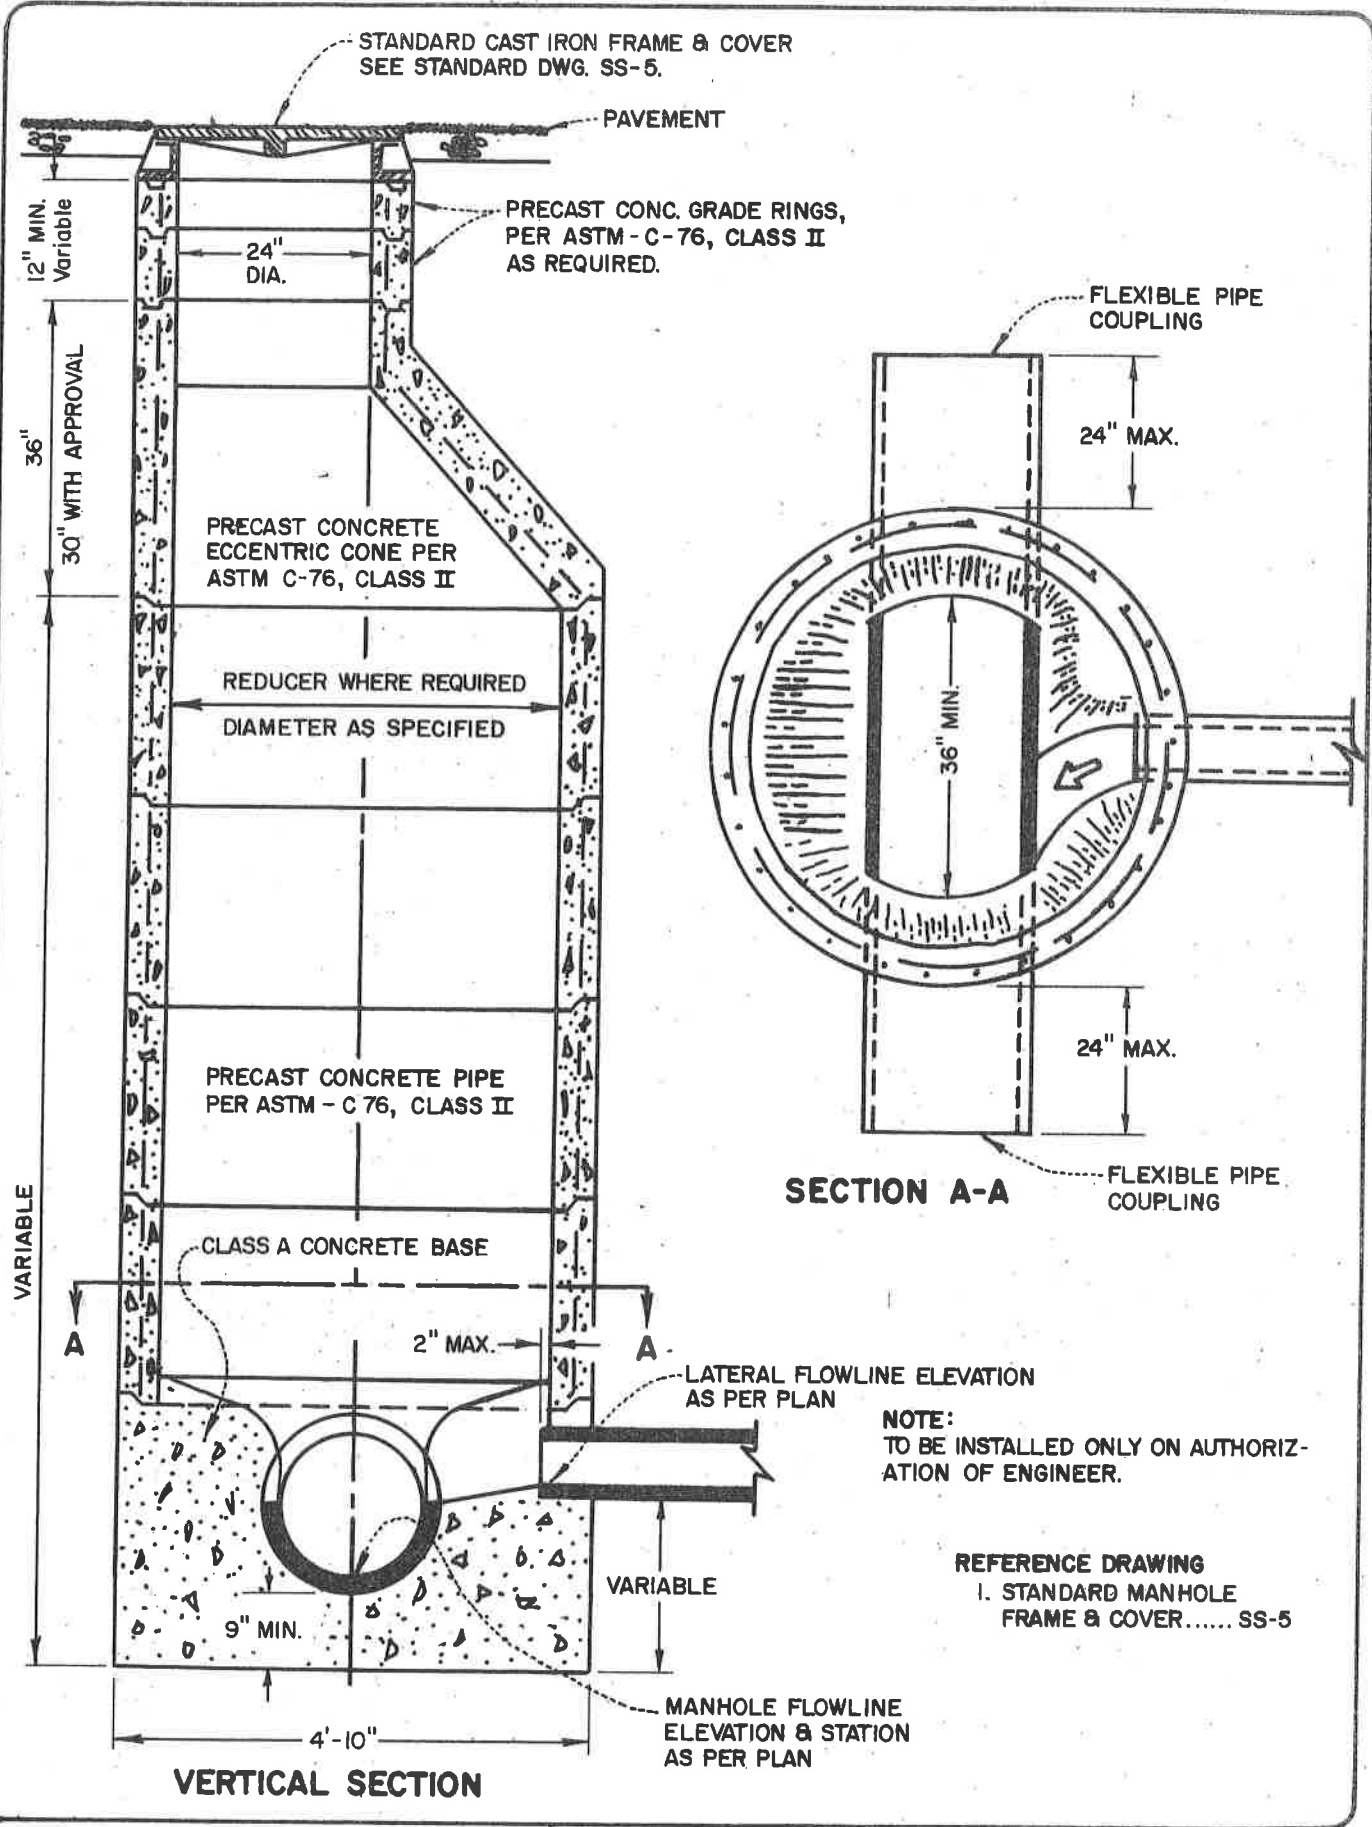



NOTE:
TO BE INSTALLED ONLY ON AUTHORIZATION OF ENGINEER.

REFERENCE DRAWING
I. STANDARD MANHOLE
FRAME & COVER..... SS-5

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

ECCENTRIC MANHOLE

MARK	DATE	REVISION	Engineering Standard	SS-4
			Approved <i>[Signature]</i>	
			Date 9/13/79	

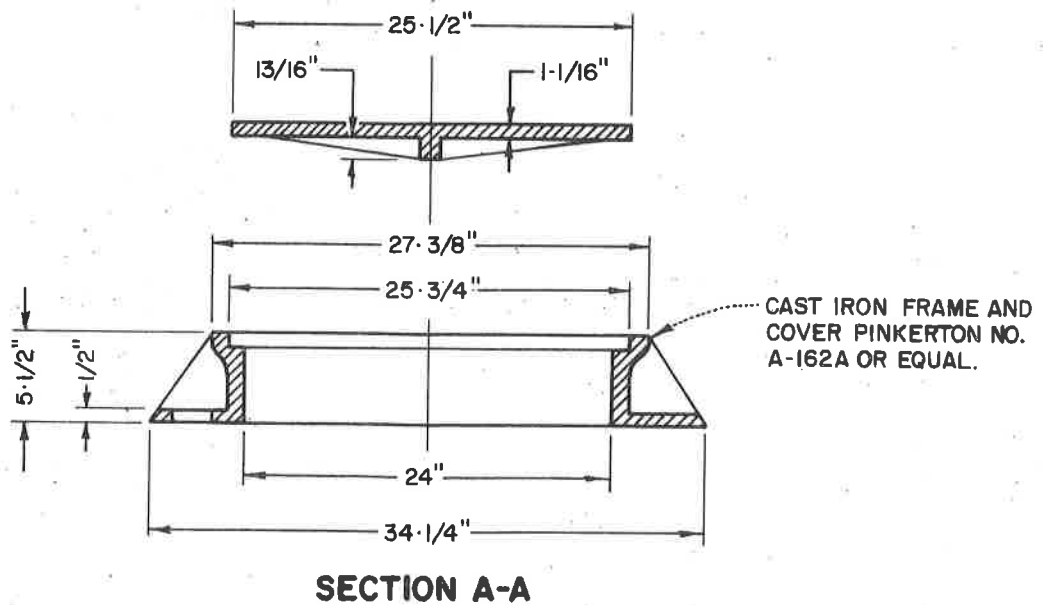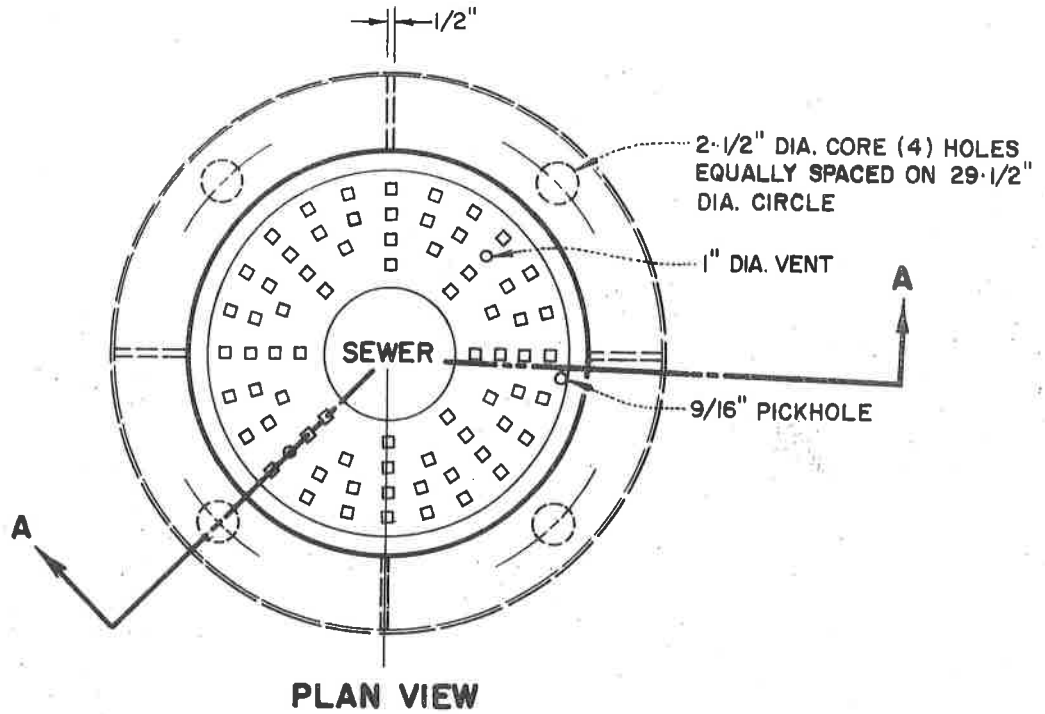

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

MANHOLE FRAME AND COVER

MARK	DATE	REVISION

Engineering Standard


Approved

Date

[Signature]


9/13/70

SS-5

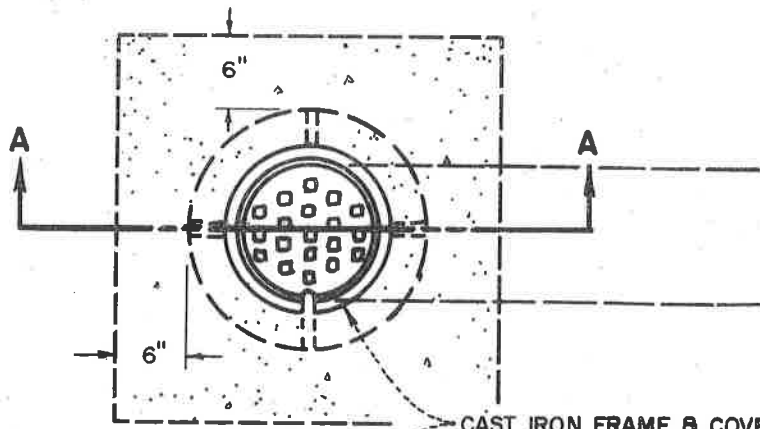

PLAN

CAST IRON FRAME & COVER, PINKERTON NO. A-512 OR EQUAL. FINISH ELEVATIONS AS PER PLAN

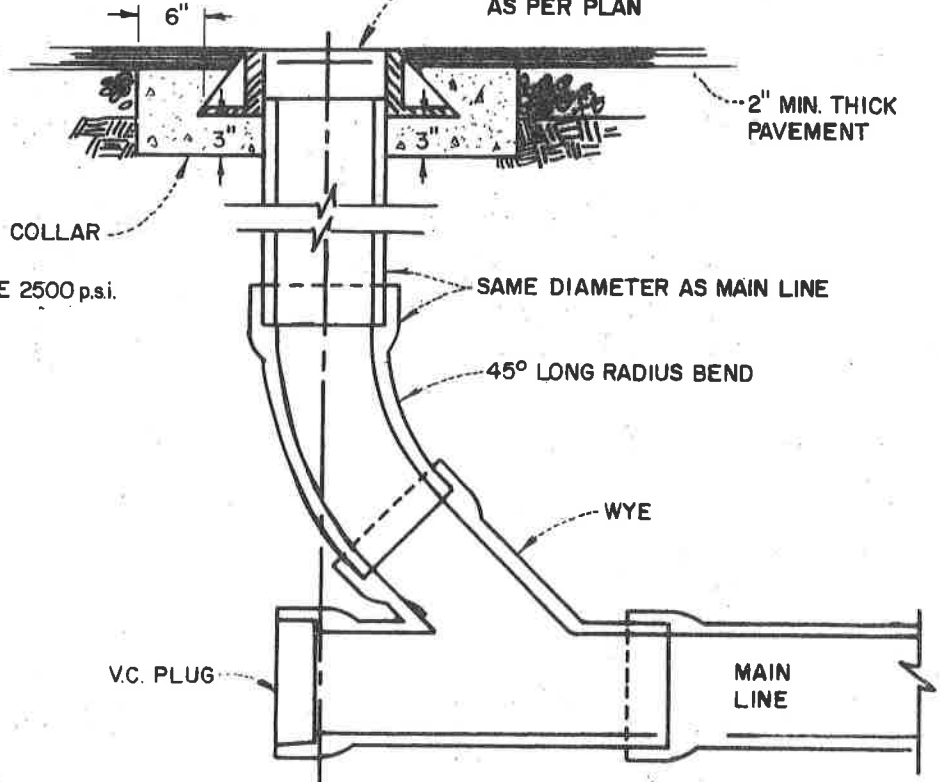

SQUARE CONCRETE COLLAR
 CONCRETE SHALL BE 2500 p.s.i.
 (5 SACK MIX)

2" MIN. THICK PAVEMENT

SAME DIAMETER AS MAIN LINE

45° LONG RADIUS BEND

WYE

VC. PLUG

MAIN LINE

CLEANOUT FLOWLINE ELEVATION & STATION SHOWN ON PLANS.

SECTION A-A


CITY OF *Lindsay*
 DEPARTMENT OF PUBLIC WORKS

TERMINAL CLEANOUT


MARK	DATE	REVISION

Engineering Standard
 Approved: *[Signature]*
 Date: 9/14/79

SS-6

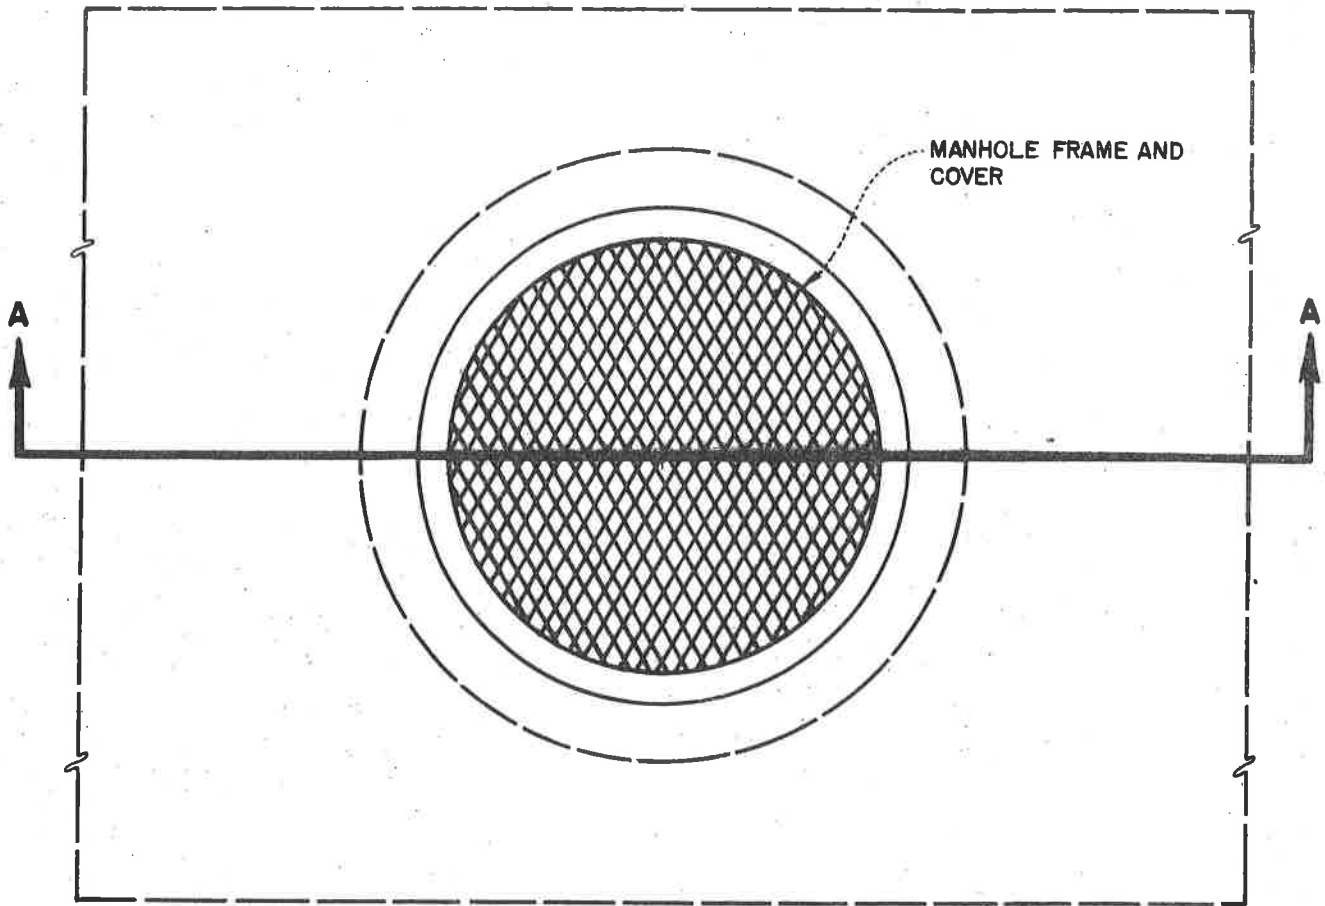

PLAN

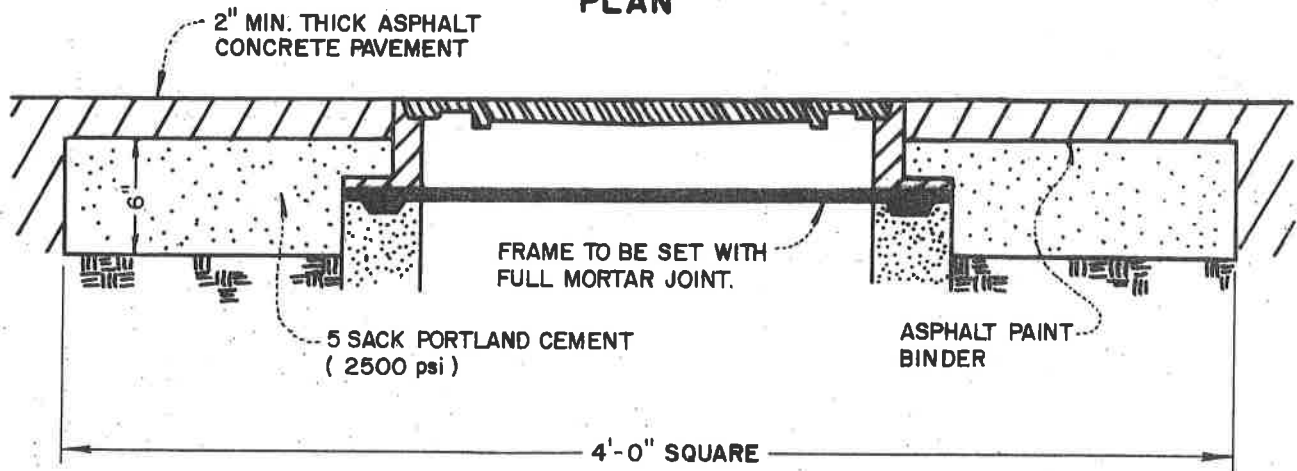

SECTION A-A

NOTE:

ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE REQUIREMENTS OF THE STANDARD SPECIFICATIONS.

MANHOLE FRAME AND COVER ADJUSTMENT DETAIL

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS


MARK	DATE	REVISION

Engineering Standard


Approved *[Signature]*

Date July 9, 1979

SS-7

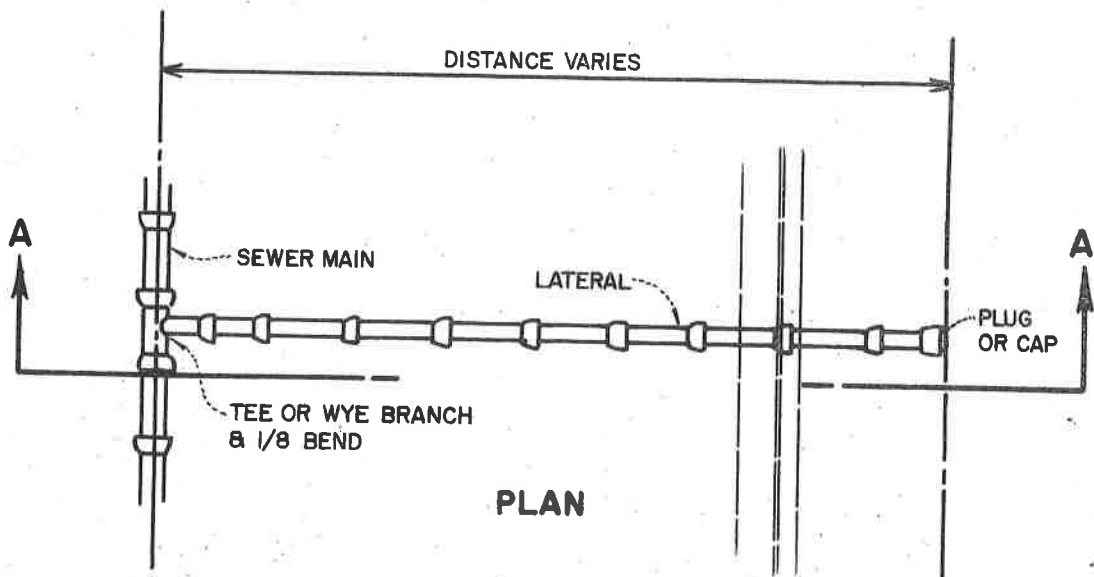

PLAN

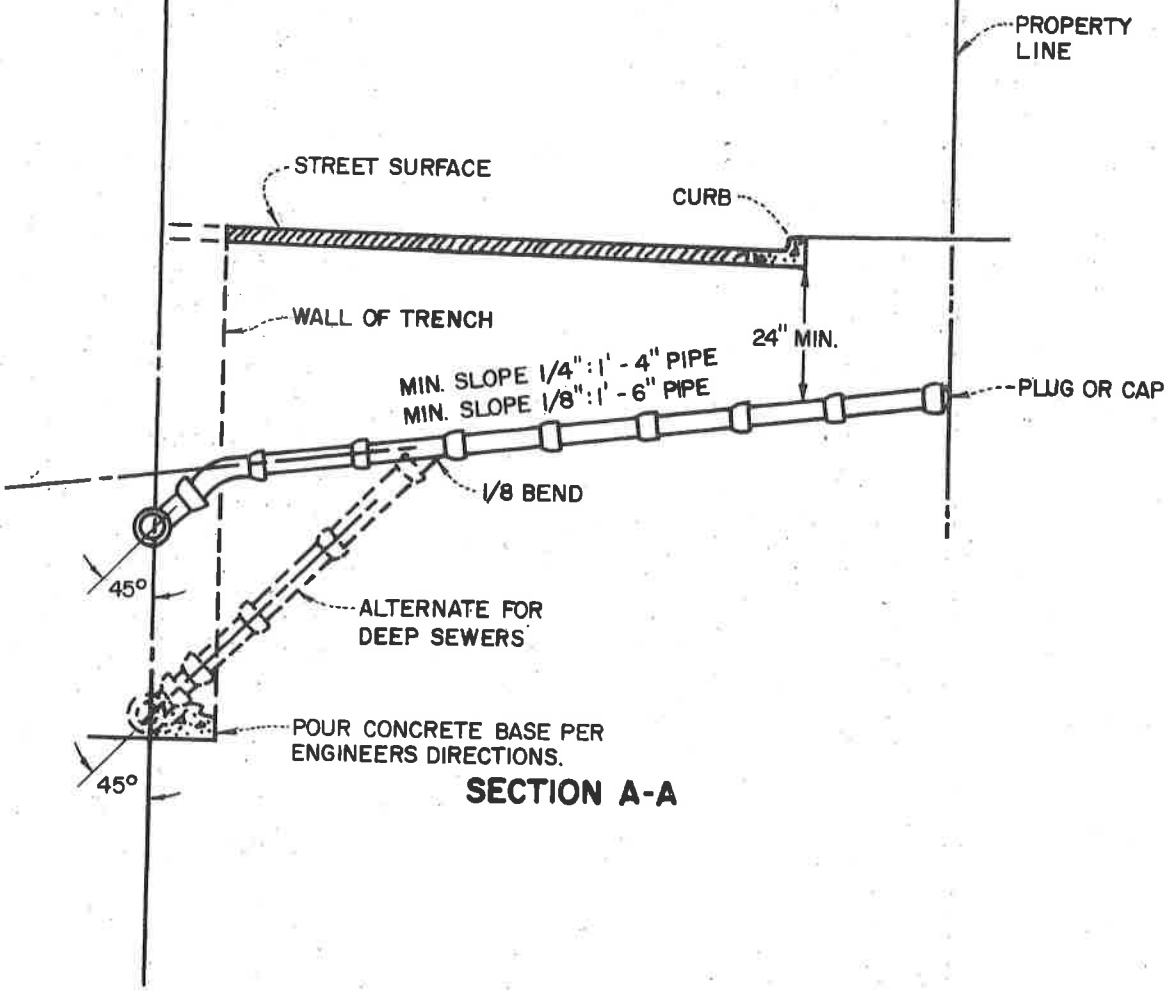

SECTION A-A


CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

LATERAL

MARK	DATE	REVISION

Engineering Standard
Approved *[Signature]*
Date 9/14/79


SS-8

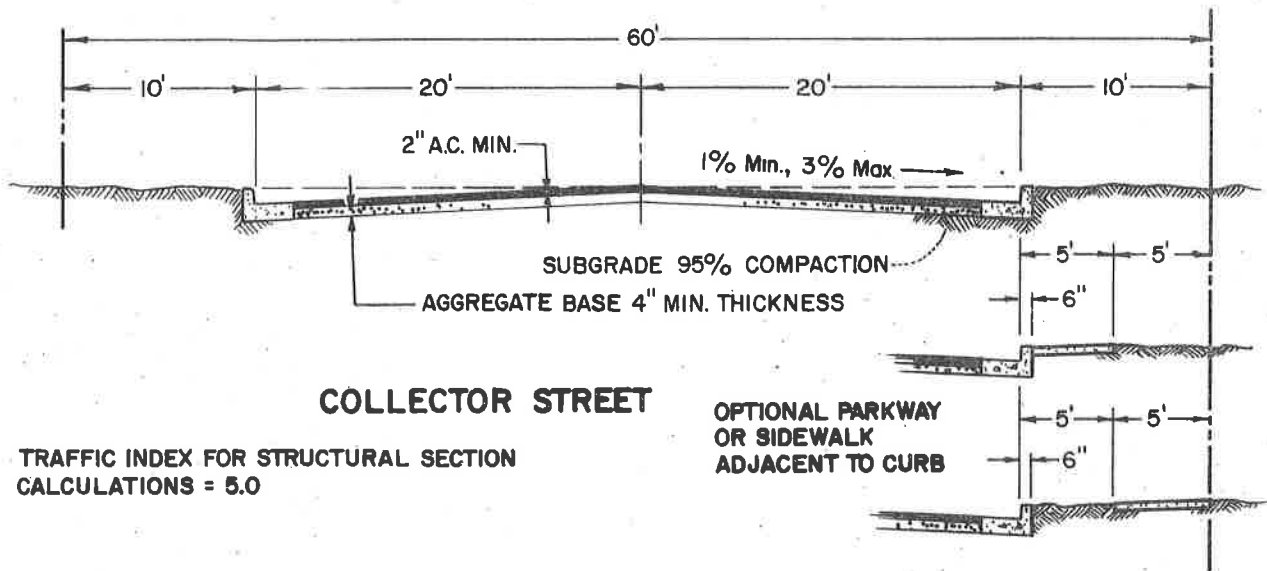

COLLECTOR STREET

TRAFFIC INDEX FOR STRUCTURAL SECTION
CALCULATIONS = 5.0

OPTIONAL PARKWAY
OR SIDEWALK
ADJACENT TO CURB

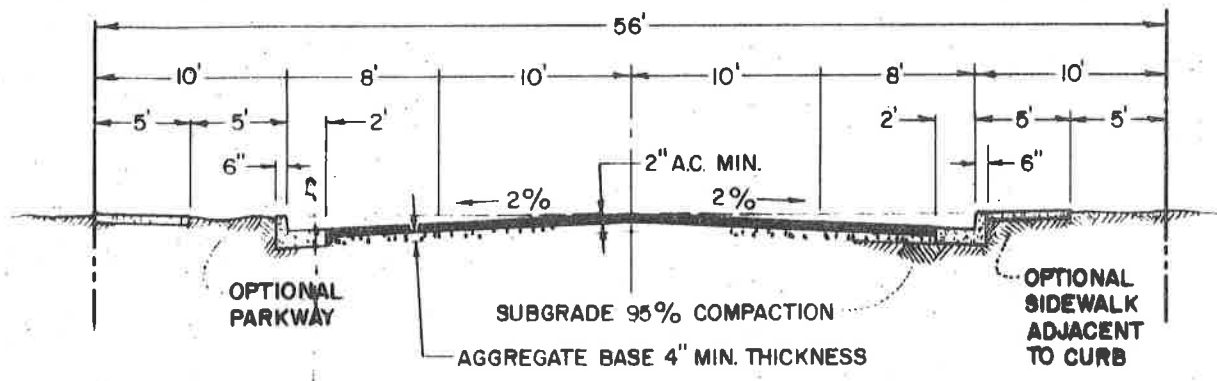



LOCAL & CUL-DE-SAC STREET

TRAFFIC INDEX FOR STRUCTURAL SECTION CALCULATIONS = 4.0

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

LOCAL & COLLECTOR STREETS

MARK	DATE	REVISION	Engineering Standard
			Approved <i>Janina J. Wind</i> ST-1A
			Date 9/13/79

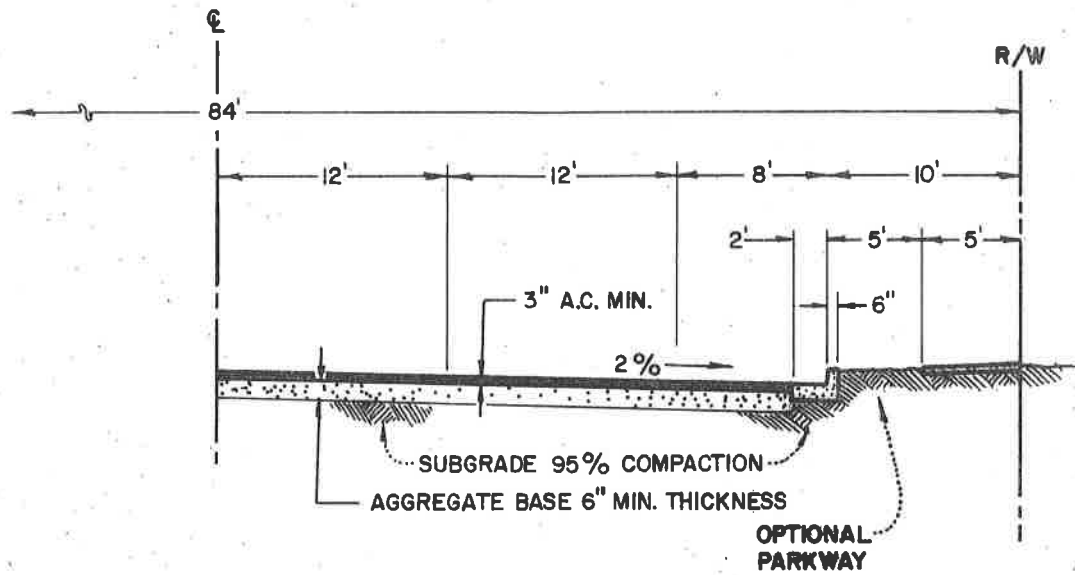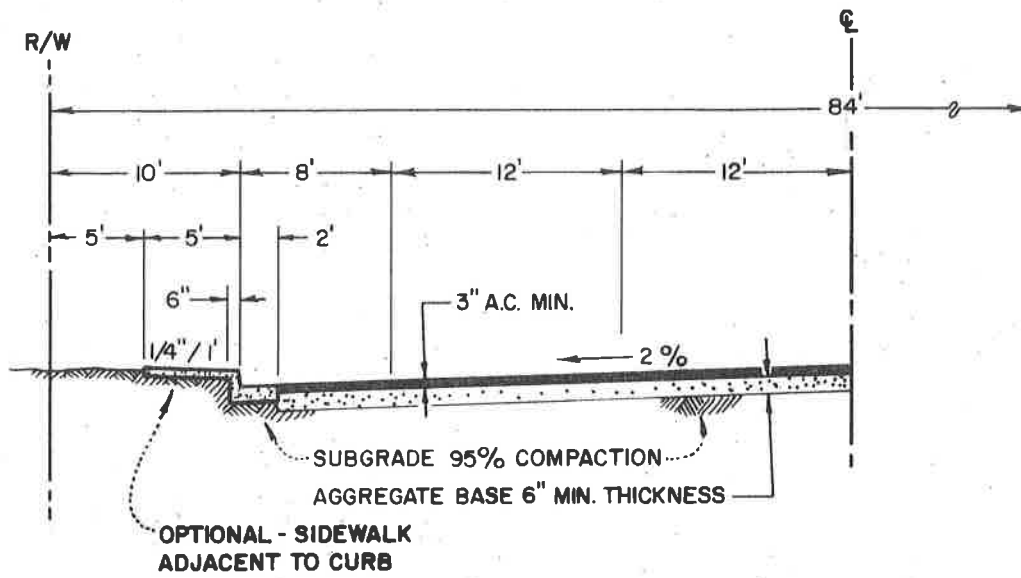



TRAFFIC INDEX FOR STRUCTURAL SECTION CALCULATIONS = 6.0

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

SECONDARY STREET

MARK	DATE	REVISION	Engineering Standard
			Approved <i>[Signature]</i>
			Date 9/14/79

ST-1B

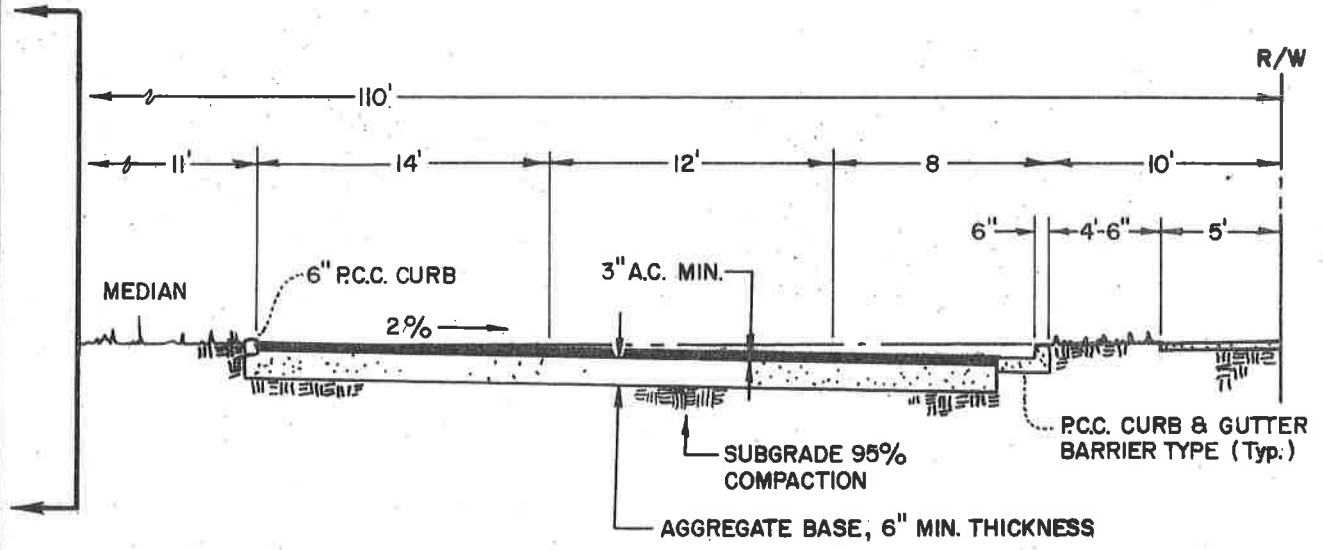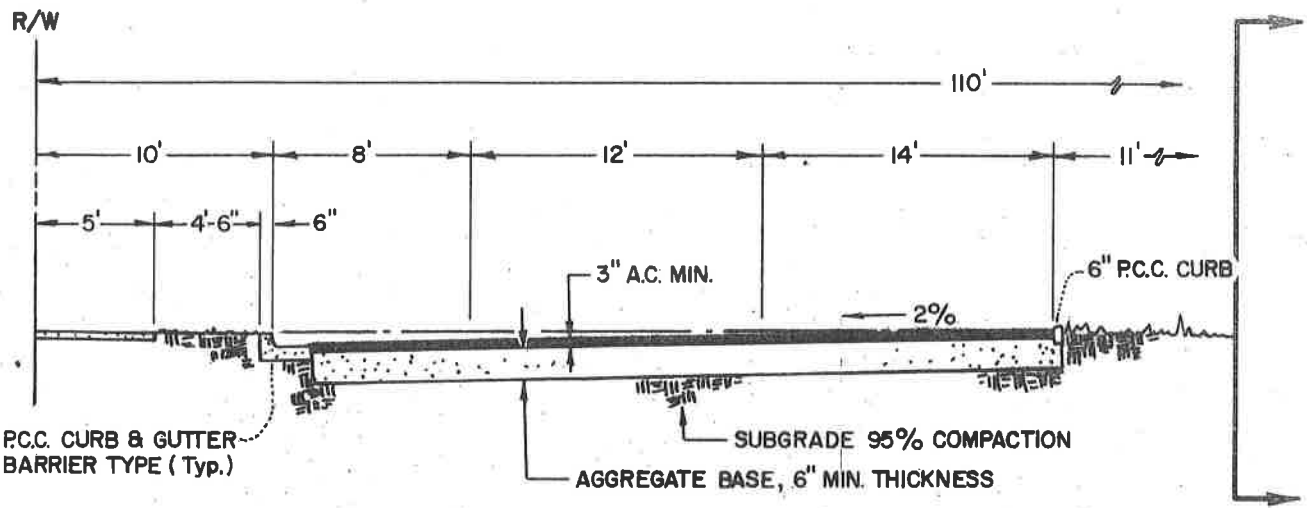


TRAFFIC INDEX FOR STRUCTURAL SECTION CALCULATIONS = 7.0

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

MAJOR ARTERIAL STREET

MARK	DATE	REVISION	Engineering Standard
			Approved <i>[Signature]</i>
			Date 9/13/79

ST-IC

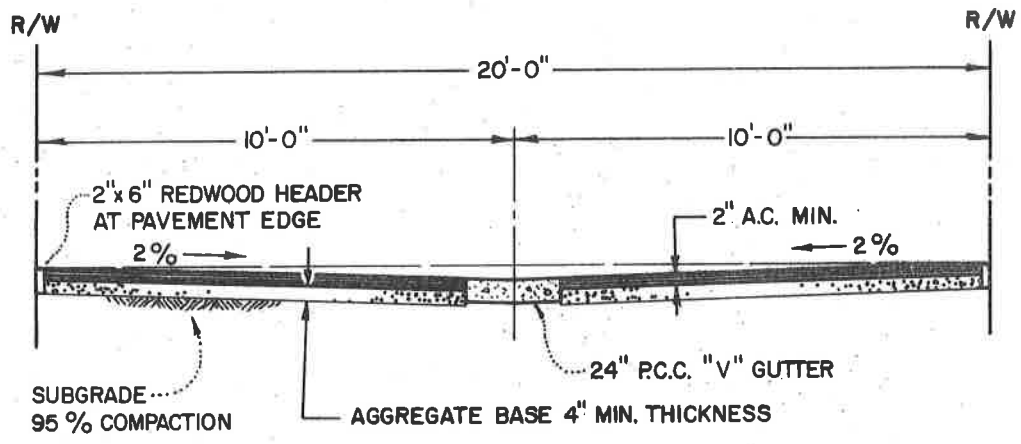

TRAFFIC INDEX FOR STRUCTURAL SECTION CALCULATIONS = 5.0


CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

ALLEY

MARK	DATE	REVISION

Engineering Standard
 Approved *[Signature]*
 Date 9/14/79

ST-ID

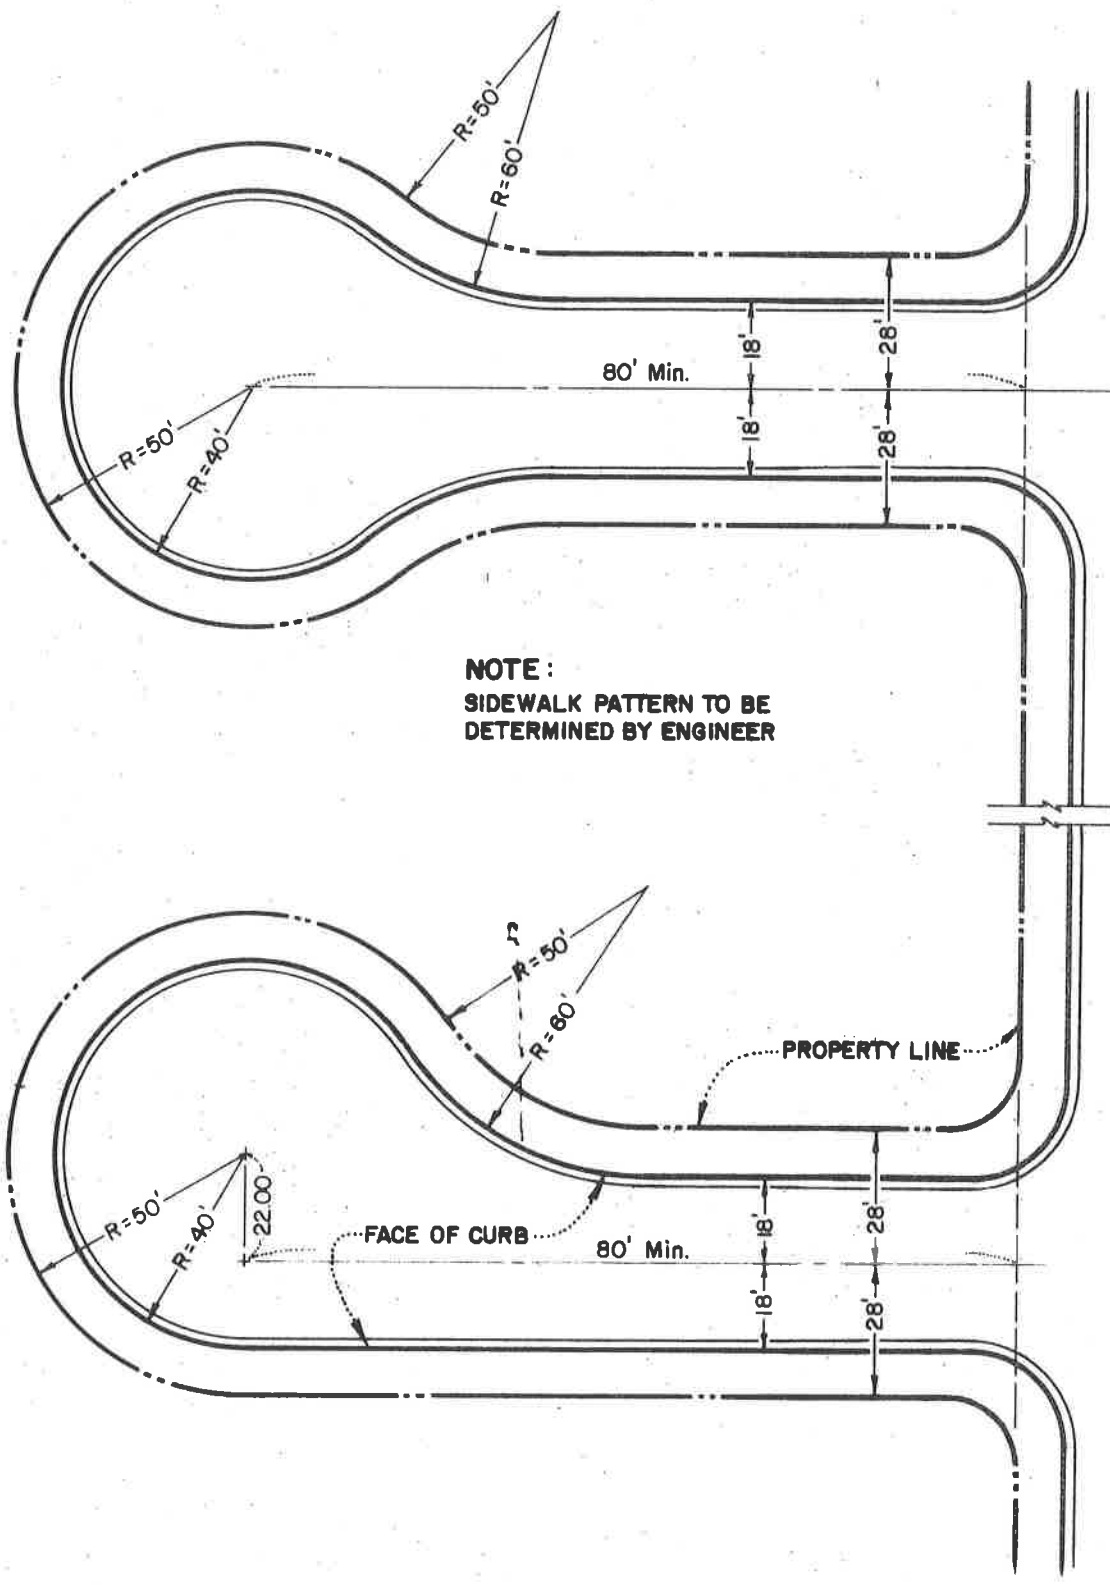

NOTE :
SIDEWALK PATTERN TO BE
DETERMINED BY ENGINEER


CITY OF *Lindsay*
 DEPARTMENT OF PUBLIC WORKS

CUL-DE-SAC

MARK	DATE	REVISION

Engineering Standard
 Approved: *[Signature]*
 Date: 9/13/79

ST-2

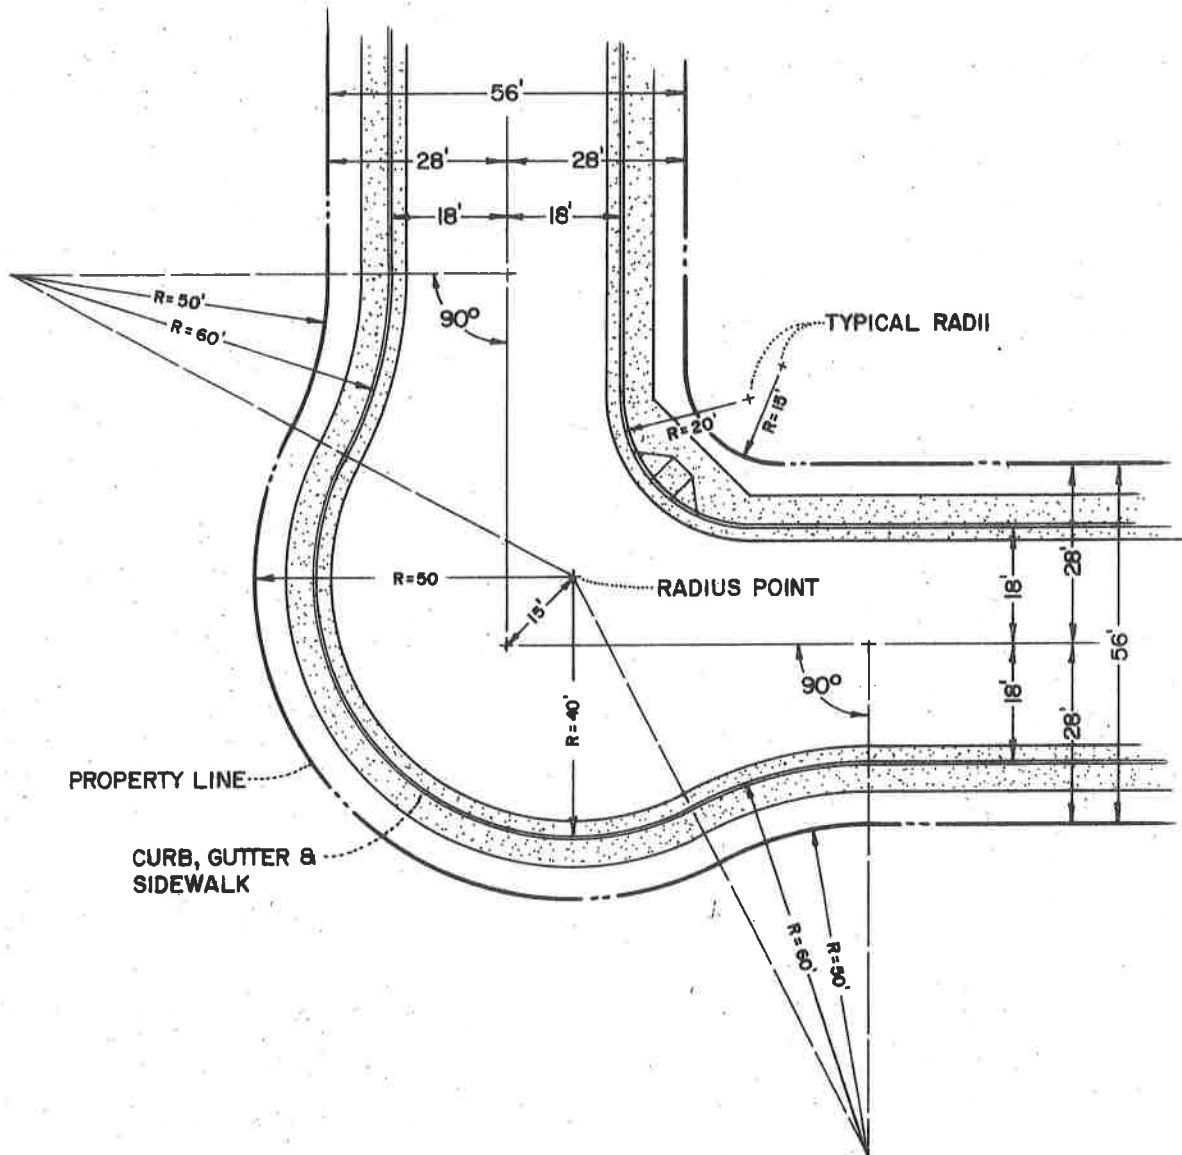

CITY OF *Lindsay*
 DEPARTMENT OF PUBLIC WORKS

STREET BULB CONNECTION


MARK	DATE	REVISION

Engineering Standard

Approved: *[Signature]*

Date: 9/13/79


ST-3

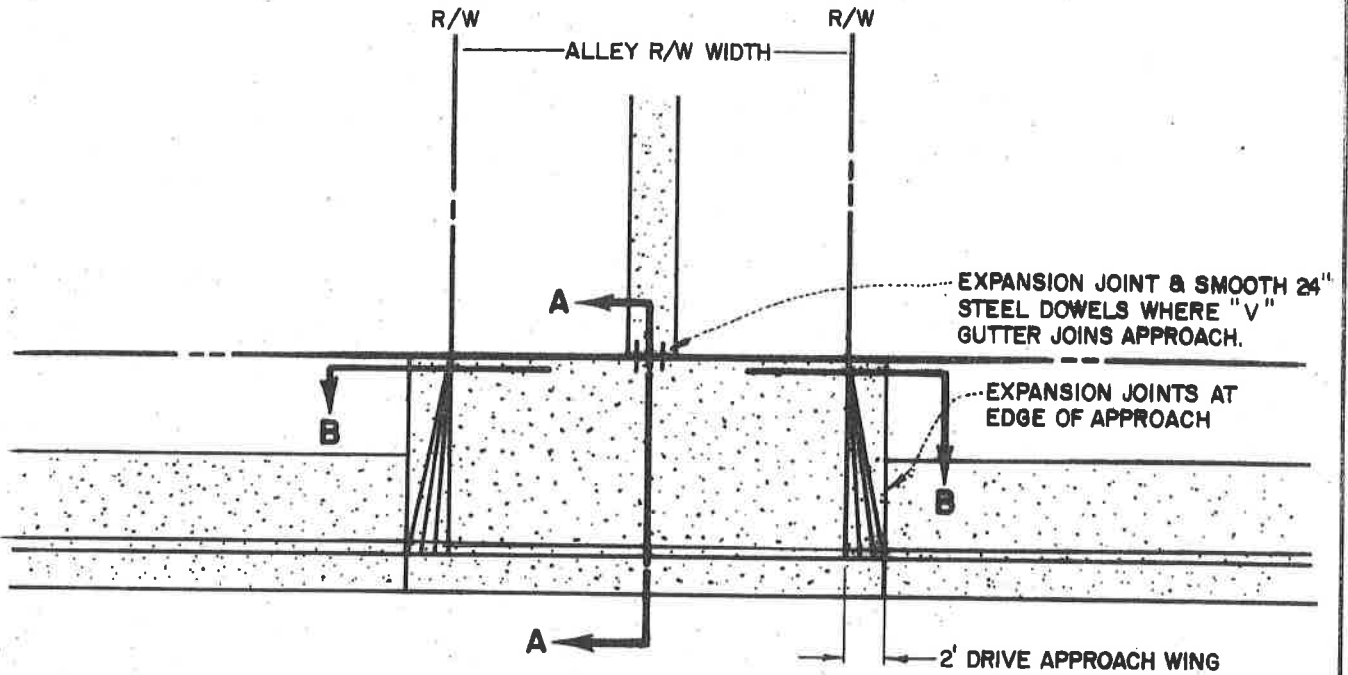


PLAN

NOTES :

1. CONCRETE SHALL BE 2500 p.s.i. (5 SACK MIX)
2. APPROACH SHALL HAVE HEAVY BROOM FINISH.
3. CURING COMPOUND SHALL BE APPLIED AS APPROVED BY THE CITY ENGINEER.

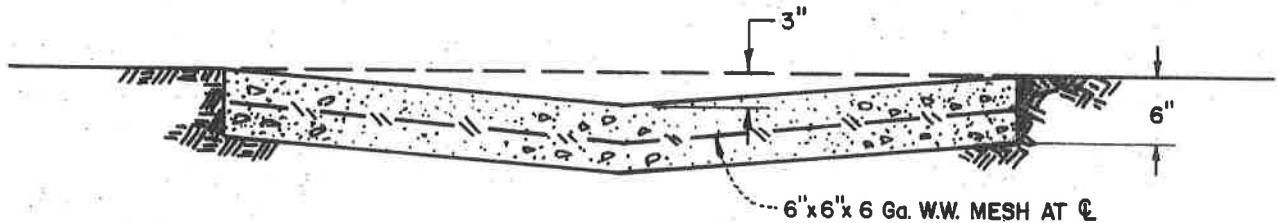

SECTION B-B

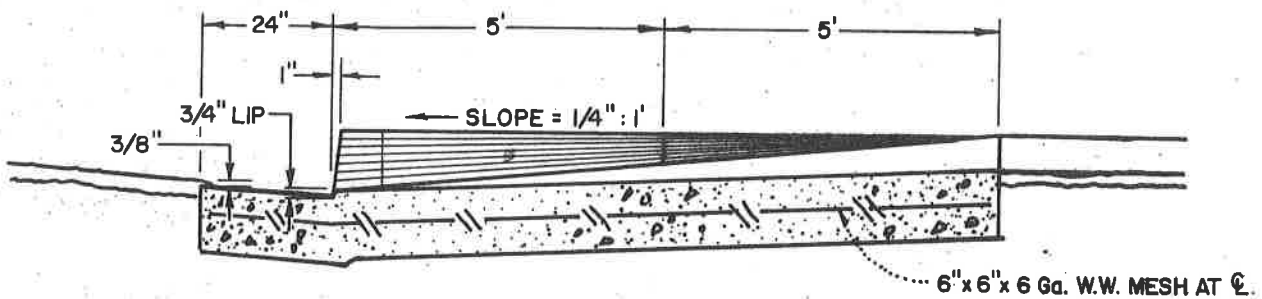

SECTION A-A

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

ALLEY APPROACH

MARK	DATE	REVISION

Engineering Standard


Approved

Date


9/13/79

ST-4


PROVIDE WEAKENED PLANE JOINTS, AT 10' O.C.

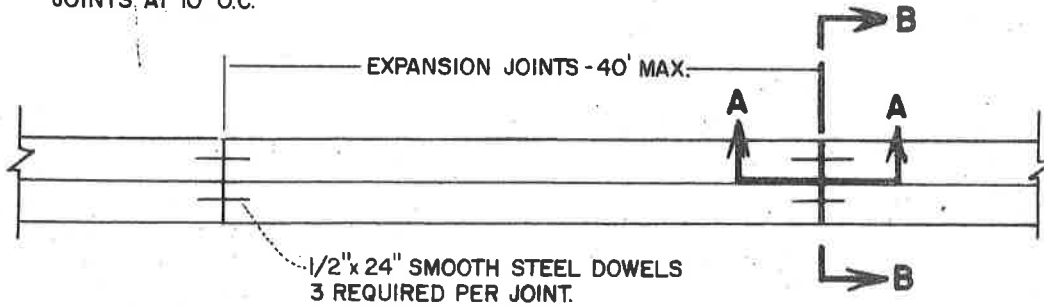

PLAN

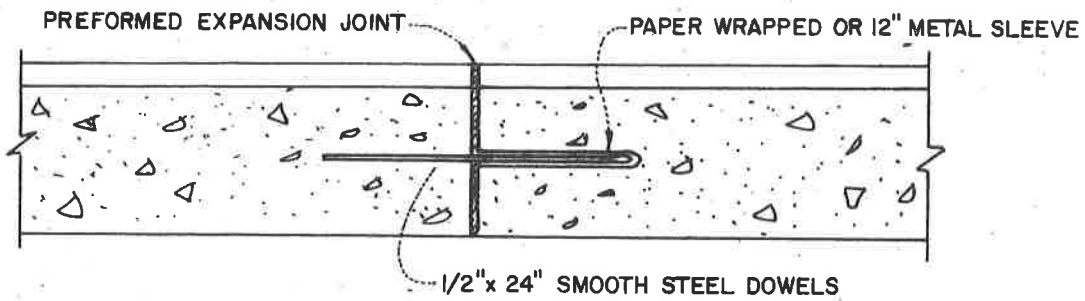

SECTION A-A

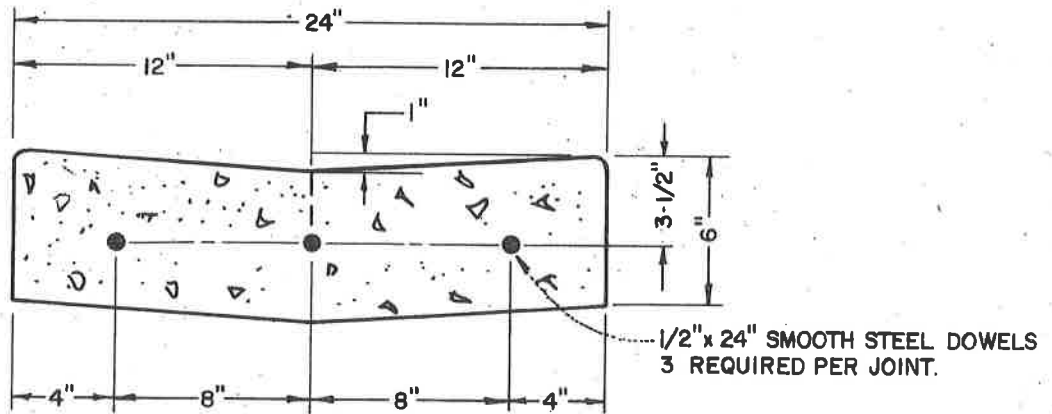

SECTION B-B

NOTES:


1. CONCRETE SHALL BE 2500 ps.i. (5 SACK MIX)
2. GUTTER SHALL HAVE LIGHT BROOM FINISH.
3. FINISHED SURFACES SHALL BE TREATED WITH A CURING COMPOUND APPROVED BY THE CITY ENGINEER.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

ALLEY "V" GUTTER

MARK	DATE	REVISION	Engineering Standard
			Approved <i>[Signature]</i>
			Date 9/14/79

ST-5

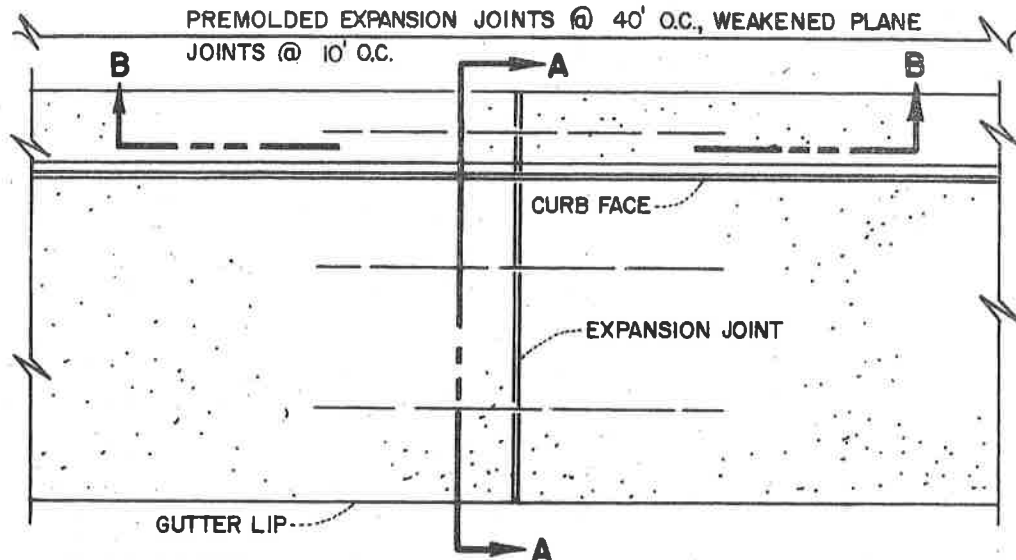

NOTES:


PLAN VIEW

CONCRETE SHALL BE 2500 p.s.i. (5 Sack Mix)

TOP AND FACE OF CURB SHALL HAVE A LIGHT BRUSH FINISH, GUTTER SHALL HAVE A LIGHT BROOM FINISH.

FINISHED SURFACES SHALL BE TREATED WITH A CURING COMPOUND APPROVED BY CITY ENGINEER.

SECTION A-A

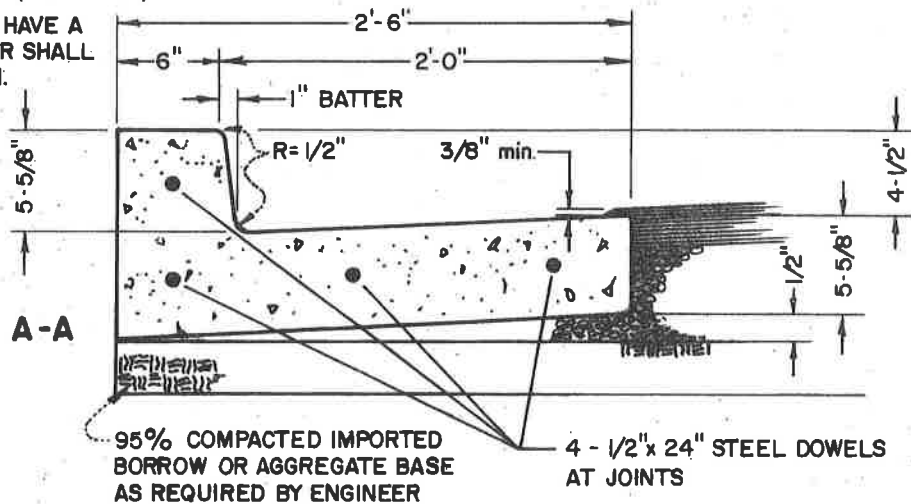


NOTE:

CONTRACTOR SHALL FILL AREA BETWEEN NEW GUTTER AND EXISTING STREET SURFACE WITH SAME TYPE OF MATERIAL AS EXISTING STREET TO A MINIMUM SECTION OR 2" ASPHALT CONCRETE TYPE B OVER 4" CLASS II BASE OR AS DIRECTED BY ENGINEER. APPLY PRIME COAT TO NEW GUTTER AND EXISTING STREET AS DIRECTED BY ENGINEER.

NOTE:

CURB & GUTTER SHALL HAVE A GRADIENT OF 0.20% MINIMUM.

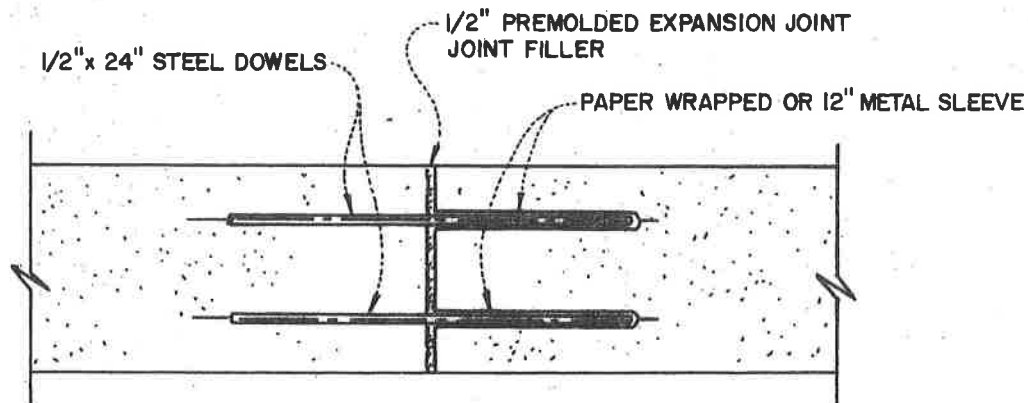

SECTION B-B

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

BARRIER TYPE CURB AND GUTTER

MARK	DATE	REVISION

Engineering Standard

Approved: *[Signature]*

Date: 9/13/79

ST-6



City of Lindsay



DEPARTMENT OF CITY SERVICES

P.O. Box 369 — Lindsay, California 93247 — 150 N. Mirage Ave.
559 • 562 • 5945
559 • 562 • 5748 fax


City of Lindsay Development Standard Addendum May 2006

Development Standard No. ST-6, Barrier Type Curb and Gutter.

The following items shall be considered City of Lindsay acceptable construction practice and allowed for the construction of curb and gutter.


This applies to machine pour curb and gutter only. Allowances can be made for form and stake curb and gutter, but will be reviewed on a project by project basis.

- Steel dowels are required at cold joints only. ½" diameter x 24" long embedded 12" into each section of curb and gutter. A total of 4 dowels (2 in curbing, 2 in gutter pan) are required. Expansion felt shall be required at cold joints also.
- Weakened plane joints (deep joints) shall be required at 20' o.c.; the definition of weakened plane joints shall be 1" minimum depth and shall be finished with a scoring tool leaving the edges rounded.
- "Beauty Mark" joints (surface joints) shall be required at 10' o.c.
- Expansion felt may be omitted from each driveway location as directed by the City representative.
- "0" (zero) lip is required at all handicap curb depressions.
- ½" lip, maximum, is required at all driveway depressions.

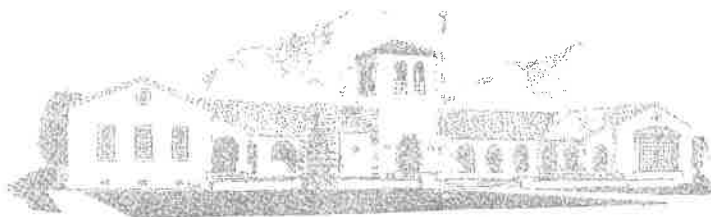

ROLL TYPE GURB AND GUTTER

FOR USE ONLY IN AREAS OF A PREDOMINANCE OF ROLL TYPE CURB & GUTTER AND ONLY AT THE DIRECTION OF THE CITY OF LINDSAY.

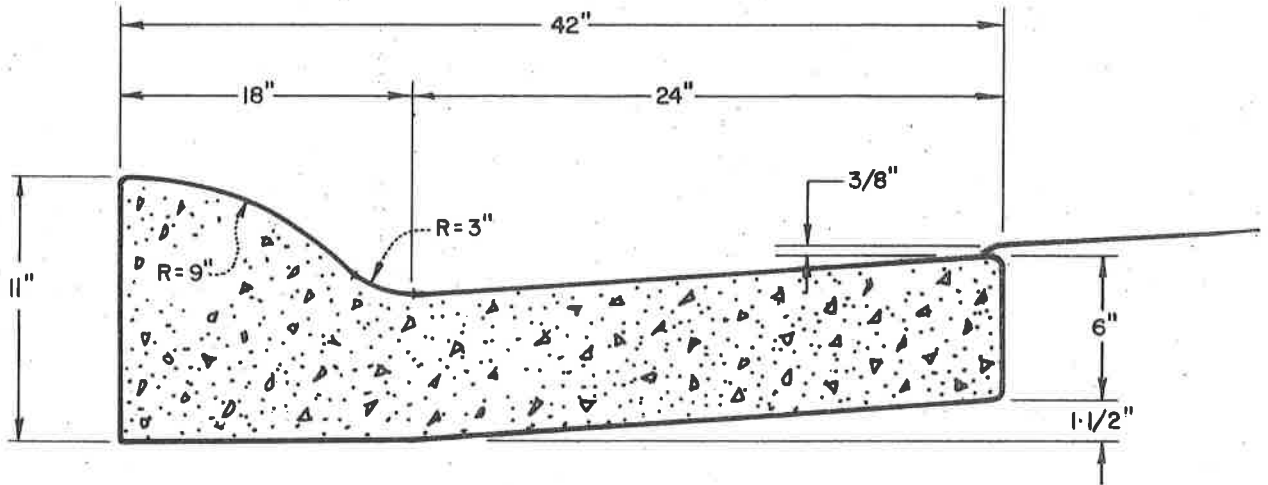

SECTIONAL VIEW

NOTES:

1. CONCRETE WORK SHALL BE 2500psi. DESIGN (5 SACK MIX)
2. ALL CONCRETE SHALL HAVE A LIGHT BROOM FINISH.
3. 1/2" EXPANSION JOINT AT END OF CURVE AND BEGINNING OF CURVE OF WALK RETURNS, DRIVEWAY APPROACHES AND AT INTERVALS OF 40' O.C. (MAX.)
4. WEAKENED PLANE JOINTS SHALL BE CONSTRUCTED AT 10' CENTERS AND SHALL BE A MINIMUM DEPTH OF 3/8" AND SHALL BE FINISHED WITH A SCORING TOOL LEAVING THE EDGES ROUNDED.
5. PLACE 4" OF SAND OR DECOMPOSED GRANITE GRANITE BEDDING WHERE REQUIRED BY THE CITY OF PORTERVILLE.
6. FINISHED SURFACES SHALL BE TREATED WITH CURING COMPOUND APPROVED BY CITY ENGINEER.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

ROLLED TYPE CURB AND GUTTER




MARK	DATE	REVISION

Engineering Standard

Approved *[Signature]*

Date 9/14/79

ST-7

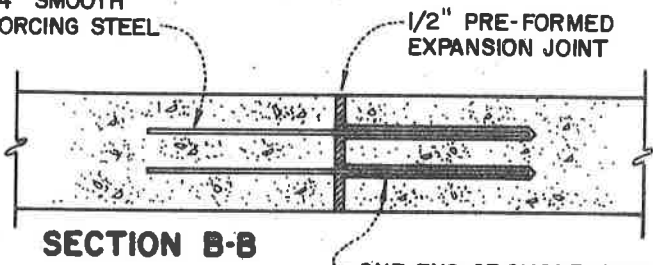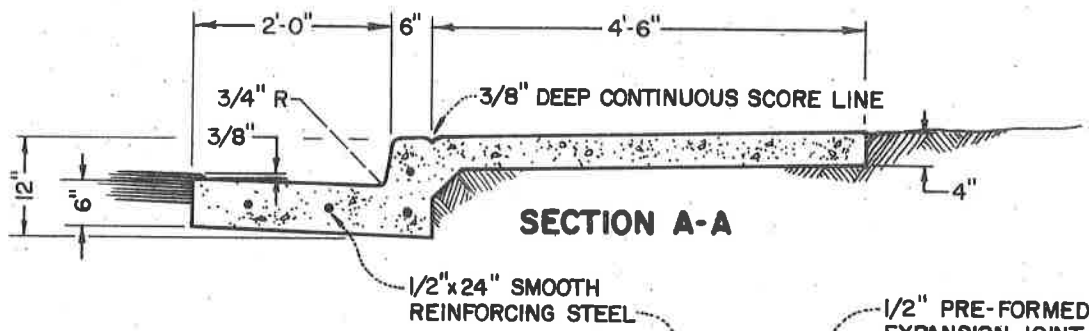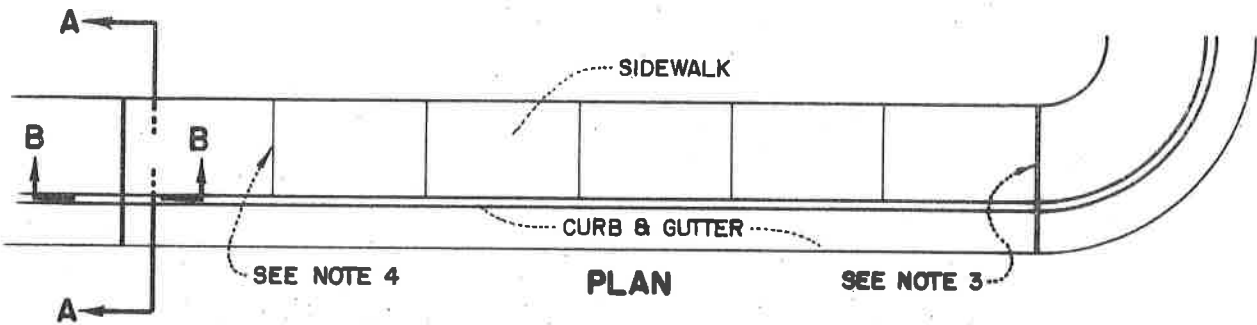

NOTES:

1. CONCRETE WORK SHALL BE 2500psi. (5 SACK MIX)
2. 1/2" EXPANSION JOINT AT END OF CURVE AND BEGINNING OF CURVE OF WALK RETURNS, AND AT DRIVEWAY APPROACHES, AND AT 40' O.C. MAXIMUM.
3. WEAKENED PLANE JOINTS SHALL BE CONSTRUCTED AT 10' CENTERS AND SHALL BE A MINIMUM DEPTH OF 3/8" AND SHALL BE FINISHED WITH A SCORING TOOL LEAVING THE EDGES ROUNDED.
4. FINISHED SURFACES SHALL BE TREATED WITH CURING COMPOUND APPROVED BY THE CITY ENGINEER.
5. TOP AND FACE OF CURB SHALL HAVE A LIGHT BRUSH FINISH, GUTTER SHALL HAVE A LIGHT BROOM FINISH, SIDEWALK SHALL HAVE A MEDIUM SWEAT FINISH.

NOTE:

MONOLITHIC CURB, GUTTER AND SIDEWALK MAY BE REQUIRED IN AREAS OF EXPANSIVE SOILS.

ONE END OF SMOOTH REINFORCING STEEL TO BE WRAPPED WITH BUILDING PAPER, GREASED, 10" P.V.C. OR METAL SLEEVE TO PERMIT MOVEMENT.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

MONOLITHIC CURB, GUTTER & SIDEWALK


MARK	DATE	REVISION

Engineering Standard
Approved: *[Signature]*
Date: 9/14/79

ST-8

NOTES:

1. CONCRETE SHALL BE 2500 psi. (5 SACK MIX)
2. SIDEWALK SHALL HAVE MEDIUM SWEAT FINISH.
3. CURING COMPOUND SHALL BE APPLIED AS APPROVED BY THE CITY ENGINEER.

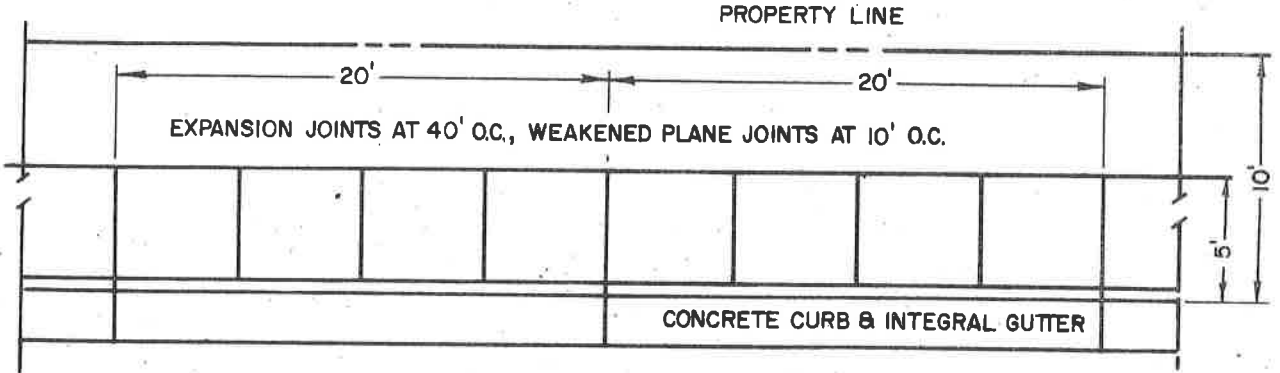


SIDEWALK AT CURB LINE


THE WALK BETWEEN EXPANSION JOINTS SHALL BE DEVIDED INTO 5' BLOCKS BY SCORING TRANSVERSELY. THE SCORING SHALL EXTEND 3/8" BELOW THE SURFACE OF THE CONCRETE SLAB AND SHALL MATCH CURB & GUTTER SCORING. COMMERCIAL SIDEWALK PATTERN SHALL EXTEND FULL WIDTH FROM PROPERTY LINE TO BACK OF CURB.

NOTE:

UTILITIES TO BE LOCATED BEHIND CURB.

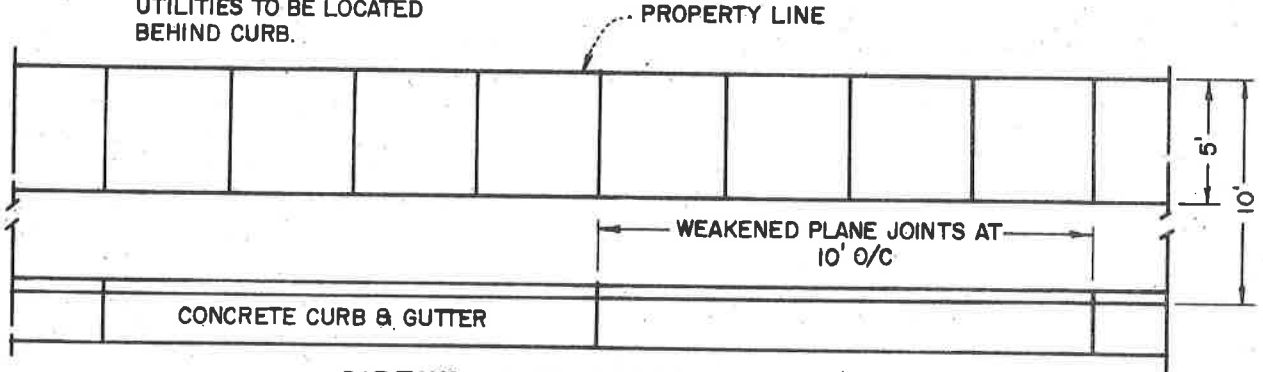

SIDEWALK AT PROPERTY LINE

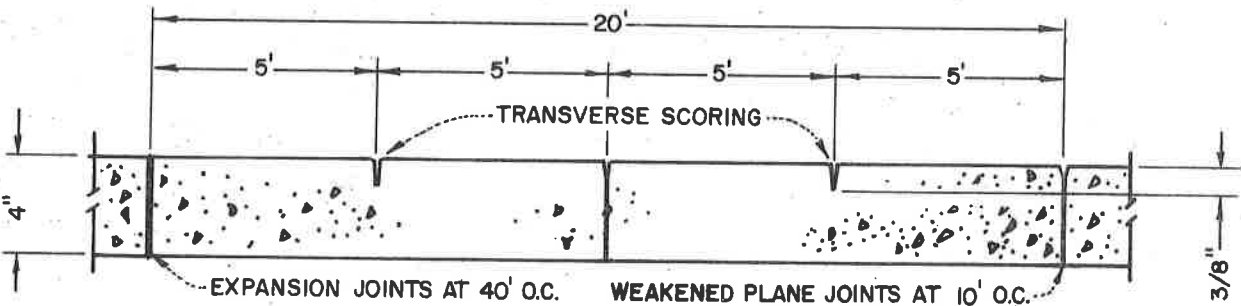

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

SIDEWALK

MARK	DATE	REVISION

Engineering Standard

Approved: *[Signature]*

Date: 9/13/79

ST-9


RAMP TO BE FINISHED WITH HEAVY BROOM TRAVERSE TO AXIS OF RAMP
1/2" CURB HEIGHT.

TRANSITION FROM FULL CURB HEIGHT TO 1/2" CURB HEIGHT.

CONCRETE GUTTER

4.5' COMBINATION CURB & SIDEWALK

EXPANSION JOINT (Typical)

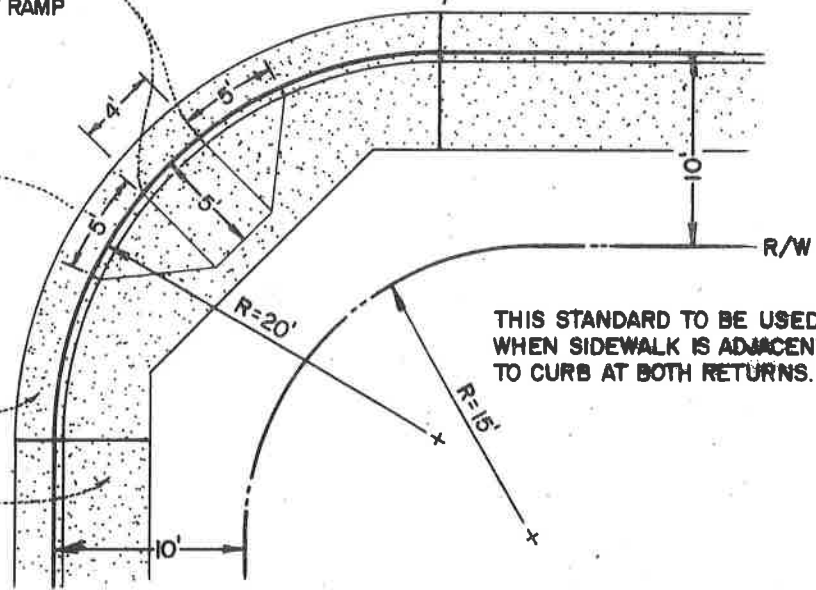

THIS STANDARD TO BE USED WHEN SIDEWALK IS ADJACENT TO CURB AT BOTH RETURNS.


EXPANSION JOINT (Typical)

1/2" CURB HEIGHT

TRANSITION FROM FULL CURB HEIGHT TO 1/2" CURB HEIGHT.

CONCRETE GUTTER

5' CONCRETE SIDEWALK

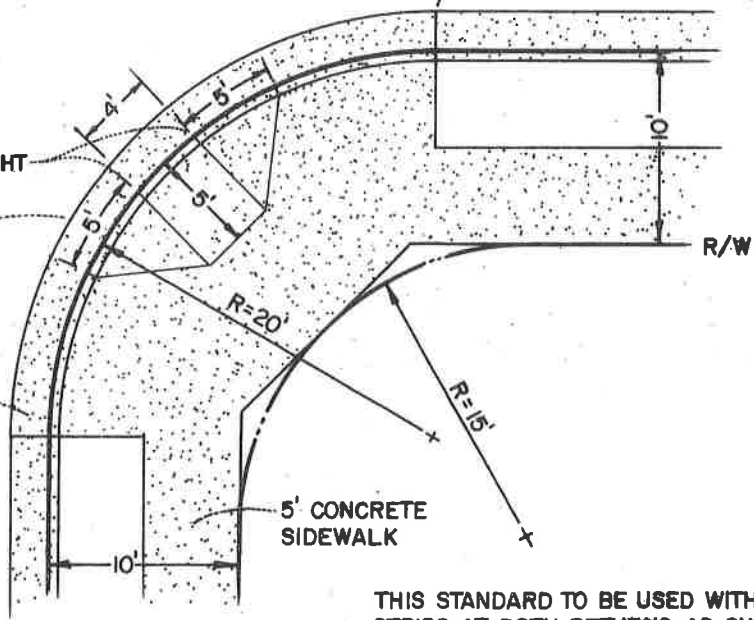

THIS STANDARD TO BE USED WITH PLANTER STRIPS AT BOTH RETURNS AS SHOWN AND WHEN SIDEWALK IS ADJACENT TO CURB AND GUTTER AT ONE RETURN ONLY.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

CURB RETURN


MARK	DATE	REVISION

Engineering Standard



Approved *[Signature]*

Date 9/13/79

ST-10

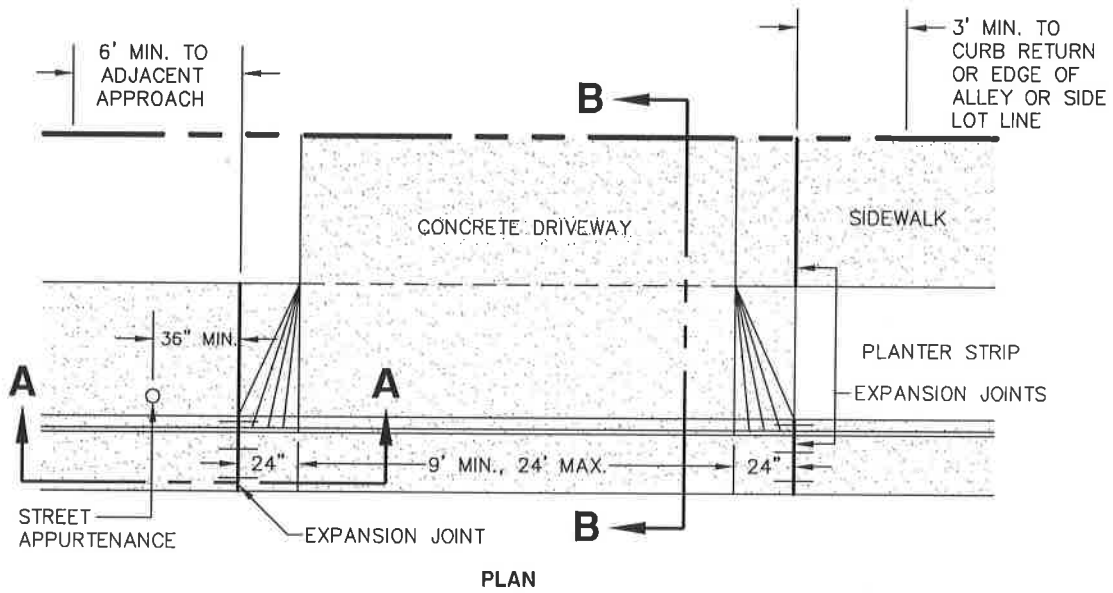


- NOTES:
1. CONCRETE SHALL BE 2500 P.S.I. (5 SACK MIX)
 2. APPROACH SHALL HAVE A HEAVY BROOM FINISH.
 3. CURING COMPOUND SHALL BE APPLIED AS APPROVED BY THE CITY ENGINEER.

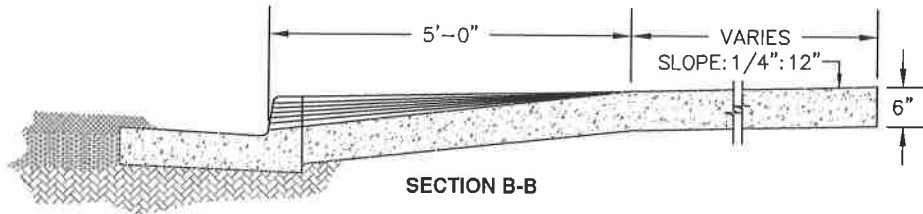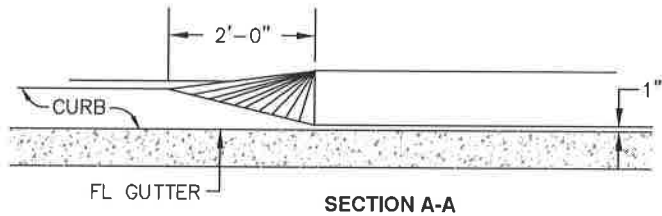


CITY OF *Lindsay*
DEPARTMENT OF CITY SERVICES

RESIDENTIAL DRIVE APPROACH				ENGINEERING STANDARD	ST-11
MARK	DATE	REVISION	APPROVED		
			DATE		

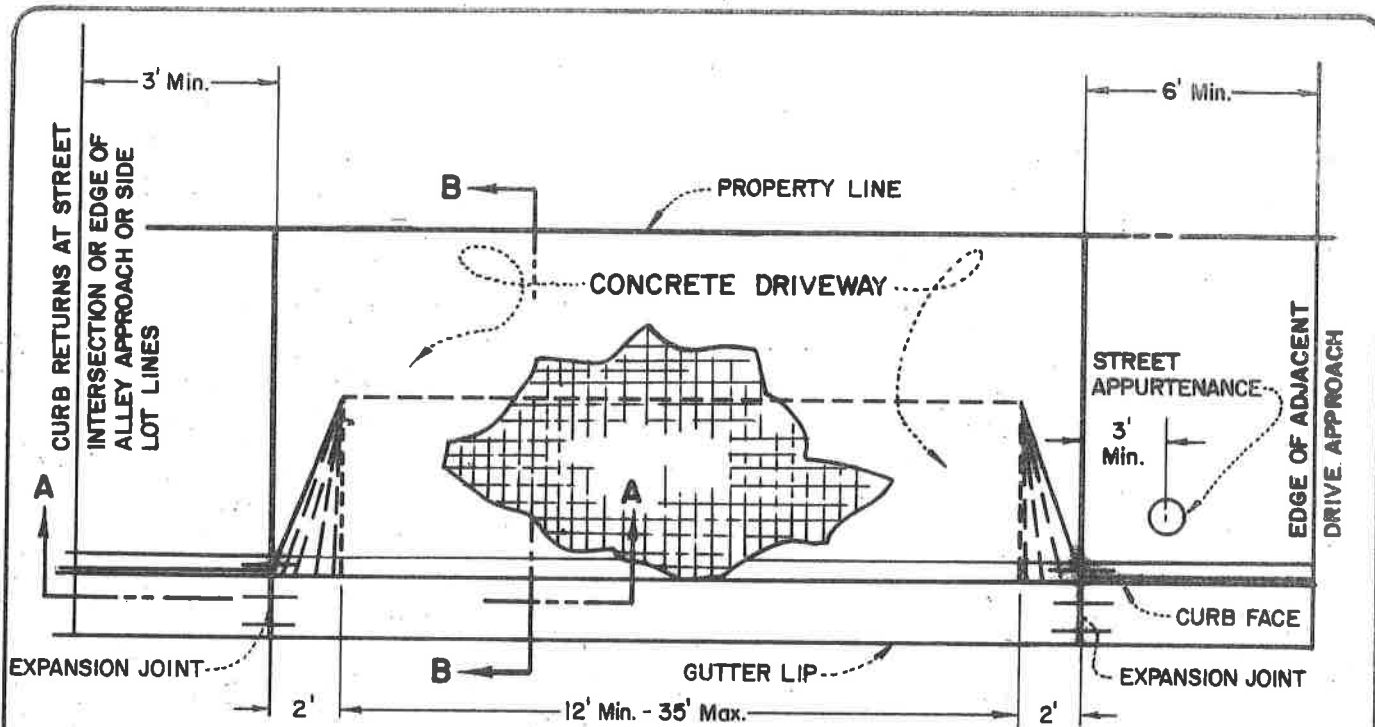


PLAN

NOTE:
 NOT MORE THAN 60% OF LOT FRONTAGE SHALL BE DRIVE APPROACH

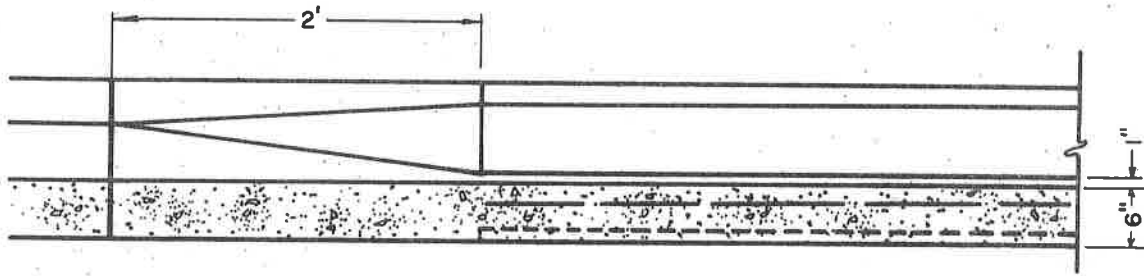

SECTION A-A

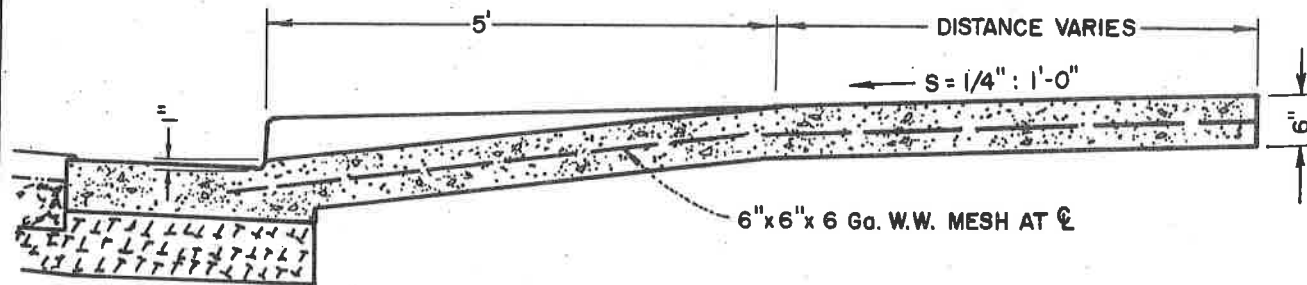

SECTION B-B

- NOTES:**
1. CONCRETE SHALL BE 2500psi. (5 SACK MIX)
 2. DRIVE APPROACH SHALL HAVE A HEAVY BROOM FINISH
 3. CURING COMPOUND SHALL BE APPLIED AS APPROVED BY THE CITY ENGINEER.

CITY OF *Lindsay*
 DEPARTMENT OF PUBLIC WORKS


COMMERCIAL DRIVE APPROACH

MARK	DATE	REVISION	Engineering Standard
			Approved: <i>[Signature]</i>
			Date: 9/12/79

ST-12

PORTION OF CURB
TO BE REMOVED

CUT LINE
(SEE NOTE BELOW)

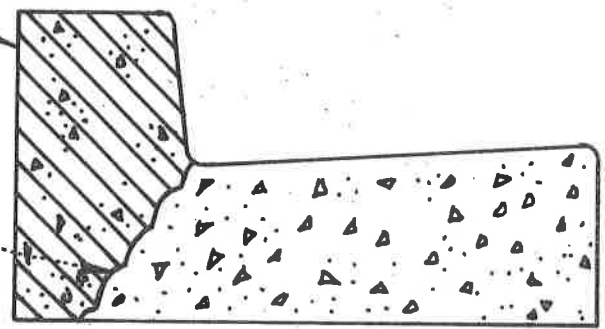

NOTE :
WHEN REMOVING CURB FOR NEW DRIVEWAY APPROACHES, CUT EXISTING CURB AS SHOWN ABOVE AT TOP OF APPROACH FOR NEW DRIVEWAY.



CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

CURB REMOVAL AT NEW DRIVE APPROACH

MARK	DATE	REVISION

Engineering Standard
Approved: *[Signature]*
Date: 9/13/79


ST-13

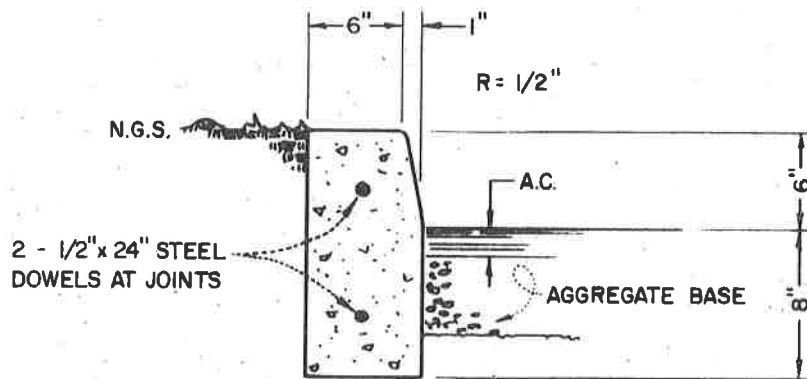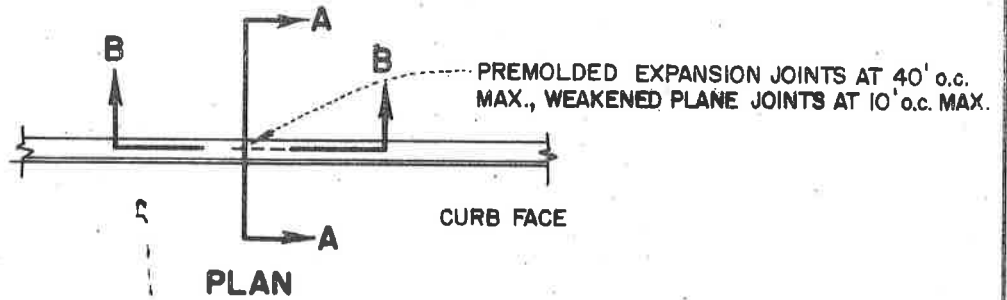

SECTION A-A

NOTES:

1. CONCRETE SHALL BE 2500psi. (5 Sack Mix)
2. CURB SHALL HAVE A LIGHT BRUSH FINISH
3. CURING COMPOUND SHALL BE APPLIED AS APPROVED BY THE CITY ENGINEER.

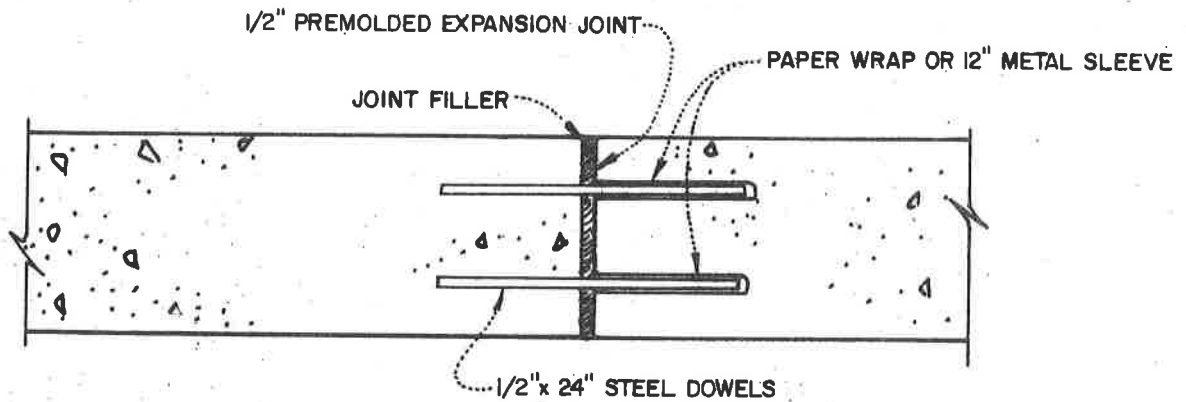

SECTION B-B

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

BARRIER TYPE CURB ONLY



MARK	DATE	REVISION

Engineering Standard

Approved


Date

[Signature]
9/13/79 ST-14

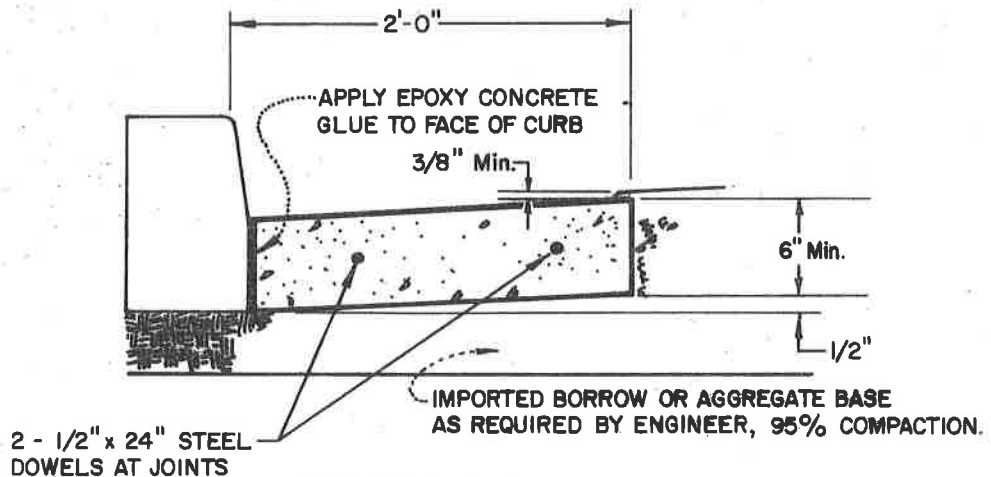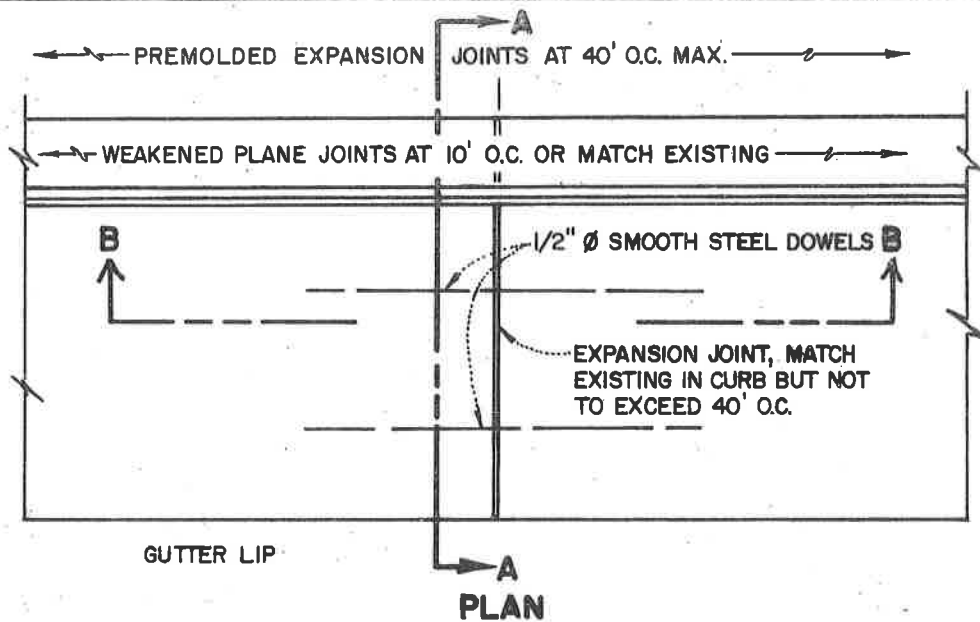

NOTES:

1. CONCRETE SHALL BE 2500ps.i. (5 SACK MIX)
2. GUTTER FINISH SHALL BE LIGHT BROOM FINISH.
3. CURING COMPOUND SHALL BE APPLIED AS APPROVED BY THE CITY ENGINEER

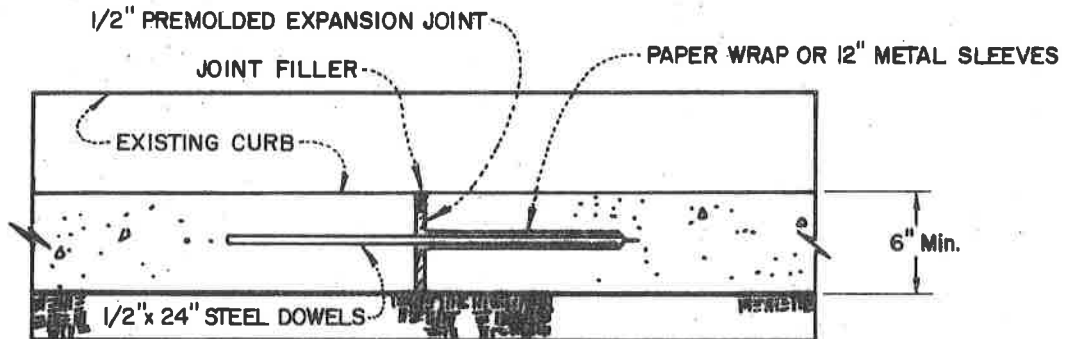


NOTE:
GUTTER SHALL HAVE A GRADIENT OF .20% Min.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

CONCRETE GUTTER AT EXISTING CURB


MARK	DATE	REVISION	Engineering Standard
			Approved: <i>[Signature]</i>
			Date: 9/13/79

ST-15

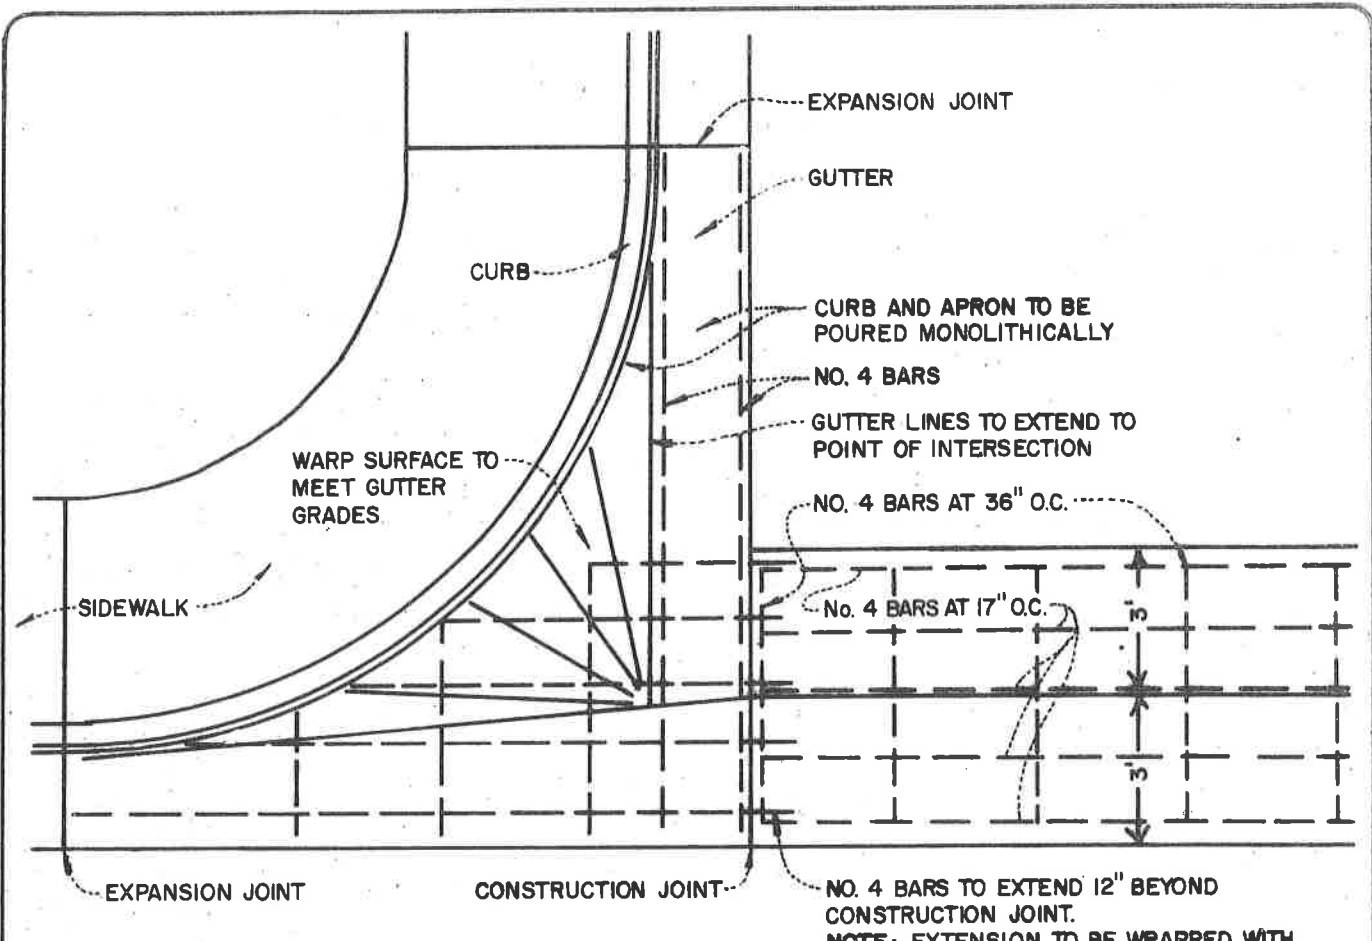

PLAN

NOTE: EXTENSION TO BE WRAPPED WITH A KRAFT TYPE PAPER TO ALLOW MOVEMENT.

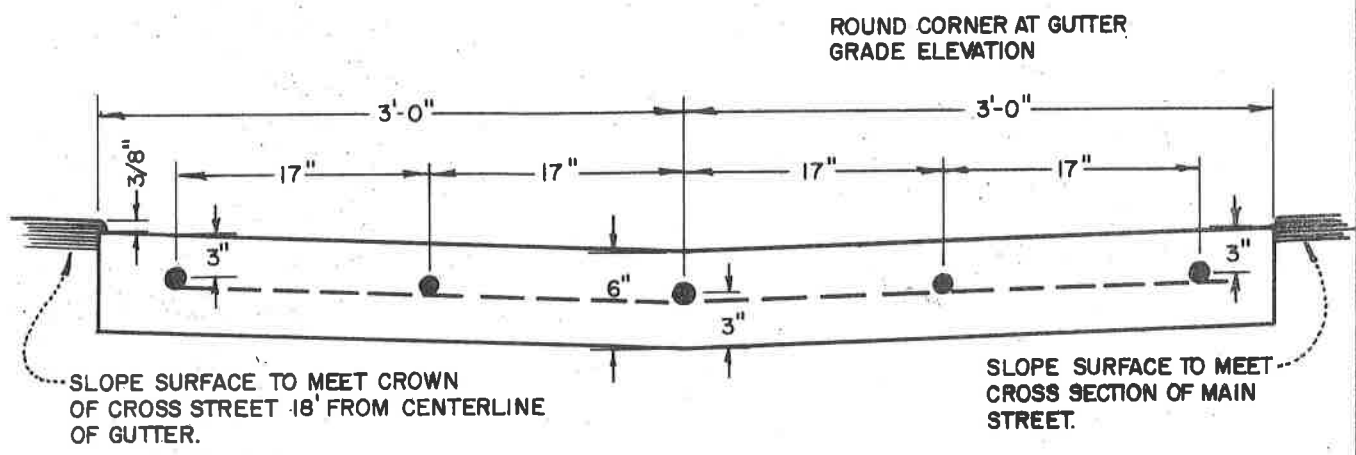

SECTION

CONCRETE SHALL BE 3000 p.s.i.
 LIGHT BROOM FINISH
 BEDDING REQUIREMENT PER
 CITY ENGINEER, CURING
 COMPOUND PER CITY
 ENGINEER.

CITY OF *Lindsay*
 DEPARTMENT OF PUBLIC WORKS

CROSS GUTTER

MARK	DATE	REVISION

Engineering Standard
 Approved *[Signature]*
 Date 9/14/79


ST-16

TYPE OF LUMBER

POSTS - REDWOOD (SHOP GRADE)
RAILING - DOUGLAS FIR (SHOP GRADE)

PAINT

TWO COATS OF WHITE PAINT SHALL BE APPLIED TO ALL WOOD SURFACES.

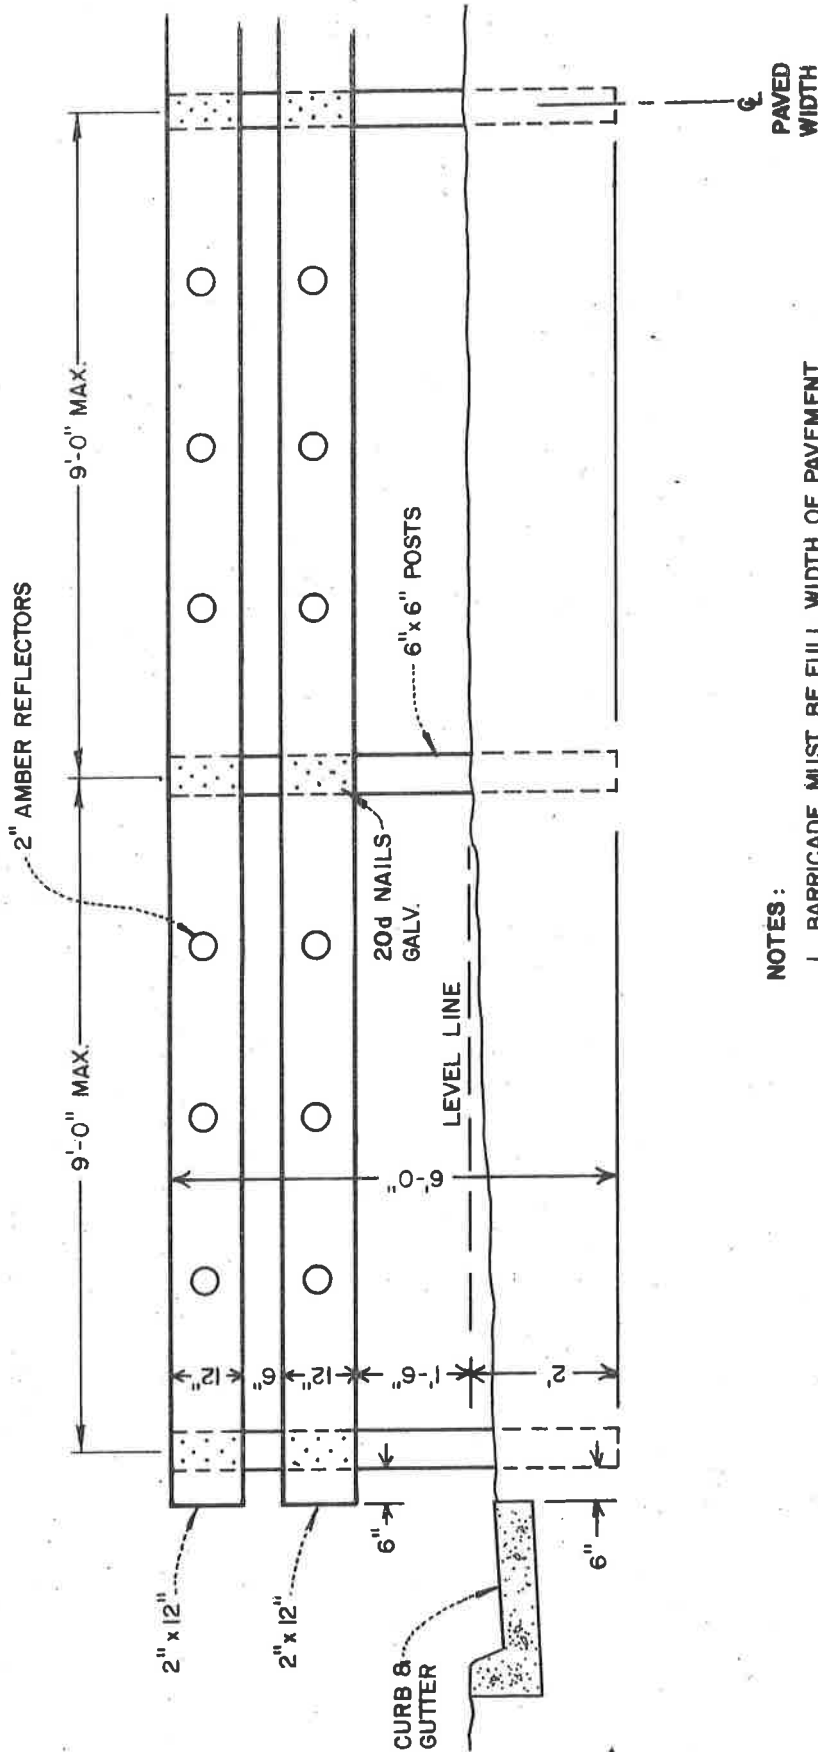

NOTES :

1. BARRICADE MUST BE FULL WIDTH OF PAVEMENT OR TRAVELED WAY.
2. APPROPRIATE SIGNS TO BE DESIGNATED BY THE DEPARTMENT OF PUBLIC WORKS.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

TIMBER BARRICADE

MARK	DATE	REVISION


Engineering Standard
Approved: *[Signature]*
Date: 9/14/79

ST-17

LOCATION: ON RIGHT SIDE OF TRAFFIC ON MAJOR STREET, IN SIDEWALK 12" BEHIND CURB FACE, AT BEGINNING OF CURB RETURN OR AT A "T" INTERSECTION IN LINE WITH CURB OF OPPOSING STREET.


SUPPORT: MOUNT ON 2" OR 2-1/2" GALVANIZED IRON PIPE 10' LONG, BOTTOM PLACED 2' BELOW SIDEWALK GRADE. SUPPORT SHOULD BE PLACED AT TIME P.C.C. SIDEWALKS ARE CONSTRUCTED. PIPE MUST HAVE 4" BOLT THRU AT A POINT JUST BELOW S/W LEVEL. SIGNS MAY BE MOUNTED WITH BRACKET ON STREET LIGHT ELECTROLIER. BRACKET TO BE PAINTED COLOR OF ELECTROLIER.

SIGN MATERIAL: PORCELAIN BOX TYPE SINGLE PIECE, APP 9"x30" OVERALL WHITE 4" LETTERS ON DARK GREEN (I.E. DELUX 872) ABOVE 2" BLOCK NUMBERS WITH ARROW. EMBOSSED BORDER.

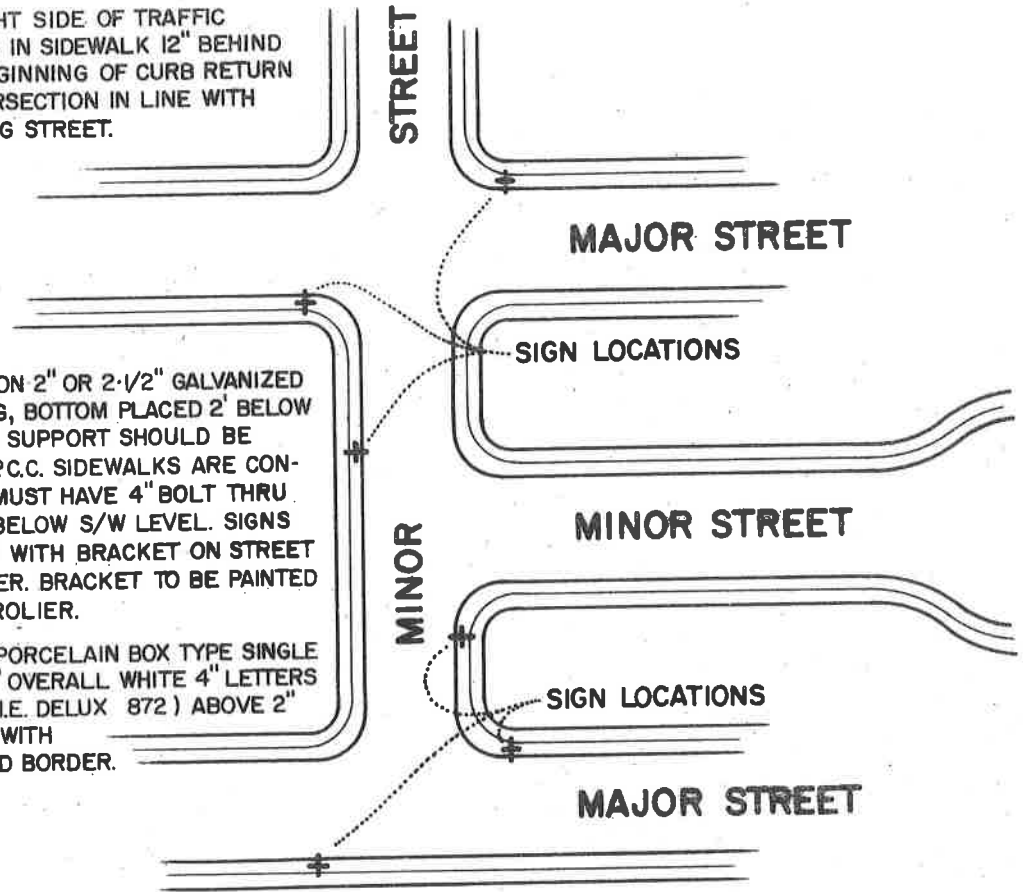

ARRANGEMENT: SIGN FOR N-S TO BE PLACED ON TOP AND SIGN TO BE PARALLEL TO STREET WHICH IT NAMES.


PROCURING: CITY WILL ORDER STREET SIGNS ON RECEIPT OF DEPOSIT FROM SUBDIVIDER.

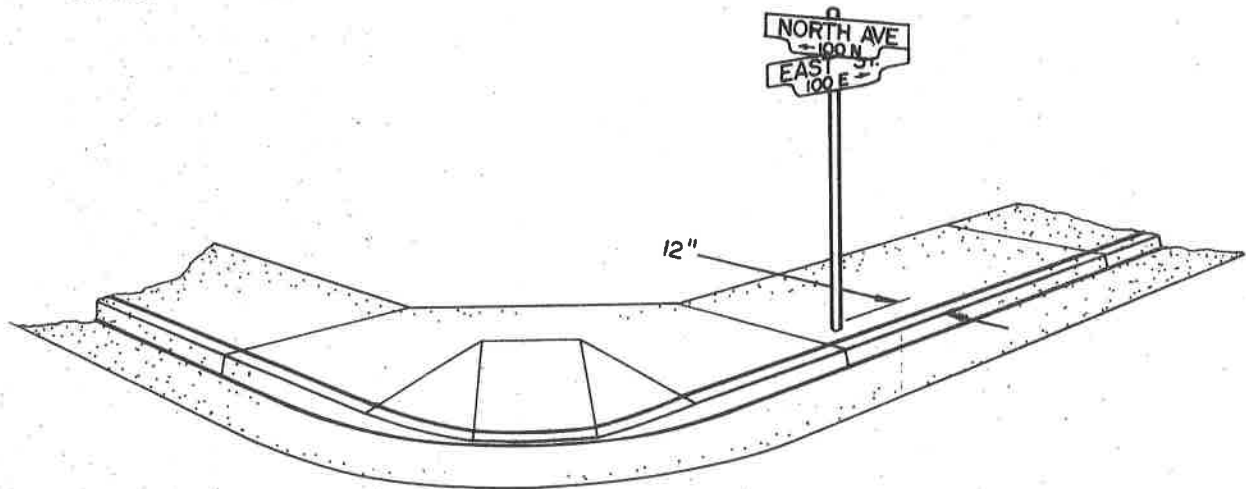


CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

STREET SIGN LOCATION

MARK	DATE	REVISION	Engineering Standard	ST-18
			Approved <i>[Signature]</i>	
			Date 9/13/79	

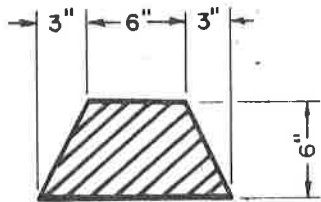


PLANT MIX ASPHALT CONCRETE

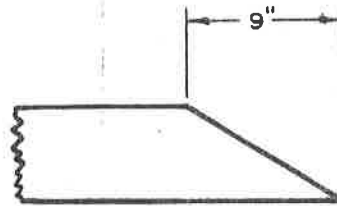


PAINTED WITH ASPHALTIC PAINT

6" DIKE


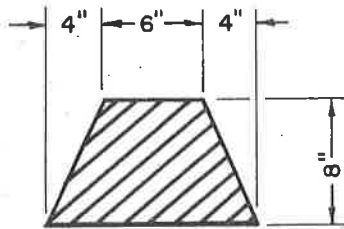


PLANT MIX ASPHALT CONCRETE

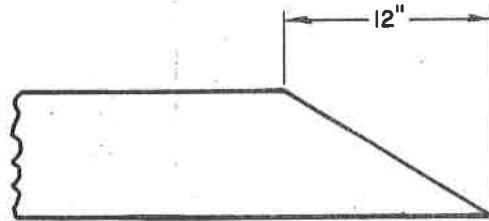

PAINTED WITH ASPHALTIC PAINT

8" DIKE

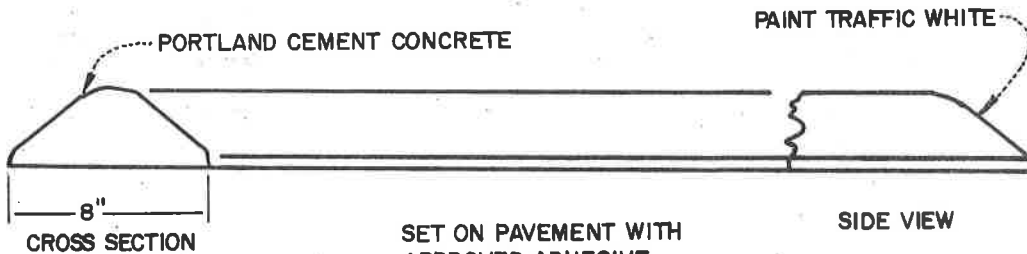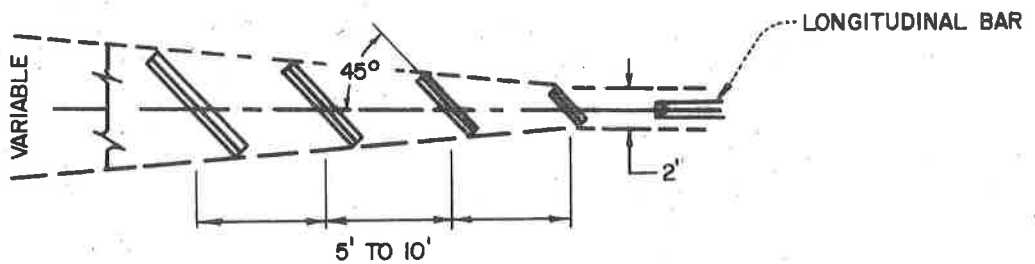

RAISED TRAFFIC BARS


CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

TRAFFIC BARS

MARK	DATE	REVISION

Engineering Standard
Approved *[Signature]*
Date 7/19/79

ST-19

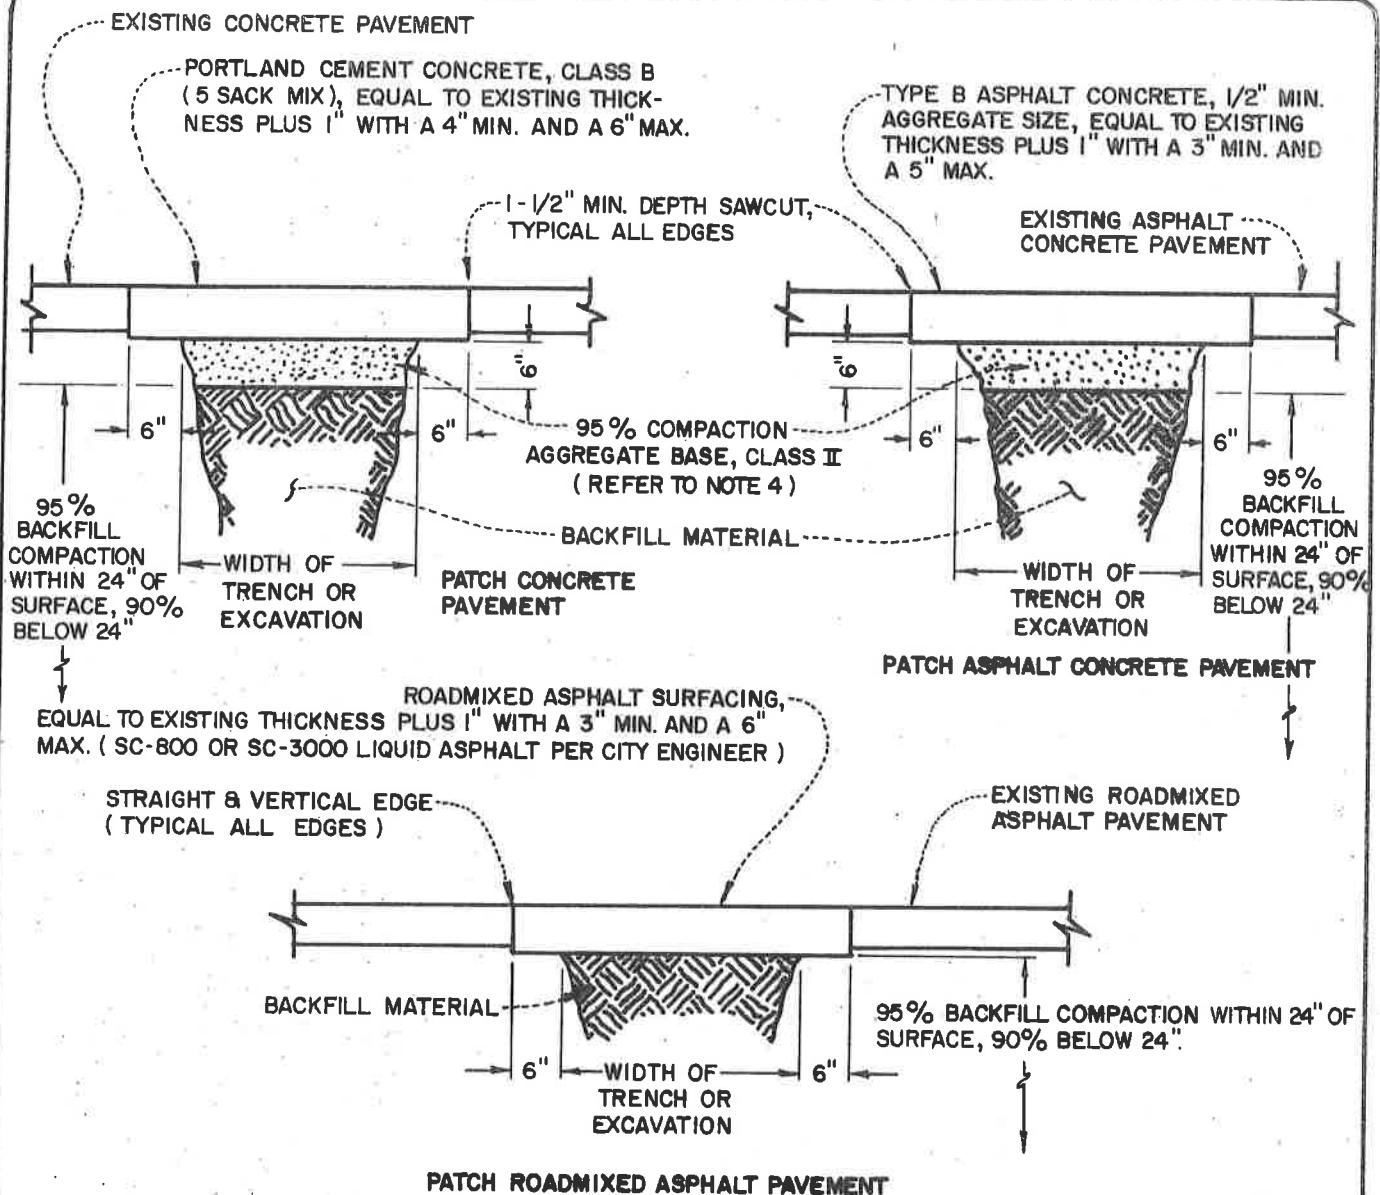

GENERAL NOTES :

1. ALL MATERIALS AND WORKMANSHIP SHALL CONFORM TO CITY STANDARD SPECIFICATIONS.
2. SUITABILITY OF BACKFILL MATERIAL SHALL BE AT THE DISCRETION OF THE CITY ENGINEER.
3. BACKFILL COMPACTION OUTSIDE OF ROADWAY OR ALLEYWAY STRUCTURAL SECTION SHALL BE 85%. (EXAMPLE : BEHIND BACK OF CURB OR WITHIN EASEMENTS.)
4. DECOMPOSED GRANITE FROM SOURCE APPROVED BY CITY ENGINEER MAY BE SUBSTITUTED FOR CLASS II BASE WITH A 10% INCREASE IN THE REQUIRED BASE THICKNESS AND 95% COMPACTION IN THE BASE. THIS SUBSTITUTION WILL ONLY BE ALLOWED IN MINOR COLLECTOR, LOCAL OR CUL-DE-SAC ROADWAYS AND IN ALLEYWAYS AND WOULD REQUIRE A 10% INCREASE IN THE THICKNESS INDICATED. THIS SUBSTITUTION WILL NOT BE ALLOWED WITH MAJOR COLLECTOR OR ARTERIAL ROADWAYS.
5. SAWCUTS OR VERTICAL EDGES SHALL BE MADE PARALLEL TO, OR AT RIGHT ANGLES TO, THE CENTER-LINE OF THE ROADWAY OR ALLEYWAY.
6. PATCHES LESS THAN TWO FEET FROM EXISTING PATCHES, EDGES OF PAVEMENT OR GUTTERS SHALL BE EXTENDED TO INCLUDE THE INTERMEDIATE ISOLATING STRIP OF EXISTING PAVEMENT.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

PAVEMENT PATCHES


MARK	DATE	REVISION

Engineering Standard

Approved *[Signature]*

Date 9/14/79

ST-20



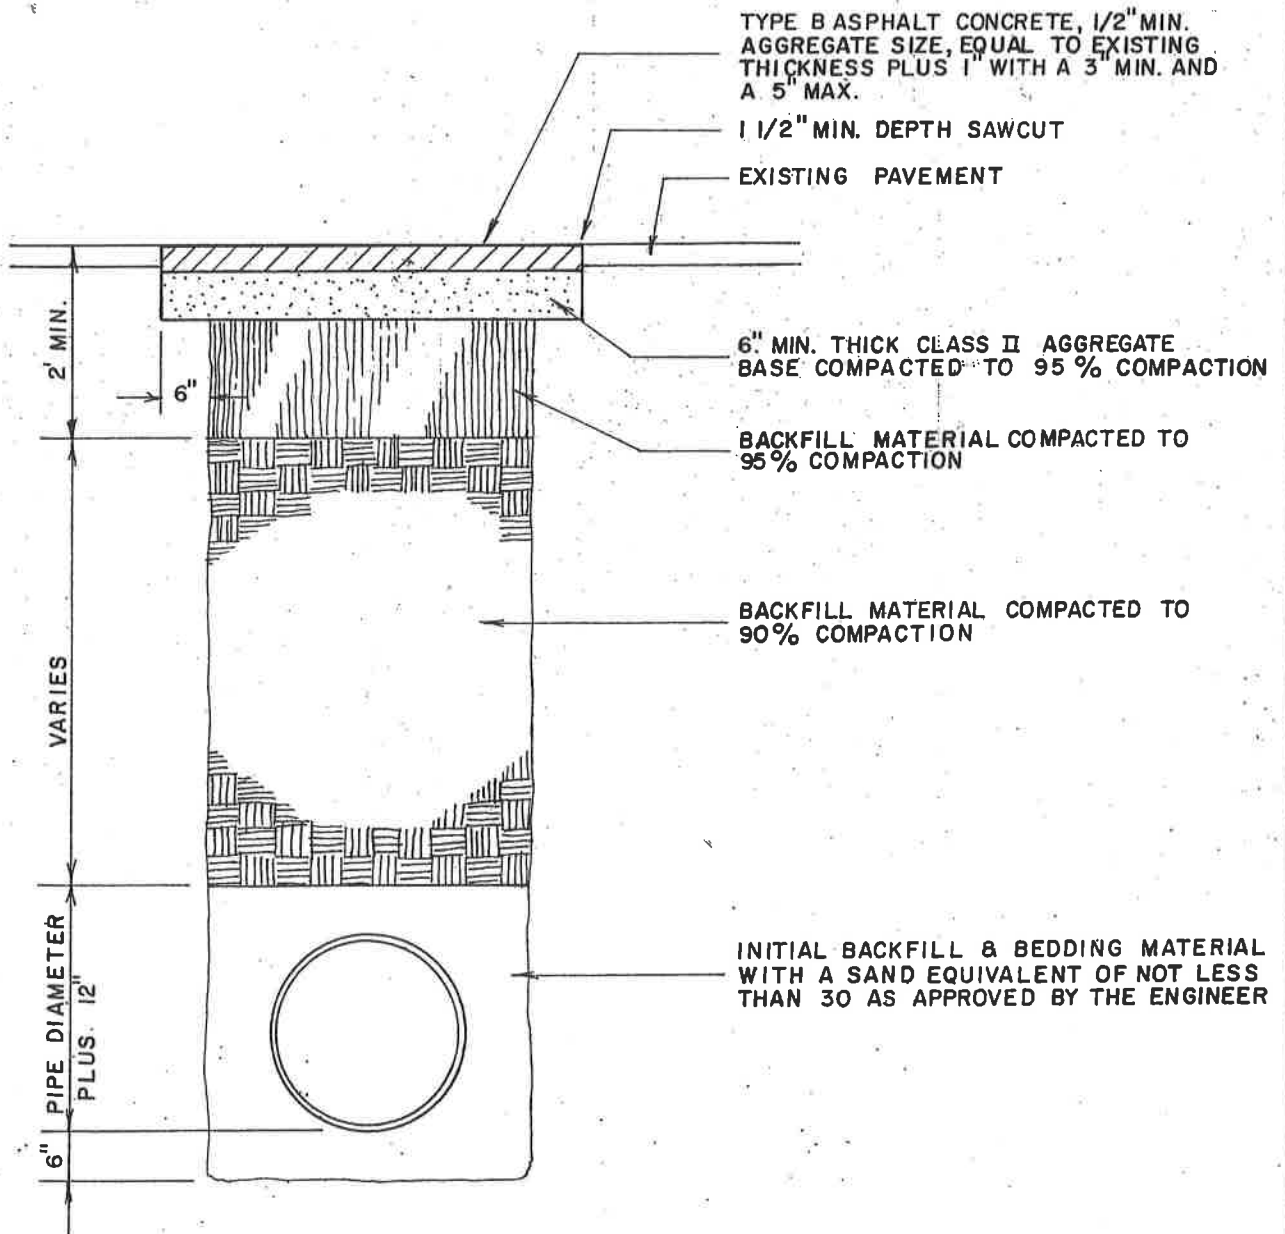


**TYPICAL TRENCH SECTION
AT PAVED AREAS**

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

MARK	DATE	REVISION	Engineering Standard
			Approved
			Date

ST-20A

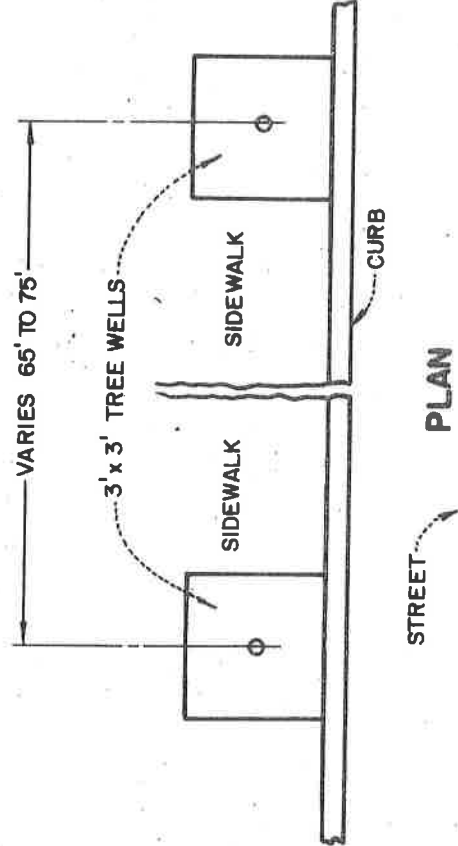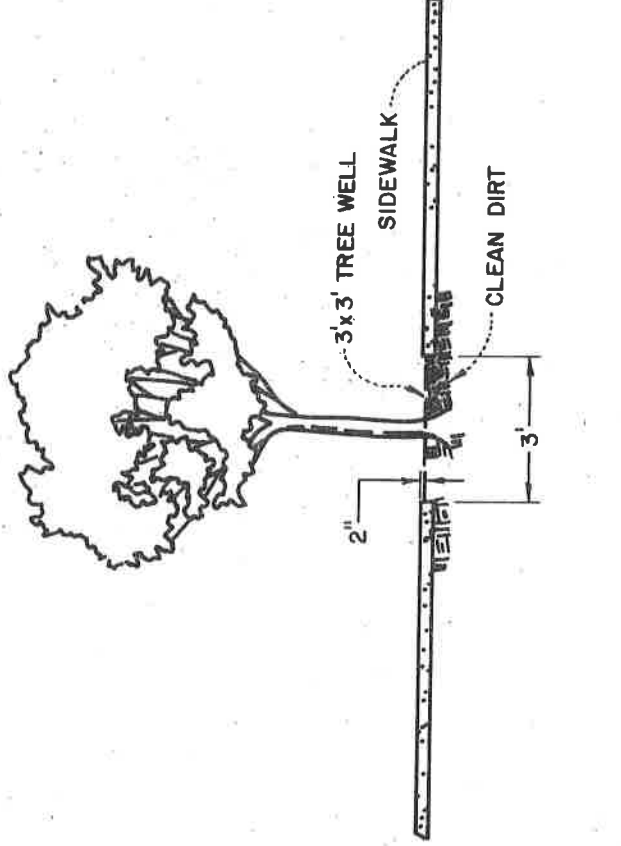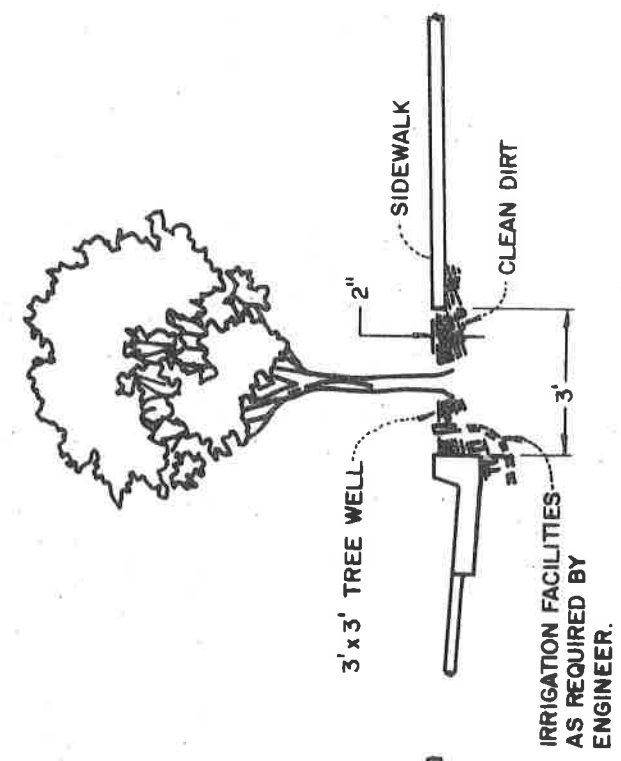




- NOTES:**
1. PAVE SURFACE WITH BRICKS OR FLOWERS
 2. FORM LUMBER FOR TREE WELL SHALL BE 2" x 4"
 3. ONE INCH CONCRETE CAPPING MAY BE REQUIRED.
 4. IRRIGATION FACILITIES SHALL BE REQUIRED BY THE ENGINEER.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

**TREE WELL
COMMERCIAL SIDEWALK PATTERN ONLY**


MARK	DATE	REVISION

Engineering Standard
Approved: *[Signature]* ST-21
Date: 9/13/79

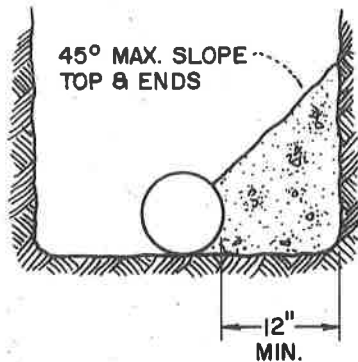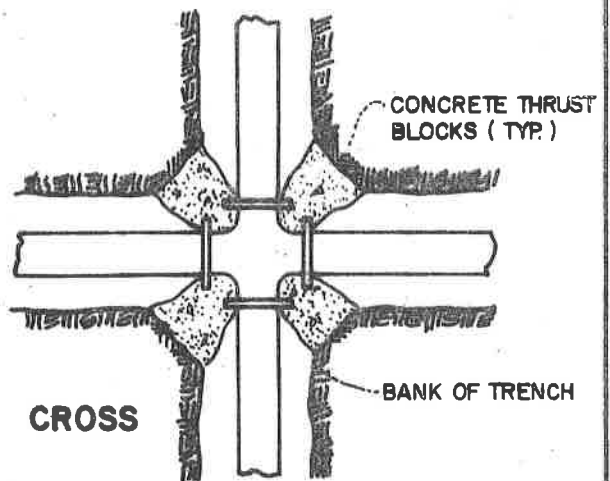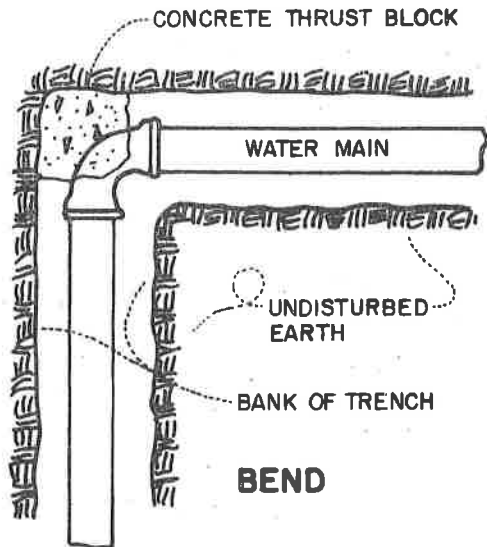


Note :

CONCRETE SHALL BE 2500 p.s.i. (5 SACK) .
 ALL SITUATIONS NOT COVERED HERE SHALL
 BE INDIVIDUALLY DESIGNED BY THE CITY
 ENGINEER.

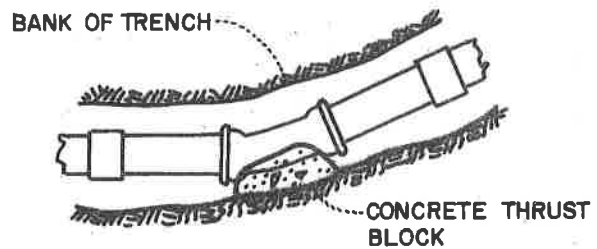

ANGLE BEND

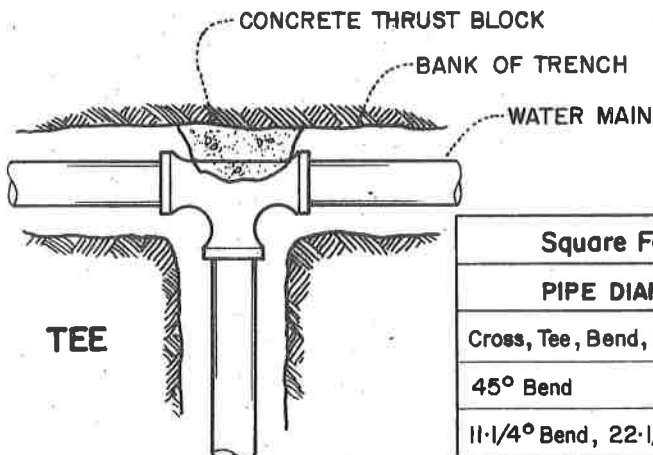


Square Feet of Bearing Areas Required				
PIPE DIAMETER	6"	8"	10"	12"
Cross, Tee, Bend, Plug & Fire Hydrant	3	5	8	11
45° Bend	2	3	5	6
11-1/4° Bend, 22-1/2° Bend	1	2	3	3


CITY OF *Lindsay*
 DEPARTMENT OF PUBLIC WORKS

CONCRETE THRUST BLOCK DETAIL

MARK	DATE	REVISION	Engineering Standard	
			Approved <i>[Signature]</i>	WA-1
			Date 9/14/79	

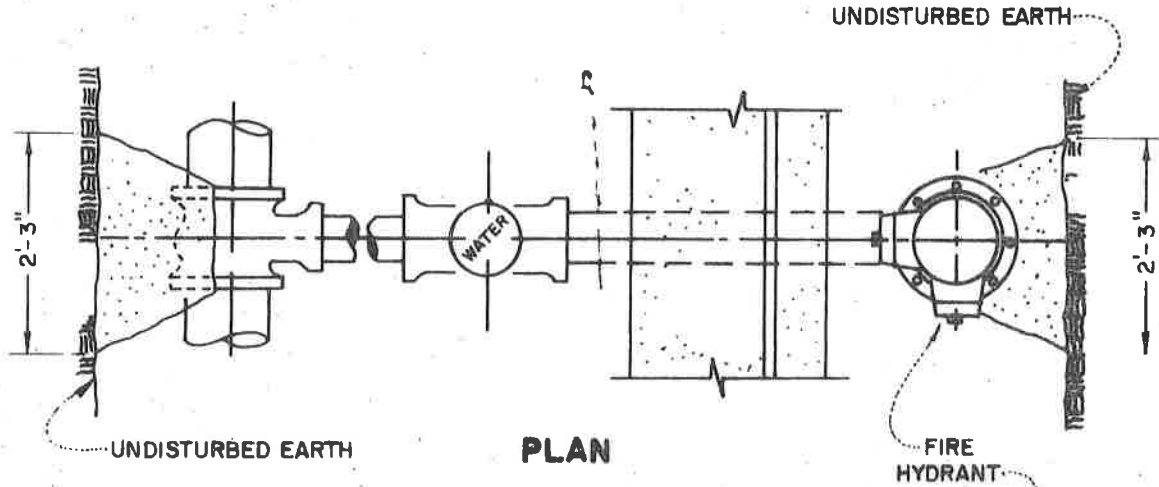

PLAN


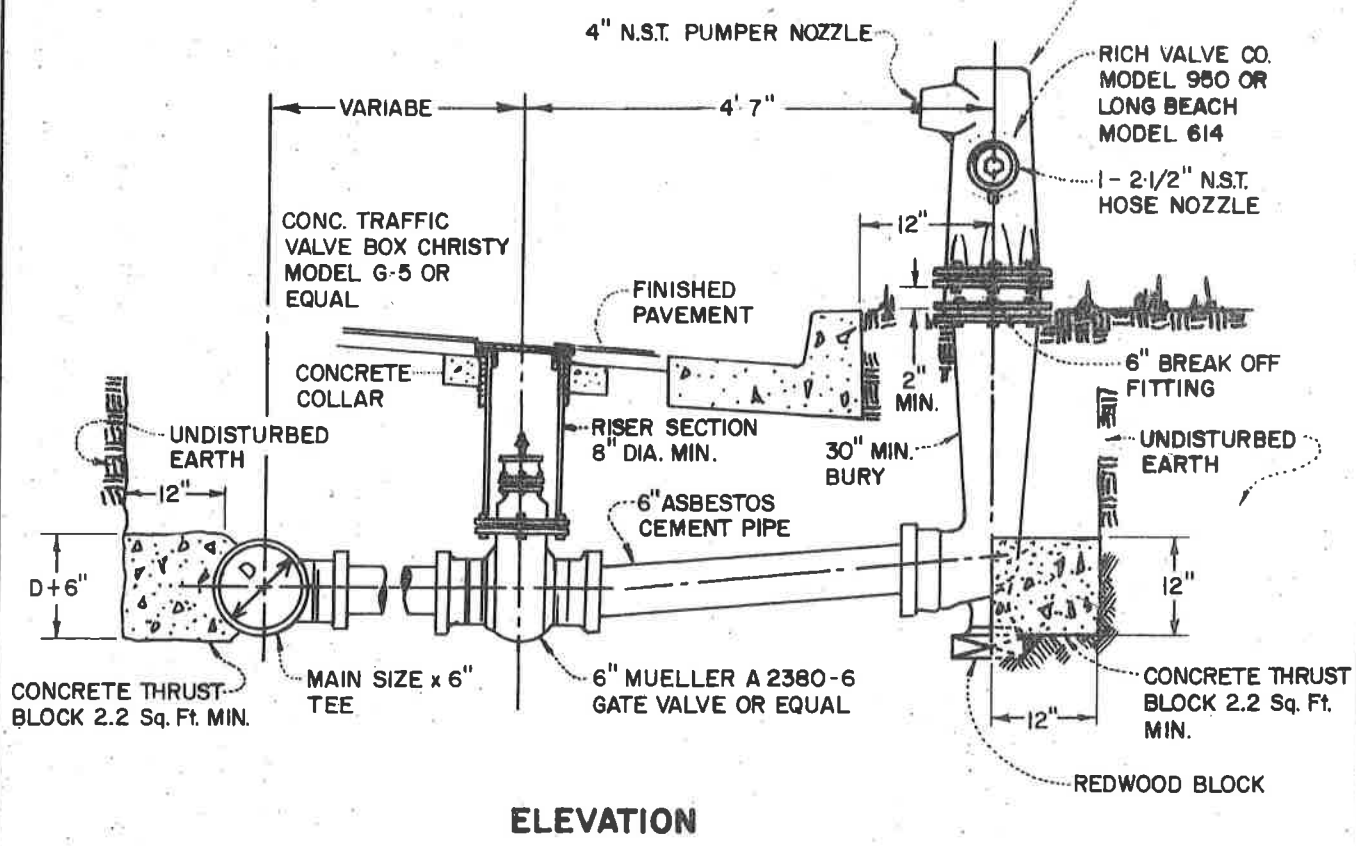


ELEVATION

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

FIRE HYDRANT ASSEMBLY

MARK	DATE	REVISION	Engineering Standard	WA-2
			Approved <i>[Signature]</i>	
			Date 9/13/79	

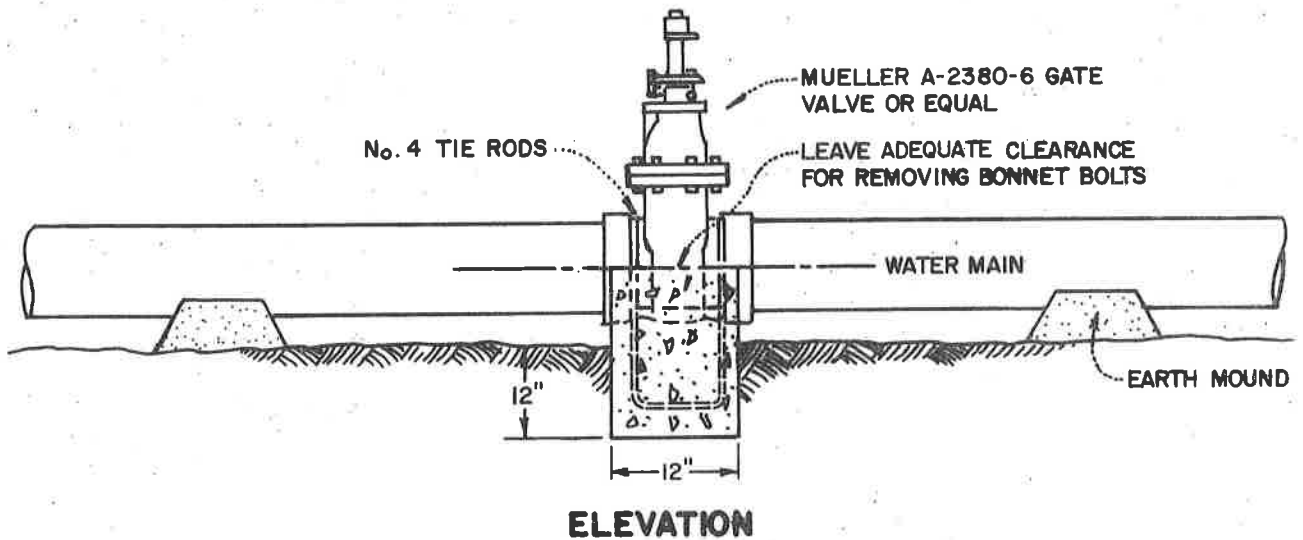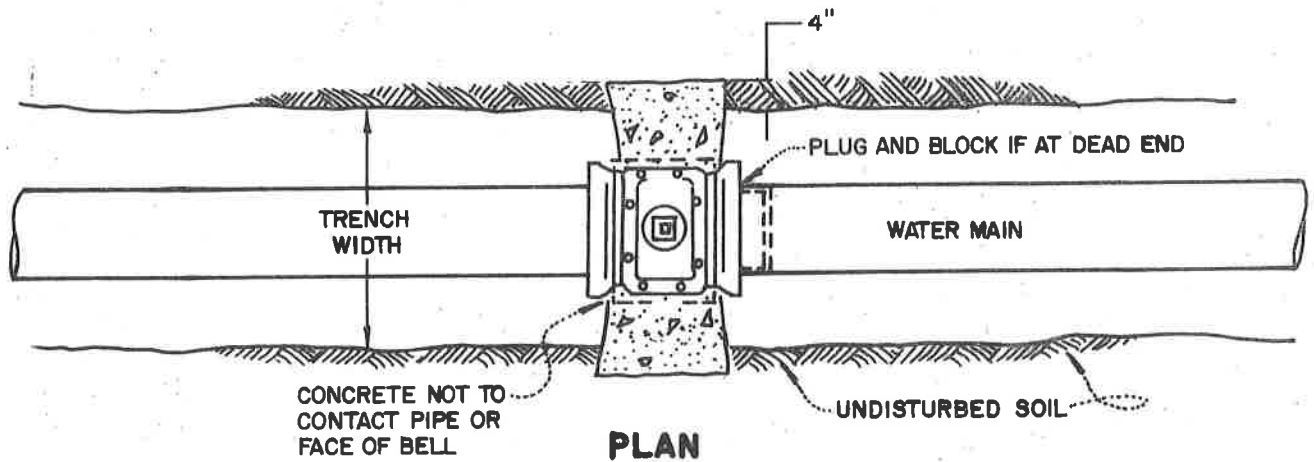

NOTES:

1. ALL GATE VALVE THRUST BLOCKS TO BE SIZED FOR DIFFERENTIAL PRESSURE OF 150 p.s.i.
2. VALVES ON TEMPORARY DEAD ENDS TO BE BLOCKED FOR FUTURE EXTENSION WITH DIFFERENTIAL PRESSURE ON VALVE.
3. TIE RODS (COATED WITH MORTAR OR BITUMASTIC MATERIAL) REQUIRED ON ALL VALVES OVER 12" AND ALL VALVES AT DEAD ENDS.


CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

GATE VALVE

MARK	DATE	REVISION

Engineering Standard
Approved *[Signature]*
Date 9/14/79

WA-3

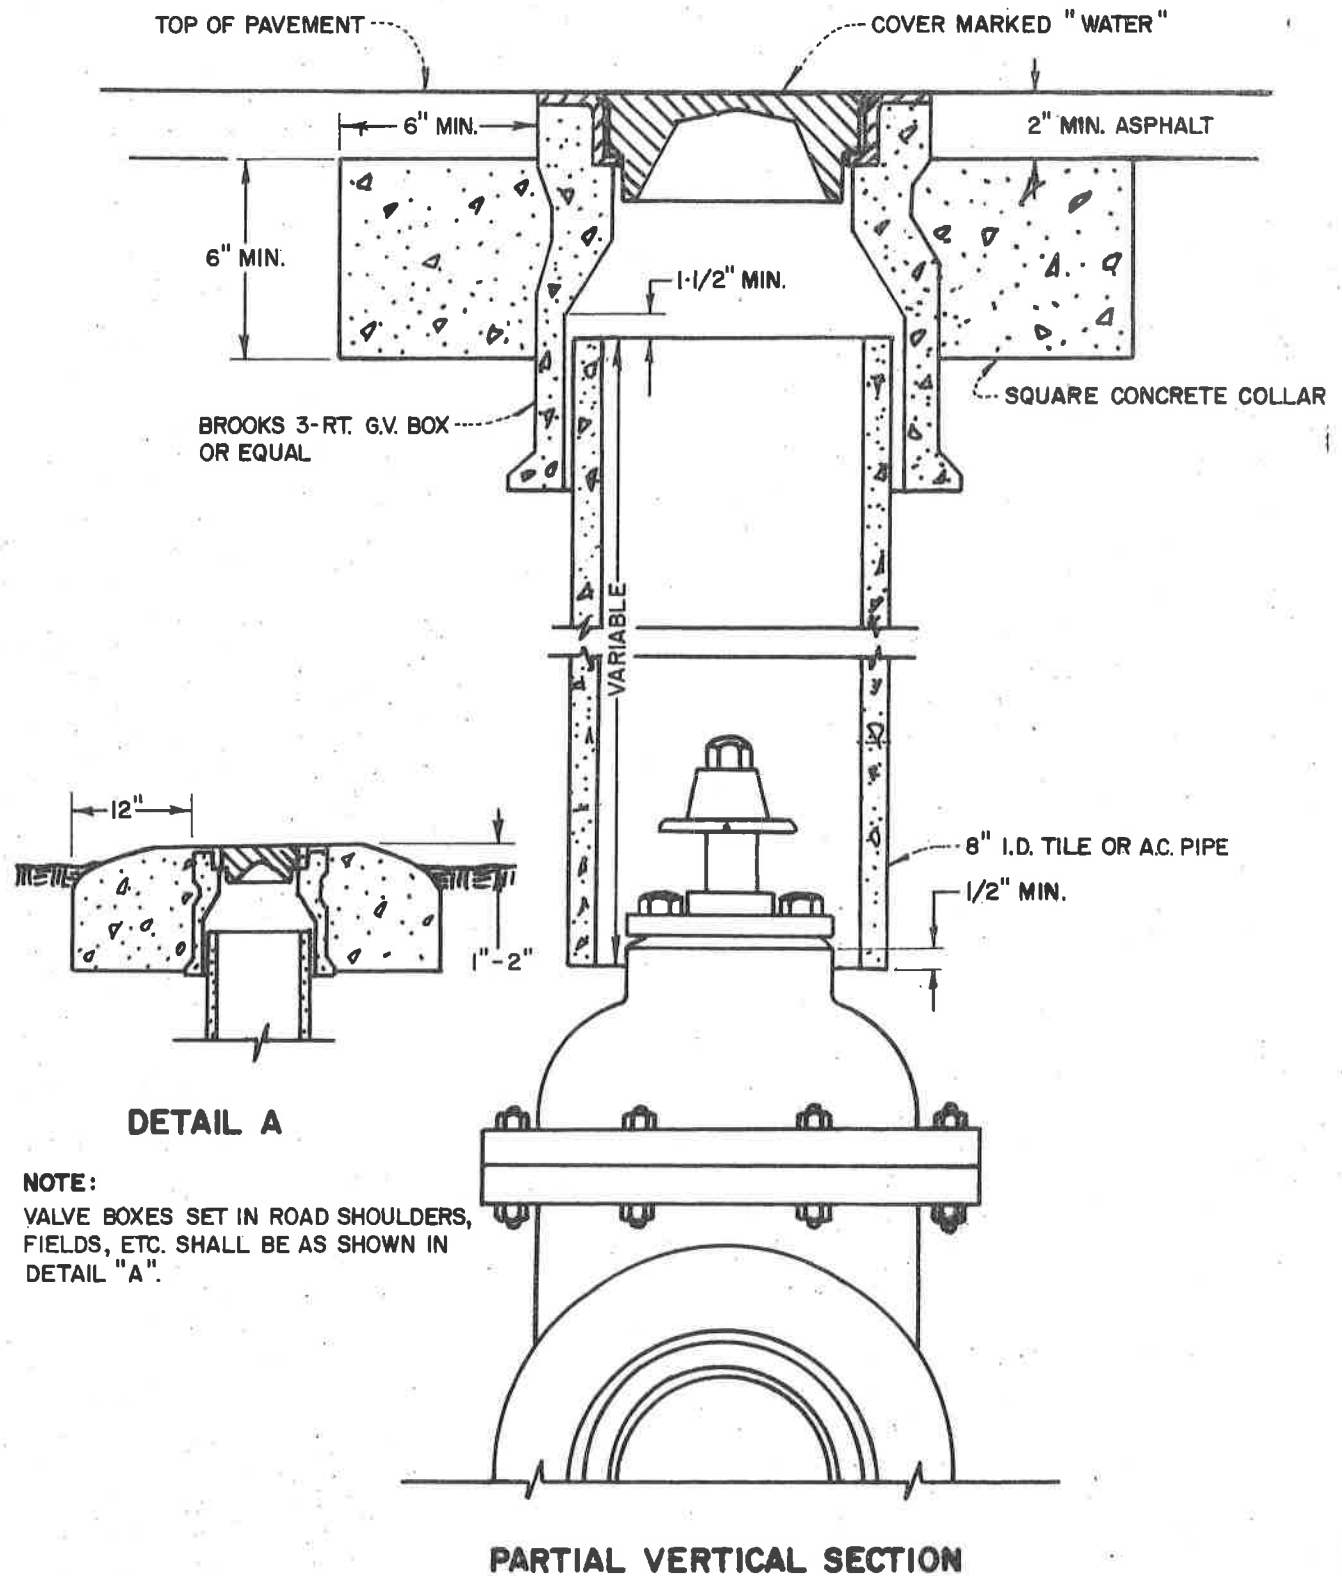

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

VALVE ACCESS BOX

MARK	DATE	REVISION

Engineering Standard


Approved

[Signature]

Date

July 9, 1979

WA-4

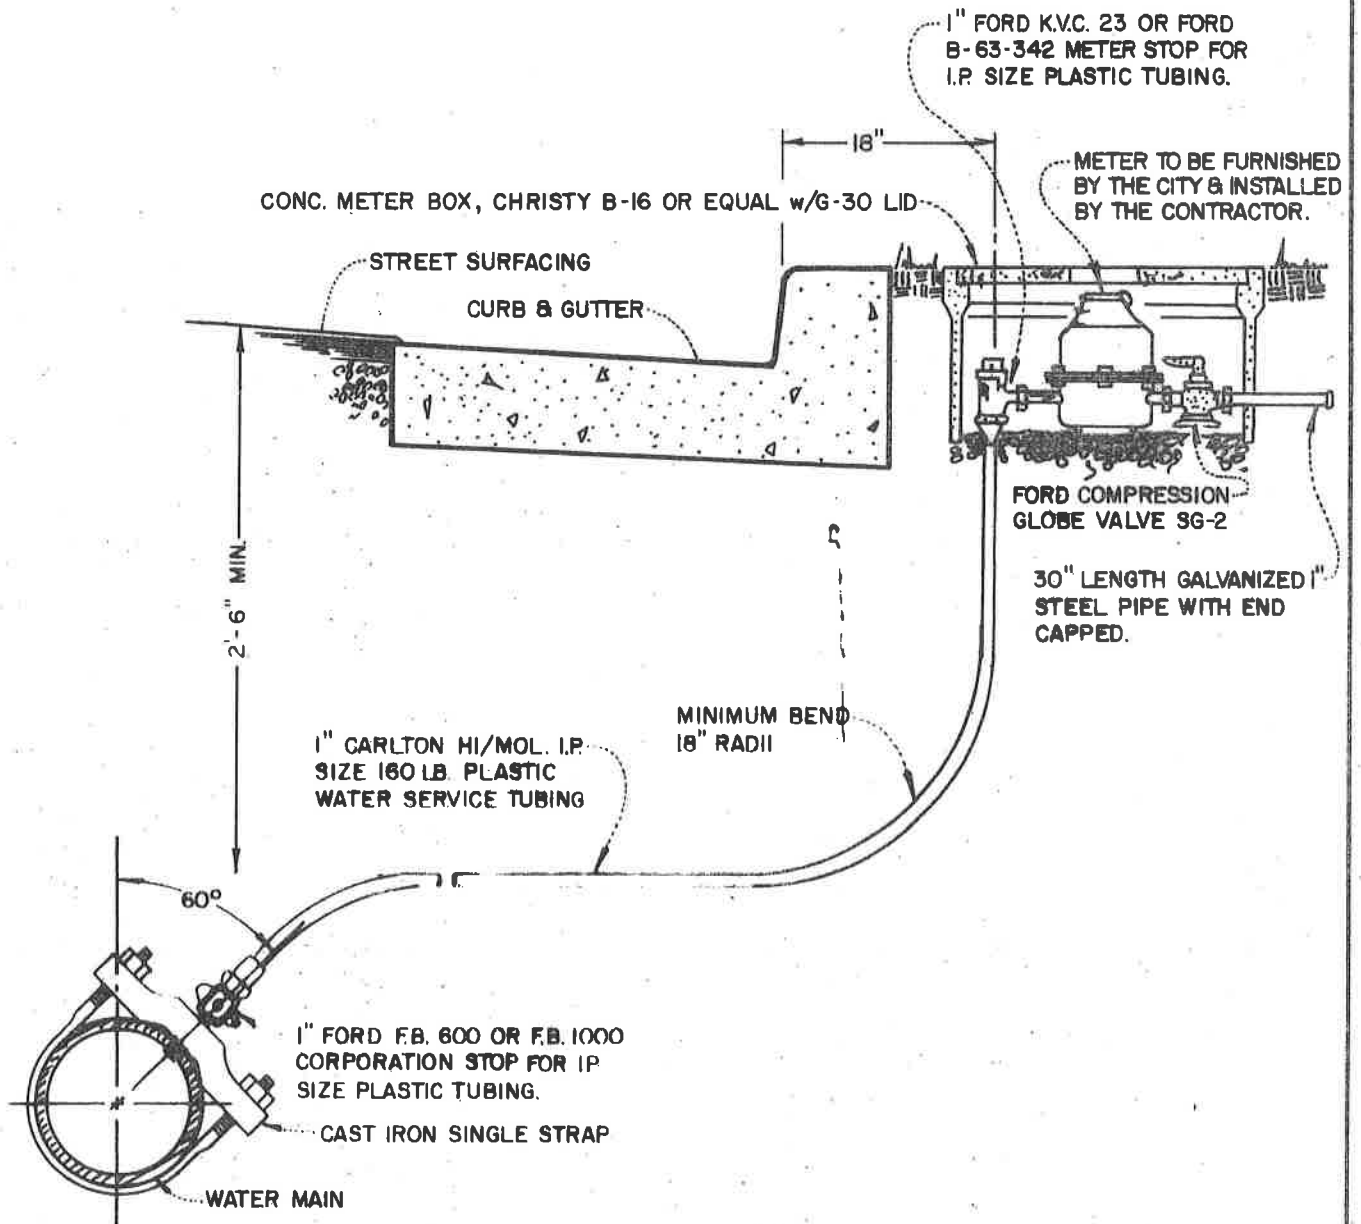


INSTALLATION DETAILS OF LARGER SERVICES TO BE DETERMINED BY ENGINEER.


CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

1" WATER SERVICE

MARK	DATE	REVISION	Engineering Standard	
			Approved <i>[Signature]</i>	WA-5
			Date 9/14/79	

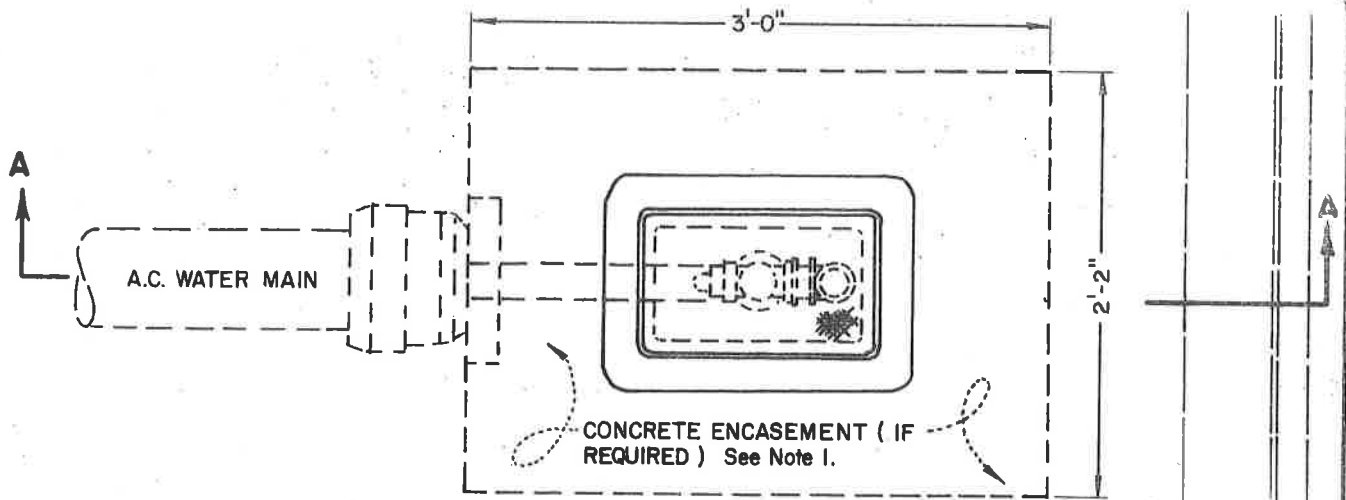

PLAN

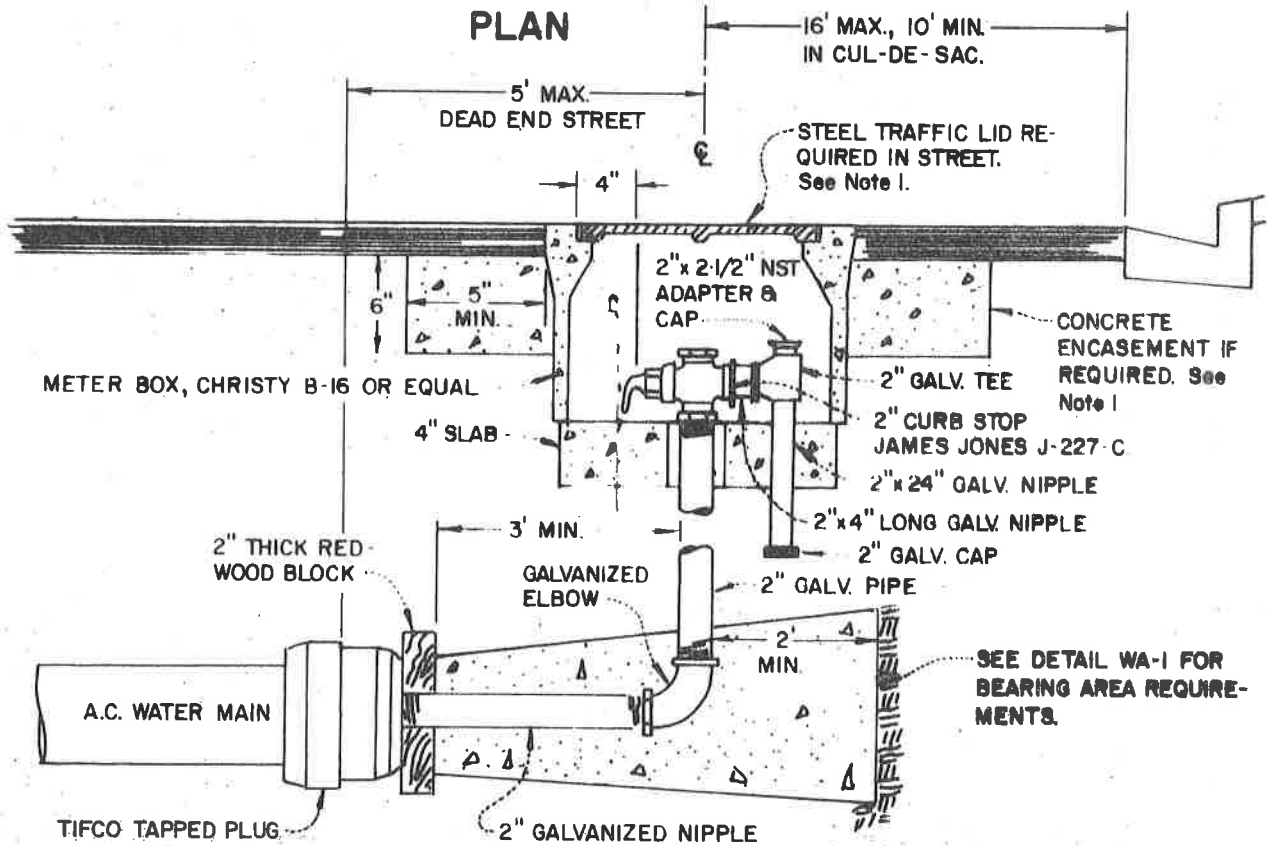

SECTION A-A

NOTES:

1. CONCRETE ENCASEMENT AND STEEL TRAFFIC LIDS REQUIRED FOR ALL PERMANENT INSTALLATIONS SUBJECT TO TRAFFIC.
2. CURB STOP KEY SHALL BE ALIGNED TO SIDE AS SHOWN.
3. ALL PIPE ENCASED IN CONCRETE TO BE PAINTED WITH RUST RESISTANT PAINT AND WRAPPED WITH PLASTIC TAPE.

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

BLOW OFF


MARK	DATE	REVISION

Engineering Standard

Approved: *[Signature]*

Date: 9/14/79

WA-6

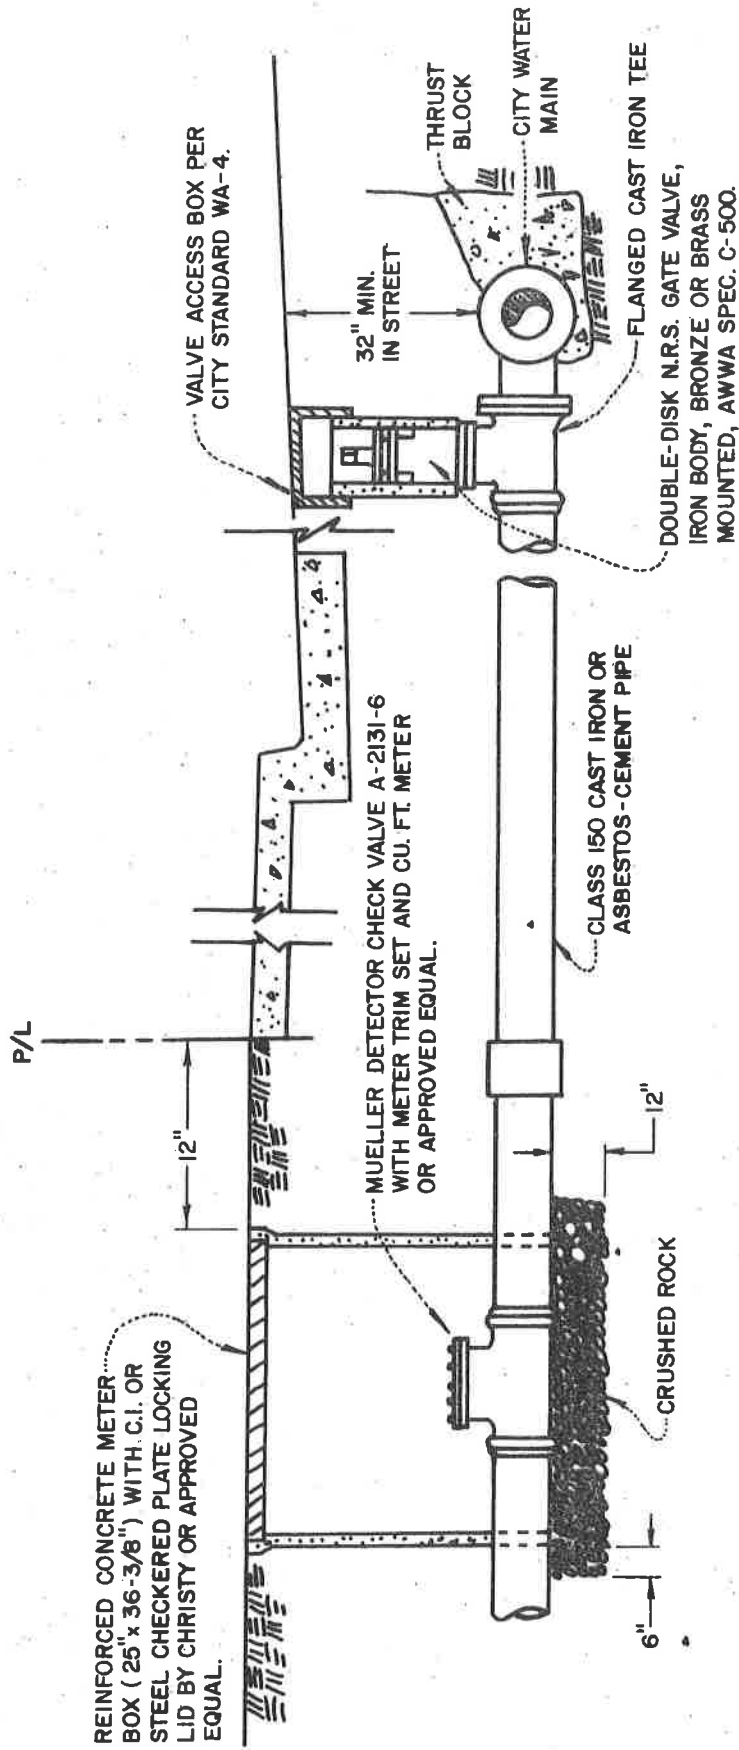

CITY OF *Lindsay*
 DEPARTMENT OF PUBLIC WORKS


FIRE SERVICE

MARK	DATE	REVISION

Engineering Standard

Approved *[Signature]* WA-7


Date 9/14/79

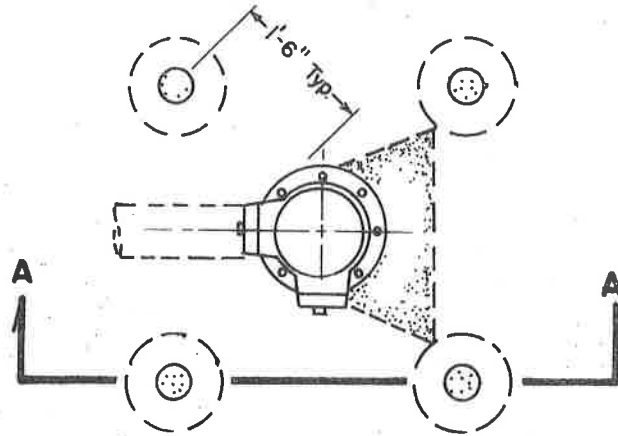

PLAN

NOTE :

THE INSTALLATION OF TWO TRAFFIC SIDE POSTS AT A FIRE HYDRANT SHALL CONSTITUTE ONE FIRE HYDRANT ASSEMBLY. ADDITIONAL POSTS MAY BE REQUIRED AT THE DIRECTION OF THE ENGINEER AND WOULD BE PLACED AS SHOWN

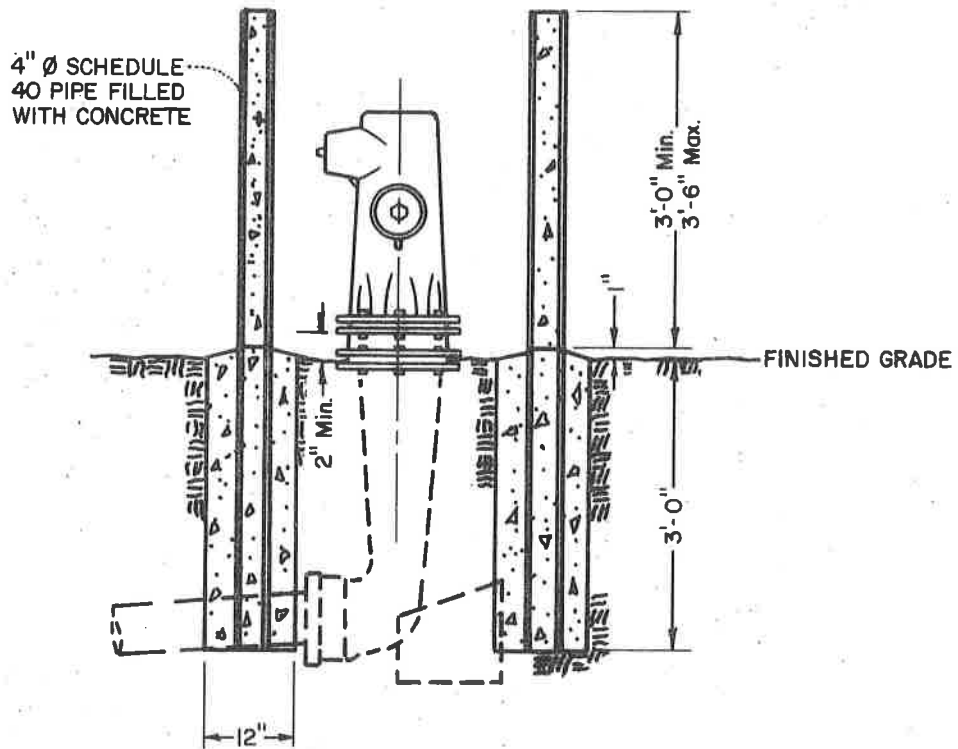

SECTION A-A

CITY OF *Lindsay*
DEPARTMENT OF PUBLIC WORKS

FIRE HYDRANT PROTECTION ASSEMBLY

MARK	DATE	REVISION

Engineering Standard

Approved *[Signature]*

Date *9/19/79*

WA-8